

Index

AI	Page	2
AIE	Page	7
AIES	Page	13
AIS	Page	20
B	Page	26
BD	Page	31
BEMF	Page	37
D	Page	44
DAE	Page	49
EDIX	Page	54
FLIP CAP	Page	59
FS/Q	Page	61
K	Page	66
KC	Page	71
KE	Page	76
KEYS	Page	81
KF	Page	87
KL	Page	92
KLC	Page	97
KLE	Page	103
KLF	Page	108
KLP	Page	113
KP	Page	120
KS	Page	125
KSD	Page	131
KSE	Page	137
KSP	Page	144
KSS	Page	149
KSSE	Page	156
KSUPS	Page	163
MBV	Page	169
MSI	Page	177
Olympus	Page	183
Salus	Page	189
Salus20	Page	194
TDI	Page	200
TDR	Page	206
W	Page	213
X	Page	218
Y	Page	223
Z	Page	228



AI-FSS-2

The AI is a single key access interlock ideal for use on hinged doors. The interlock has an open cavity design manufactured in either aluminium alloy/brass or stainless steel, making it ideal for use in harsh or corrosive environments and heavy use. Typical industries using the AI are food, chemical, pharmaceutical, mining, steel and power generation.

Operation

The Castell single key access interlocks are used in various applications to control part body access to hazardous areas.

AI single key access interlock (bolt trapped - key free)

① Key is free, bolt is trapped



② Insert and turn key, then turn and release bolt



③ Key is trapped, bolt is unlocked



1. While the key is free, the bolt of the AI is trapped in the mechanism. The door is locked.
2. By inserting and turning the key in the Access Interlock, you can release the bolt. This will trap the key in the lock.
3. The key stays trapped while the bolt is released and the door is open.

Usage

The AI Access Interlock should be used to allow safe access to potential hazardous and dangerous areas. The AI Access Interlock should be used on part body access doors where the use of personal safety keys is not essential (to prevent accidental lock in).



The AI Access Interlock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the AI access interlock should normally be mounted on the static frame of the guard and the bolt to the sliding or hinged door using suitable fasteners. Fixed bolt bracket is highly tolerant to misaligned guards and should be fitted with suitable fasteners. Please refer to the drawing on page 4 for mounting details for the housing and bolt. The AI interlocks are available in Hand 1 and Hand 2 version suitable for left or right hinged doors, respectively. Anti vibration pads should be used on machines that generate a high level of vibration.



IMPORTANT:

The AI Access Interlock should be mounted on the guard using anti-tamper fasteners to prevent unauthorised removal.



The AI Access Interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 24KN for both stainless steel and brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,8 kg
	Stainless steel: 1,0 kg
Material	Aluminium alloy/brass or stainless steel
MTTF Certification	Available on request

Application

A typical application of the AI Single Key Access Interlock is machine guarding with part body access.

The AI is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed.

The system involves a KS key switch that breaks the machine safety circuit, when the key is removed. The key can then be taken to the AI Access Interlock to enable access to the machine. The machine cannot be restarted until the door is closed, the bolt is replaced and the key is removed and taken to the KS key switch.

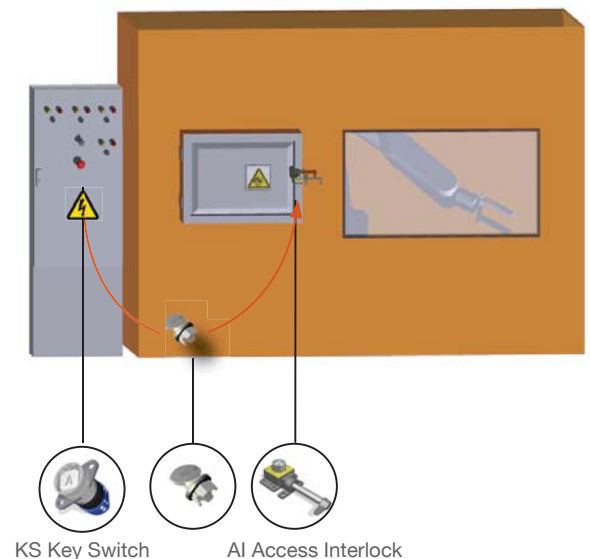

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

AI, Hand 2

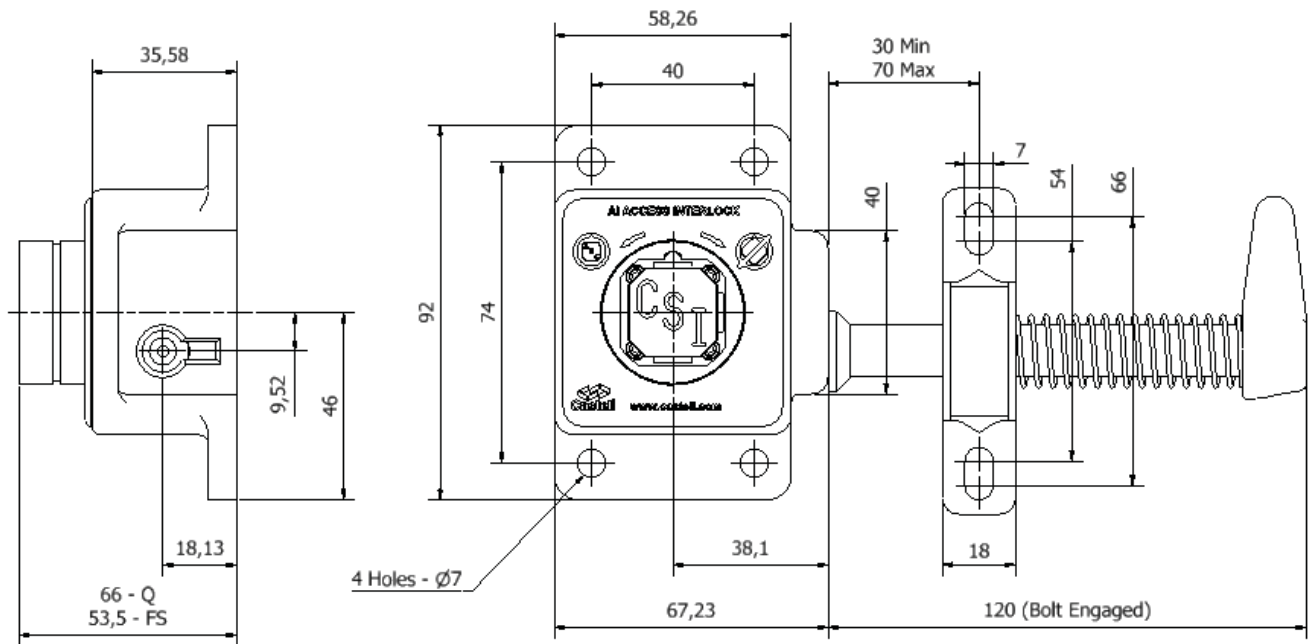

Order Information


	Product Type	1	2	3
Part Number	AI			
Example	AI	FS	AL	1
	4			
	ABC			

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	AL = Aluminium alloy/brass S = Stainless steel
3	Handing	1 = left hinged door (bolt enters left) ⁽²⁾ 2 = right hinged door (bolt enters right) ⁽²⁾
4	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters **Q - Lock type** Up to 6 characters




(2) **Handing** **1** **2**



Accessories

Special construction available upon enquiry

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



AIE-FSS-E-2


The AIE dual key access interlock is suitable for use on hinged and sliding doors. The interlock has an open cavity design and is manufactured in an aluminum alloy or durable stainless steel making it ideal for harsh or corrosive environments where the lock is subject to heavy use. The AIE is available in two options: exchange key and double key.

Operation

Castell dual key access interlocks are used in various applications to control full body access to hazardous areas.

AIE dual key access interlock, exchange key condition (bolt trapped - personnel key trapped/isolation key free)

- ① Side bolt is trapped and the personnel key is trapped, isolation key is free.
- ② Insert and turn isolation key, then turn and release the personnel key. The side bolt can now be released.
- ③ isolation key is trapped, the side bolt and personnel key are free.

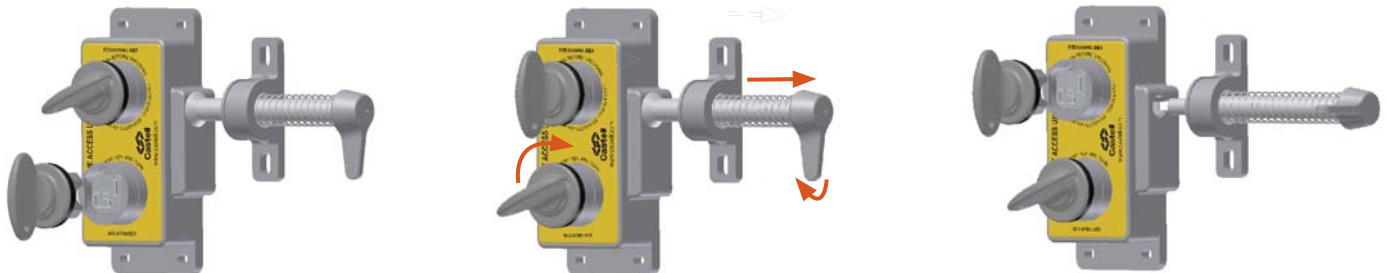

1. While the isolation key is free and the personnel key trapped in the AIE, the bolt of the AIE is trapped in the mechanism. The door is closed.
2. By inserting and turning the isolation key in the access interlock, you can release the personnel key. This traps the isolation key, which enables the release of the side bolt. The personnel key should be taken by the Personnel to the hazardous area.
3. The isolation key stays trapped while the bolt is released and the door is open.


Operation

AIE dual key access interlock, double key condition (bolt trapped - both keys are free)

① Bolt is trapped,
while both keys are free



② Insert and turn the keys,
then turn and release bolt

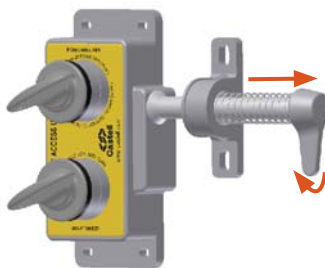

③ keys are trapped,
bolt is unlocked



1. While both keys are free, the bolt of the AIE is trapped in the mechanism. The door is locked.
2. By inserting and turning the keys in the access interlock, you can release the bolt and open the door.
3. Both keys stay trapped while the bolt is released and the door is opened.

Usage

The AIE access interlock should be used to allow safe access to potential hazardous and dangerous areas. The AIE access interlock should be used on full body access doors where the use of personal safety keys is essential (to prevent accidental lock in).



The AIE access interlock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the AIE access interlock should normally be mounted on the static frame of the guard and the bolt to the sliding or hinged door using suitable fasteners. Fixed bolt bracket is highly tolerant to misaligned guards and should be fitted with suitable fasteners. Please refer to the drawing on page 4 for mounting details for the housing and bolt. The AIE interlocks are available in Hand 1 and Hand 2 version suitable for left or right hinged doors, respectively. Anti vibration pads should be used on machines that generate a high level of vibration.



IMPORTANT:

The AIE access interlock should be mounted on the guard using anti-tamper fasteners to prevent unauthorised removal.



The AIE access interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 24KN for both stainless steel and brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,8 kg
	Stainless steel: 1,0 kg
Material	Aluminium alloy/brass or stainless steel
MTTF Certification	Available on request


Application

A typical application of the AIE dual key Access Interlock is machine guarding with full body access.

The AIE is used as part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed.

The system involves a KS key switch for the electrical supply. The removal of the isolation key from the key switch isolates the electrical supply to the machine. This key is taken to the AIE and inserted into the lock. This allows the release of the personnel key and then the sidebolt, which traps the isolation key. The personnel key is then taken into the area by the operative to safeguard themselves against accidental lock in and start up.

The machine cannot be restarted until the personnel key is returned, the bolt is replaced in the AIE and the isolation key is removed and taken to the KS key switch.

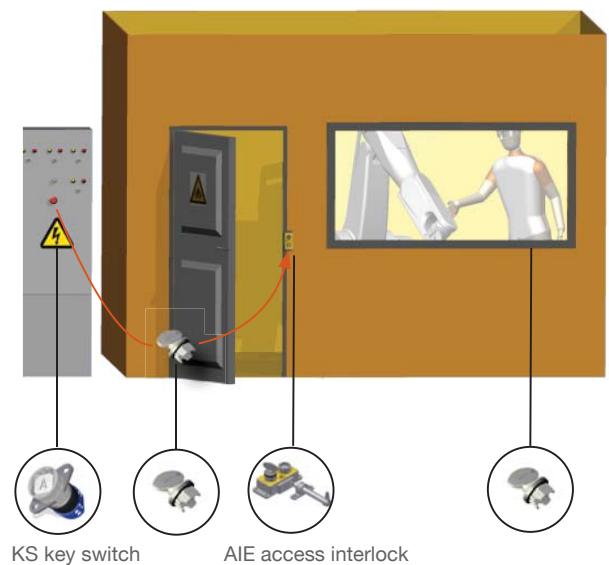

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

AIE, Hand 1

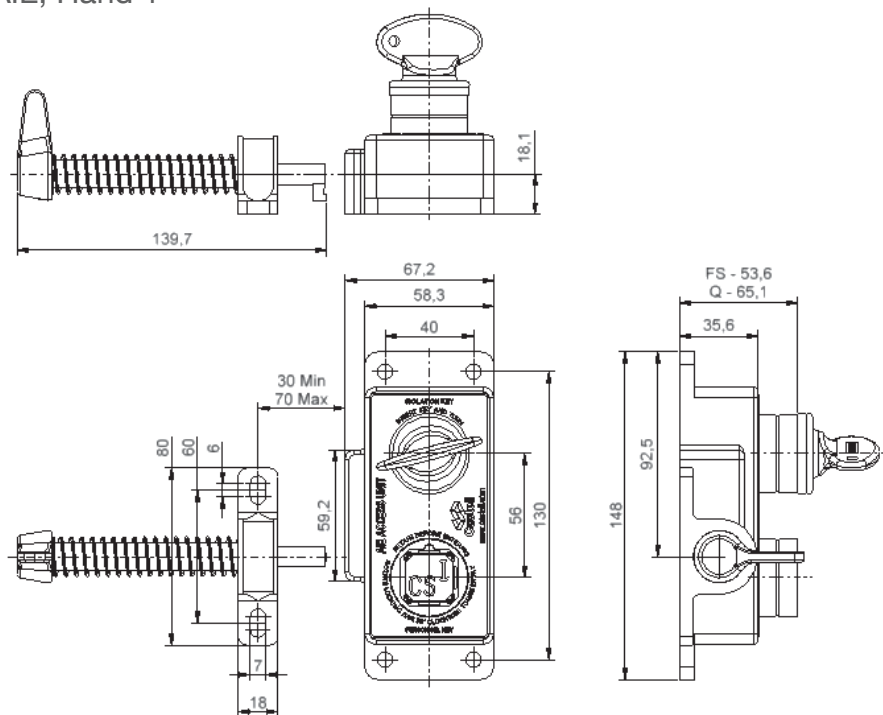

AIE, Hand 2

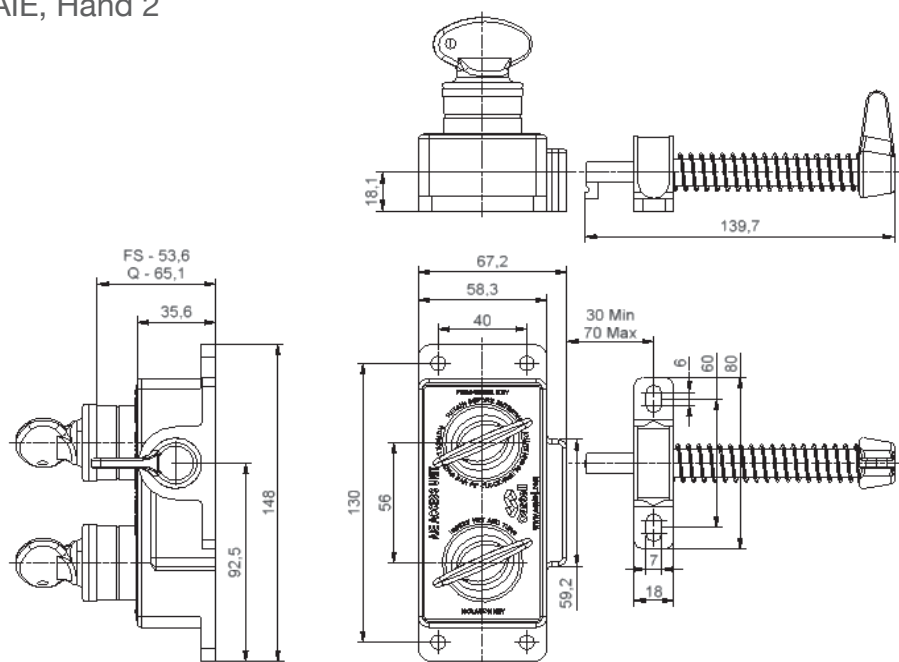

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Order Information

	Product Type	1	2	3	4
Part Number	AIE				
Example	AIE	FS	AL	E	1


5	A1	Isolation Key Symbol (exchange key condition)	6	B1	Personnel Key Symbol (exchange key condition)
	OR			OR	
		Primary Key Symbol (double key condition)			Secondary Key Symbol (double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	AL = Aluminium alloy/brass S = Stainless steel
3	Key Condition	E = Exchange key Condition D = Double key Condition
4	Handing	1 = left hinged door ⁽²⁾ 2 = right hinged door ⁽²⁾
5	Lock portion symbol: Isolation key symbol (for exchange key condition) Primary key symbol (for double key condition, lock next to the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
6	Lock portion symbol: Personnel key symbol (for exchange key condition) Secondary key symbol (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



(2) Handing

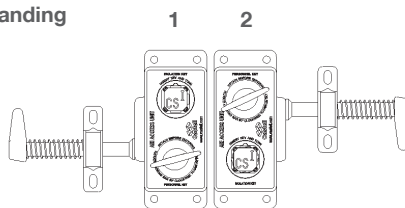

Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



AIES-FSS-E-2

The AIES is a dual key access interlock complete with electrical contacts for use on hinged or sliding doors. The AIES contacts can be used to switch off the machine via its control circuitry or to initialise a signal to visual beacons/sounders. The switch is sealed to IP65 with 1N/O 2N/C contacts, it is rated to 6 amps making it ideal for use in cross monitored safety systems. The interlock is manufactured in a durable stainless steel making it ideal for use in harsh or corrosive environments and where the lock is subject to heavy use.

Operation

The AIES access interlock with safety switch is used for machine isolation in order to protect the hazardous area from full body access while power is on.

AIES dual key access interlock with safety switch, exchange key condition (bolt trapped - personnel key trapped/ isolation key free)

- ① Power is on, bolt is trapped. Isolation key is free, personnel key is trapped



- ② Insert and turn isolation key to change the switch contacts condition and release the bolt. Then release the personnel key.



- ③ Power is off, isolation key is trapped. Bolt is free and personnel key is free.



1. While the power in the hazardous area is on, the sidebolt of the AIES is trapped in the mechanism. The door is locked.
2. By inserting and turning the isolation key, the contact condition is changed switching the power off. The bolt can now be released. This enables the release of the personnel key. The released personnel key should be taken by the personnel to the hazardous area, ensuring the power cannot be turned on as long as the door is opened.
3. The switch condition cannot be reversed until the personnel key is returned, the side bolt is trapped and the isolation key is released.

Operation

AIES dual key access interlock with safety switch, double key condition (bolt trapped - keys free)

- ① Power is on, bolt is trapped. Both keys are free.



- ② Insert and turn both keys to change the switch contacts condition and release the bolt.



- ③ Power is off, both keys are trapped and bolt is free.



1. While the power in the hazardous area is on, the sidebolt of the AIES is trapped in the mechanism. The door is locked. Both keys are free.
2. By inserting and turning both keys, the contact condition changes switching the power off. The bolt can now be released. This traps the keys.
3. The switch condition cannot be reversed until the sidebolt is trapped in the locking mechanism and the keys are turned and released.

AIES dual key access interlock with safety switch, double key condition (bolt trapped - keys trapped)

- ① Power is on, bolt is trapped. Both keys are trapped.



- ② Turn and release both keys to change the switch contact condition and release the bolt.



- ③ Power is off, bolt is free. Both keys are free.



1. While the power in the hazardous area is on, the sidebolt of the AIES is trapped in the mechanism. The door is locked. Both keys are trapped.
2. By turning and releasing both keys, the contact condition changes switching the power off. The bolt can now be released. Both keys can be released and should be taken by the personnel to the hazardous area.
3. The switch condition cannot be reversed until both keys are returned, the side bolt is trapped and both keys are trapped in the AIES access interlock locking the door.

Usage

The AIES access interlock with safety switch is designed to be part of a safety system and is used to isolate the power which then allows to gain access to a hazardous area.



The AIES access interlock is not designed for security purposes.

Installation

The housing of the AIES access interlock with safety switch should normally be mounted on the static frame of the guard and the bolt to the sliding or hinged door using suitable fasteners. Fixed bolt bracket is highly tolerant to misaligned guards and should be fitted with suitable fasteners. Please refer to the drawing on page 4 for hole details and maximum and minimum mounting distance for the housing and bolt. The AIES interlocks are available in Hand 1 and Hand 2 version suitable for left or right hinged doors, respectively. Anti vibration pads should be used on machines that generate a high level of vibration

IMPORTANT:

The AIES access interlock with safety switch should be mounted on the guard using anti-tamper fasteners to prevent unauthorised removal.



The AIES access interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.



Force required to shear lock bolt is 24KN.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.




In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

AES, Hand 1, double key condition

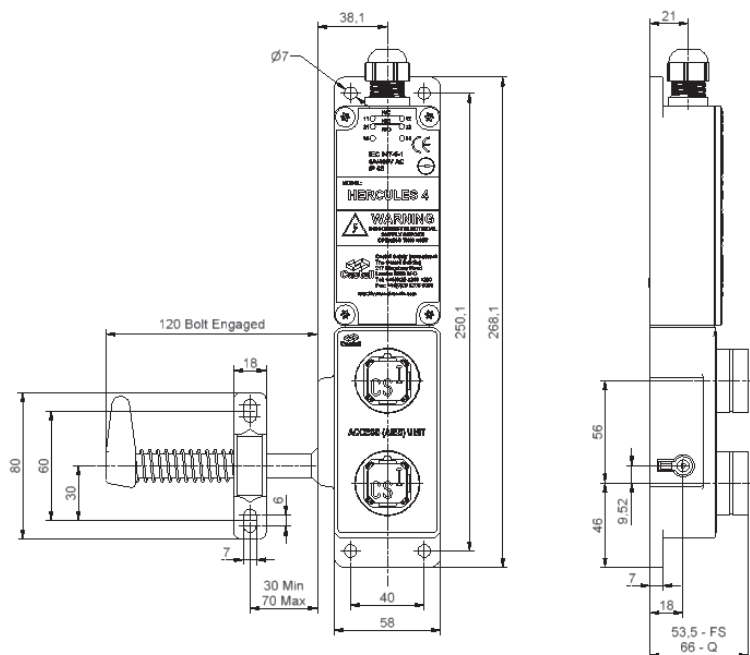

AES, Hand 2, exchange key condition

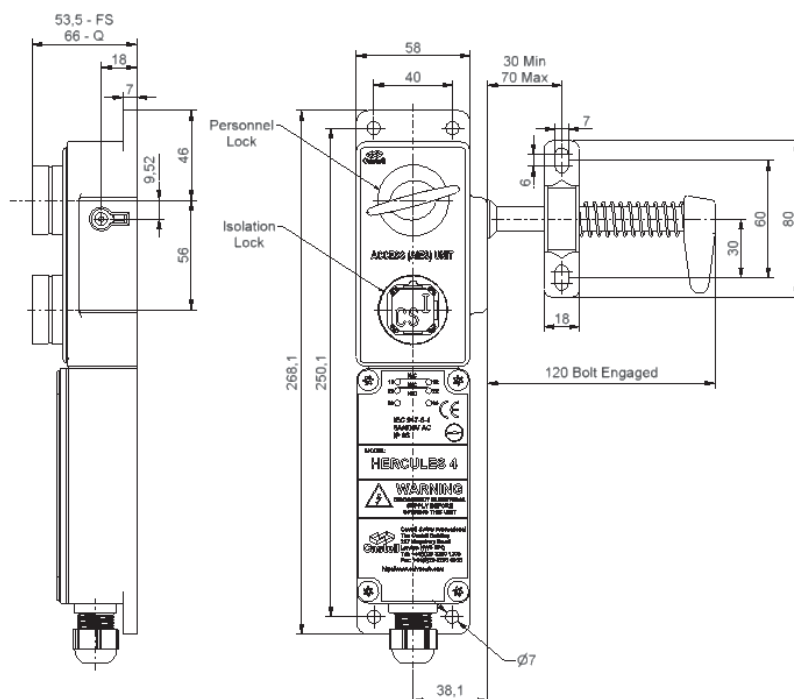


While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Wiring Diagram

Note: For safe mounting, use security screws

2NC/1NO



Contacts as shown in the following positions:

	Isolation Key	Personnel Key	Bolt
Version 1 - Exchange Key	FREE	TRAPPED	TRAPPED
Version 2 - Double Key, KF (Keys free, bolt trapped)	FREE	FREE	TRAPPED
Version 3 - Double Key, KT (Keys trapped, bolt trapped)	TRAPPED	TRAPPED	TRAPPED

Technical Data

Temperature rating	Ambient temperature of stages: open at 100% lu/lth - 55°C during 24 hours with peaks up to 60°C, enclosed at 100% lthe - 35°C during 24 hours with peaks up to 40°C
	Storage temperature: -40°C to 85°C (in case temperature below -5°C no shock load permissible)
Type of mounting	Surface mount using suitable fasteners (see drawing on page 4 for mounting details)
Weight	2,5 kg
Material	Stainless steel
Power isolation	10A
Motor isolation (AC Values)	400V AC
Switch approvals	CE, UL, CSA, IP65
MTTF Certification	Available on request

Application

A typical application of the AIES Access interlock with Safety switch is machine guarding.

The removal of the key from the AIES, isolates the electrical supply to the machine and allows the removal of the sidebolt and the personell key. This will trap the isolation key. Therefore the guard can only be opened when the electrical supply has been switched into a safe condition. The personnel key is then taken into the area by the operative to safeguard against accidental lock in or start up or to initialize another part of the process, i.e. switching the machine into a teach mode.

The machine cannot be restarted until the door is closed, the bolt is trapped and the personnel key replaced in the AIES dual key access interlock.



AIES Access interlock with safety switch

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director



Order Information

	Product Type	1	2	3	4*	5
Part Number	AIES					
Example	AIES	FS	S	E	KT	1


6	A1	Isolation Key Symbol (exchange key condition)
	OR	Primary Key Symbol (double key condition)
7	B1	Personnel Key Symbol (exchange key condition)
	OR	Secondary Key Symbol (double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	S = Stainless steel (standard)
3	Key Condition 1	E = exchange key Condition D = double key Condition
4*	Key condition 2 - in bolt trapped condition (applies for double key condition only, see item 3)	KT = keys are trapped while bolt is trapped KF = keys are free while bolt is trapped
5	Handing	1 = left hinged door ⁽²⁾ 2 = right hinged door ⁽²⁾
6	Lock portion symbol: Isolation key symbol (for exchange key condition) Primary key symbol (for double key condition, lock next to the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
7	Lock portion symbol: Personnel key symbol (for exchange key condition) Secondary key symbol (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Up to 3 characters Q - Lock type Up to 6 characters



(2) Handing



Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1649 794
f: +49 (0) 221 1649 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



AIS-FSS-KF-2

The AIS or HERCULES is a single key access interlock complete with electrical contacts for use on hinged and sliding doors. The Hercules contacts can be used to switch off the machine via its control circuitry or to initialize a signal to visual beacons/sounders. The switch is sealed to IP65 with, 1N/O 2N/C contacts, rated to 6 amps making it ideal for use in cross monitored safety systems. The interlock is manufactured in a durable stainless steel making it ideal for use in harsh or corrosive environments and where the lock is subject to heavy use.

Operation

The Hercules Access Interlock with Safety Switch is used for machine isolation in order to protect the hazardous area from access while power is on.

AIS (Hercules) access interlock with safety switch: bolt trapped - key trapped condition

- ① Power is on, sidebolt is trapped and key is trapped
- ② Turn and release key, to change the switch contact condition and turn and release the bolt
- ③ Power is off, bolt is free and key is free



1. While the power in the hazardous area is on, the sidebolt of the AIS is trapped in the mechanism. The door is locked and the key is trapped.
2. By turning and releasing the key, the contact condition changes switching the power off. The bolt can now be released. The key should be kept by the personnel as long as the door is opened, ensuring the power cannot be turned on.
3. With the sidebolt and key released, the switch condition cannot be reversed.

AIS (Hercules) access interlock with safety switch: bolt trapped - key free condition

- ① Power is on, sidebolt is trapped and key is free
- ② Insert and turn the key, to change the switch contact condition and release the bolt
- ③ Power is off, bolt is free and key is trapped



1. While the power in the hazardous area is on, the sidebolt of the AIS is trapped in the mechanism. The door is locked and the key is free.
2. By inserting and turning the key, the contact condition changes switching the power off. The bolt can now be released. This will trap the key.
3. With the sidebolt released and key trapped, the switch condition cannot be reversed.

Usage

The AIS access interlock with safety switch is designed to be part of a safety system and is used to isolate the power which is then allows to gain access to a hazardous area.



The AIS access interlock is not designed for security purposes.

Installation

The housing of the AIS access interlock with safety switch should normally be mounted on the static frame of the guard and the bolt to the sliding or hinged door using suitable fasteners. Fixed bolt bracket is highly tolerant to misaligned guards and should be fitted with suitable fasteners. Please refer to the drawing on page 4 for hole and mounting details. The AIS interlocks are available in Hand 1 and Hand 2 version suitable for left or right hinged doors, respectively. Anti vibration pads should be used on machines that generate a high level of vibration

IMPORTANT:

The AIS access interlock should be mounted on the guard using anti-tamper fasteners to prevent unauthorised removal.



The AIS access interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.



Force required to shear lock bolt is 24KN.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Ambient temperature of stages: open at 100% lu/lth - 55°C during 24 hours with peaks up to 60°C, enclosed at 100% lthe - 35°C during 24 hours with peaks up to 40°C
	Storage temperature: -40°C to 85°C (in case temperature below -5°C no shock load permissible)
Type of mounting	Surface mount using suitable fasteners (see drawing on page 4 for mounting details)
Weight	2,5 kg
Material	Stainless steel
Power isolation	10A
Motor Isolation (AC Values)	400V AC
Switch approvals	CE, UL, CSA, IP65
MTTF Certification	Available on request


Application

The Castell Hercules (AIS) access interlock with safety switch is used as a part of a safety system, typically in machine guarding applications.

The removal of the key from the AIS, isolates the electrical supply to the machine and allows the removal of the sidebolt. Therefore the guard can only be opened when the electrical supply has been switched into a safe condition.

This key is then taken into the area by the operative to safeguard against accidental lock in or start up or to initialize another part of the process, i.e. switching the machine into a teach mode.

The machine cannot be restarted until the door is closed, the bolt is trapped in the AIS access interlock and the key is replaced.

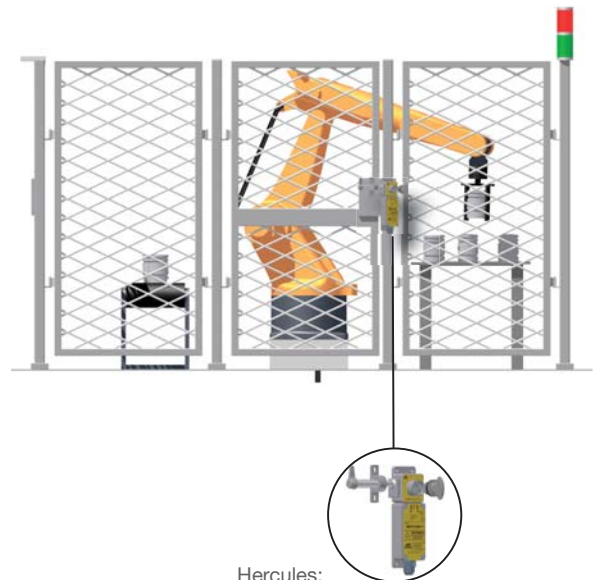

Hercules:
AIS access interlock with safety switch

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

AIS, Hand 1, key free - bolt trapped

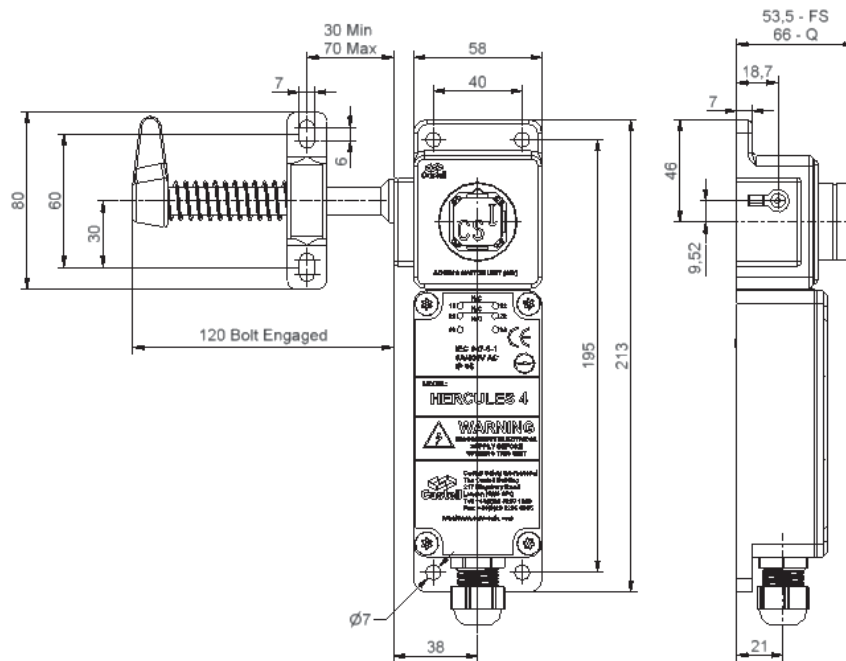


AIS, Hand 2, key free - bolt trapped

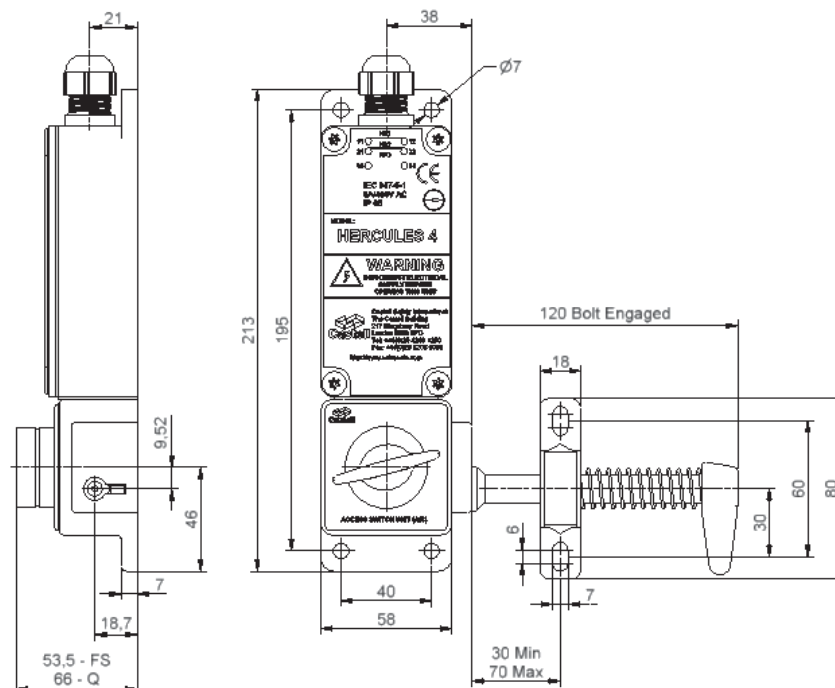

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Wiring Diagram

2 NC/1NO



Contacts as shown in the following positions:

	Key	Bolt
Version 1 - KF	FREE	TRAPPED
Version 2 - KT	TRAPPED	TRAPPED

Order Information


	Product Type	1	2	3	4
Part Number	AIS				
Example	AIS	FS	S	KT	1
	5				
	ABC				

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	S = Stainless steel (standard)
3	Condition (by bolt trapped)	KT = key trapped while bolt trapped KF = key free while bolt trapped
4	Handing	1 = left hinged door (bolt enters left) ⁽²⁾ 2 = right hinged door (bolt enters right) ⁽²⁾
5	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters
Q - Lock type Up to 6 characters




(2) **Handing**



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

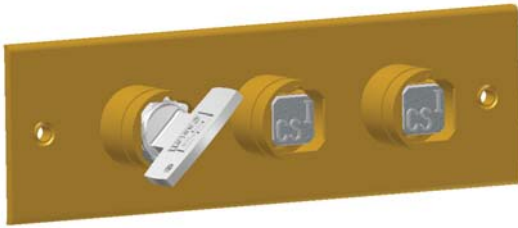

B-FSB-H-1/3


The B key exchange box is designed to enable the sequential release of keys (maximum 5) by the insertion of one or more initial key(s). The need for this type of product usually arises when there are multiple access points to the hazardous area. The unit will generally be the link between the isolation locks and the access products. The product is supplied in an enclosure suitable for surface or panel mounting, and is available in different configurations of locks.

Operation


Castell Key Exchange Boxes are used in various applications to control multi-door access to hazardous areas.

B key exchange box, horizontal mount (1 key free - 2 keys trapped)


① 1 key free, 3 keys trapped

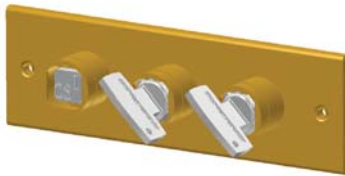

② Insert and turn free key, then turn and release trapped keys in a sequence

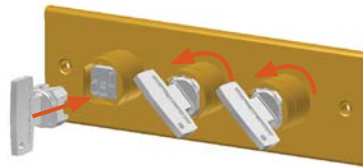

③ 1 key is trapped, 3 keys released

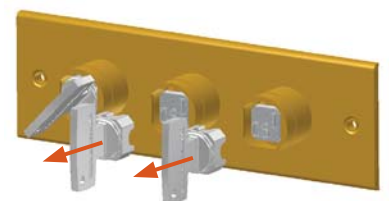

1. While 1 key is free which is usually used in power isolation, 2 keys are trapped.
2. By inserting and turning the free key in the B key exchange box, you can sequentially release trapped keys. The released keys can be used in the access door locks to gain access to the hazardous area.
3. The inserted key stays trapped until all released keys are returned to their original position.

The B key exchange box is available in different combinations of free and trapped keys and also in a vertical mounting version.

Usage

B key exchange boxes should be used to allow a safe access to potential hazardous and dangerous areas with one or more access points.



The B key exchange box is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The B key exchange box should normally be mounted on the static frame using suitable fasteners. Please refer to the drawing on page 4 for maximum and minimum mounting distance. The B key exchange boxes are available in horizontal and vertical mounting versions. Anti vibration pads should be used on machines that generate a high level of vibration



IMPORTANT:

The B key exchange box should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The B key exchange box must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	Panel mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 1 kg for 2 lock options, add 0,5 kg per additional portion
	Stainless steel: 1 kg for 2 lock options, add 0,5 kg per additional portion
Material	Brass or stainless steel
MTTF Certification	Available on request


Application

A typical application of the B key exchange box is machine guarding with one or more access points to the hazardous area.

The B key exchange box is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed. The system involves a KS key switch for the electrical supply and typically more than one AIE access interlocks for full body access.

The removal of the isolation key from the key switch isolates the electrical supply to the machine. This key is taken to the B key exchange box to release the trapped keys. The released keys are used to gain access through the AIE door interlocks.

The machine cannot be restarted until all keys are returned to the key exchange box and the power isolation key is removed and replaced in the KS key switch.

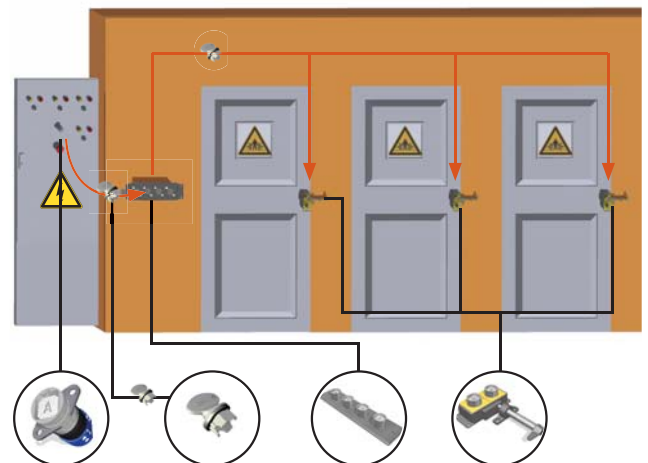

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

B key exchange box, horizontal mount

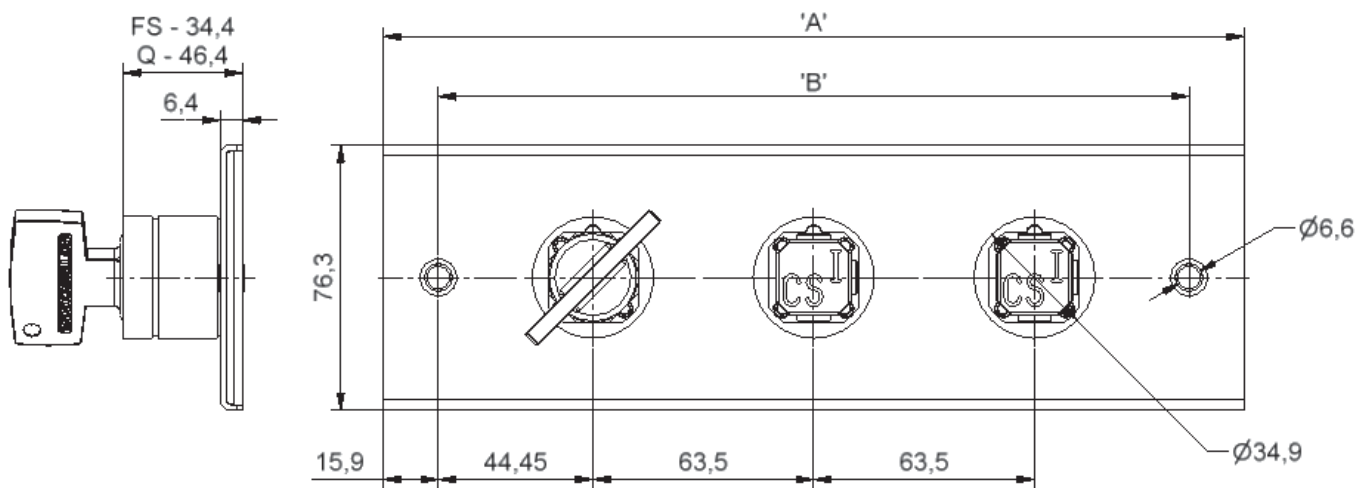

Order Information

	Product Type	1	2	3	4	5
Part Number	B					
Example	B	FS	B	H	1	3
	6					
	A	Free Key Symbol(s)				
	7					
	B1	End Key Symbol(s)				


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass
3	Mounting	H = Horizontal V = Vertical
4	Number of Free Keys	please specify
5	Number of Trapepd Keys	please specify
6	Lock portion symbol(s) - Free Key(s), all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
7	Lock portion symbol(s) - Trapped Key(s), all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

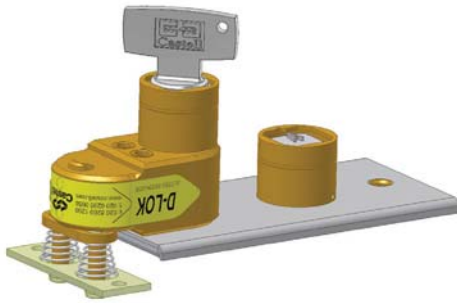

BD-FSB-F-1S-RE-MS-4




The BD Lock is a two part access interlock comprising of a main body and catch complete with secondary lock portions. The catch is available in two options, one suited to well aligned doors, the other suited to poor, mis-aligned doors. The lock is ideally suited for use on light duty panel doors in dry, non-corrosive environments where the lock is subject to light to medium use. Typical industries using the BD Lock are Control Panel Builders, HV and LV Switchgear and the food industry. The D lock is available as F (figure) or Q style of lock portions. The lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments.

Operation

The BD lock range is used for interlocking electrical control cubicles and distribution panels.

BD multi key panel door interlock, exchange key condition

- ① Key A is free, while key B is trapped and the catch is trapped.
- ② Insert and turn key A, then turn key B to release catch and then release key B.
- ③ Key B is free, key A is trapped while catch is released.

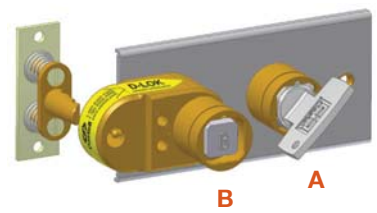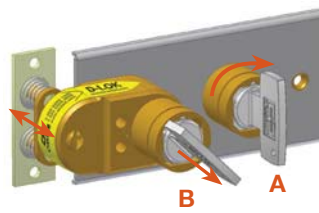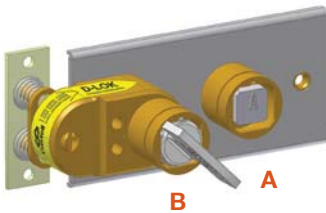

1. While the catch is trapped in the mechanism, key B is trapped and key A is free. The door is locked closed through the trapped catch.
2. Inserting and turning key A in the bolt interlock enables the release of key B and the release of the catch. This will trap key A into the lock.
3. Key B is used as the personnel key and taken to the machine area. Key A stays trapped as long the catch is released and key B is free.

The BD panel door interlock is available with as rear or front entry mounted catch.


The catch is available as standard catch for well aligned doors or as MS catch for misaligned doors.

Operation


The BD lock range is used for interlocking electrical control cubicles and distribution panels.

BD multi key panel door interlock, double key condition


- ① Both keys, A and B are free, catch is trapped.

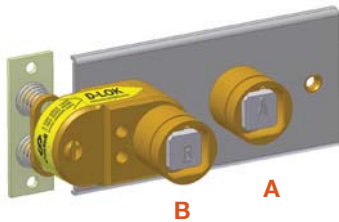

- ② Insert and turn both keys to release catch.

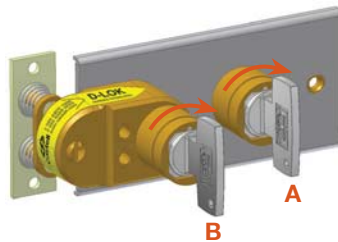

- ③ Keys are trapped, catch is released.

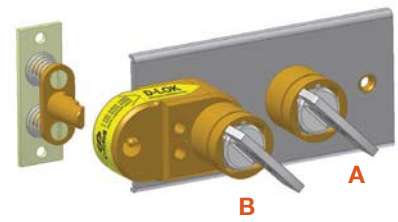

1. While the catch is trapped, both keys A and B are free. The door is locked closed through the trapped catch.
2. Inserting and turning both keys in the BD bolt interlock enables you to release the catch unlocking the door. This will trap both keys into the lock.
3. The keys stay trapped as long as the catch is released.

The BD panel door interlock is available with as rear or front entry mounted catch.

The catch is available as standard catch for well aligned doors or as MS catch for misaligned doors.

Usage

The BD panel door interlock should be used for interlocking electrical control cubicles and distribution panels.



The BD lock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the BD panel door interlock should normally be mounted to a panel using suitable fasteners (please refer to drawing on page 4 for more details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The D Panel Door Interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & F Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for F Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	1,2 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request


Application

Castell BD multi key panel door interlocks are used as a part of a safety system, typically in machine guarding applications as in the below example.

The power supply to the system is switched on and the access door to the hazardous area is locked closed.

The removal of the isolation key in the KSS20, changes the switch contacts provided for electrical supply to the electrical supply to the LV panel from closed to opened. This key is then used to unlock the door by inserting key in the BD panel door interlock and releasing the trapped personnel key and then the catch. This will trap the isolation key in the BD interlock. The release key is taken by the personnel to the machine area.

The power cannot be switched on until the personnel key is returned, the door is closed, the catch is trapped in the BD panel door interlock and the isolation key returned to the KSS20.

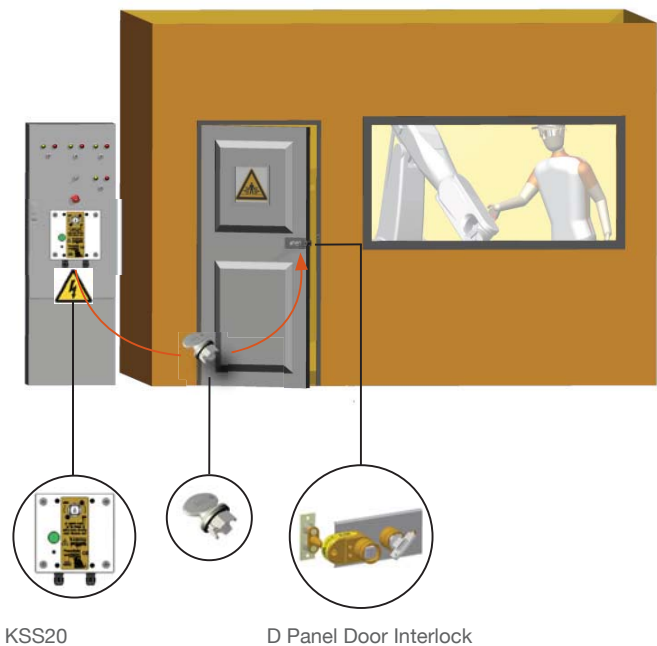

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

BD, front of board mount, exchange key condition, form 1

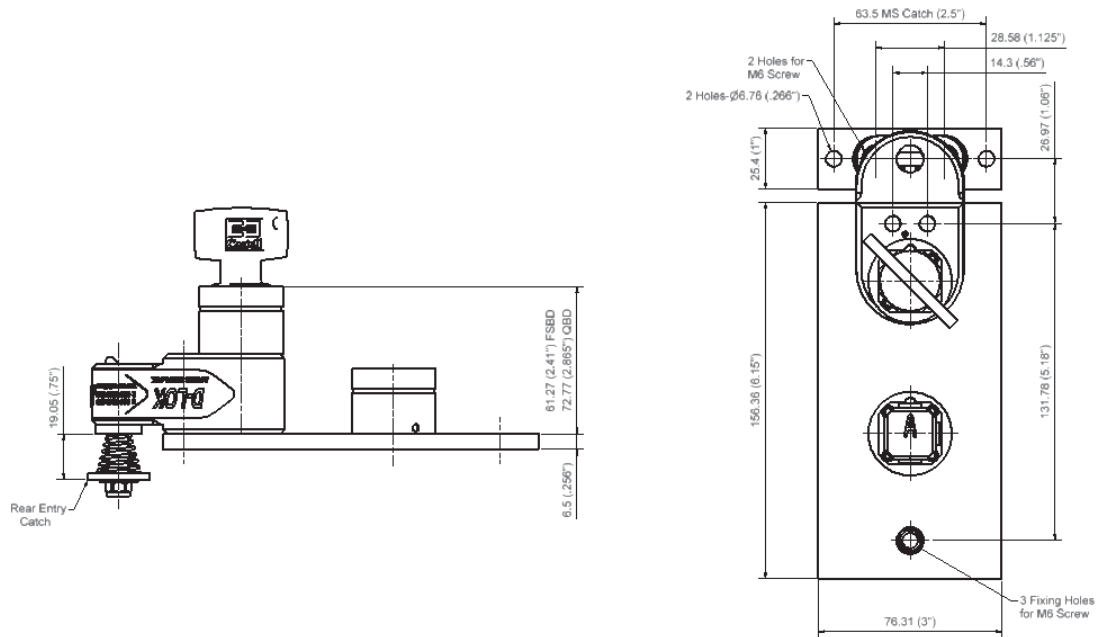

BD, back of board mount, exchange key condition, form 1

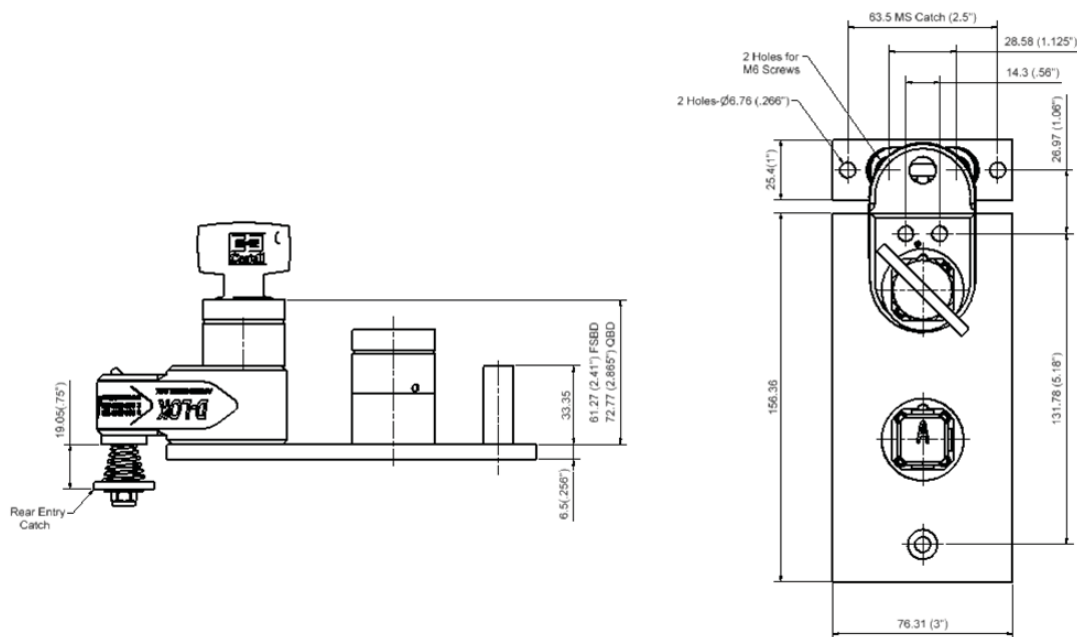

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	BD								
Example	BD	FS	B	F	1S	E	RE	STD	4


9	A	Isolation Key Symbol (exchange key condition)	10	B	Personnel Key Symbol (exchange key condition)
	OR	Primary Key Symbol (double key condition)		OR	Secondary Key Symbol (double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
3	Mounting	P = Panel mount (back of board) / F = Front of board mount
4	Secondary lock portion(s)	1S / 2S / 3S / 4S / 5S or 6S = 1 / 2 / 3 / 4 / 5 or 6 secondary lock portions respectively
5	Key condition	E = Exchange key condition / D = Double key condition (simultaneous removal of all keys)
6	Catch entry	RE = Rear entry / FR = Front entry
7	Catch type	STD = standard catch, use for well aligned doors / MS = catch with spring, use for misaligned doors
8	Form	1 / 2 / 3 / 4 ⁽²⁾
9	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition, lock next to the catch)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
10	Lock portion symbol: Personnel key (for exchange key condition) Secondary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **F - Lock style** **Q - Lock style**
Up to 3 characters Up to 6 characters



(2) **Form** 1 2 3 4

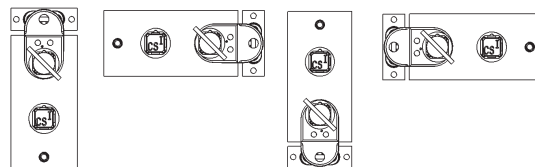

Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1649 794
f: +49 (0) 221 1649 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



BEMF-FSB-F-3-110A

The BEMF Motor sensing Interlock is designed to control access to rotating machinery. The BEMF unit relies on the measurement of the electromotive force generated by the windings of an electric motor. Only when the motor has stopped will the BEMF drop to zero and allow the release of a Castell key. The unit is used for connection to AC and DC motors including DC braking systems. The BEMF has been designed to provide the highest level of safety when installed as part of an access control system for dangerous machinery.

Operation

The Castell BEMF switch disconnecter is typically used for machine isolation in applications in order to protect the hazardous area from access while power is on.

BEMF Switch Disconnecter

- ① Power is on, key is trapped. Red LED is illuminated.
- ② Turn the key to OFF position. At zero movement detection a signal is sent to the BEMF to energise the solenoid. A green LED is illuminated. Release the key by pushing the green button.
- ③ Key is released, power is off and the motor stands still.



1. While the power is on and a motor is running, the key is trapped in the BEMF motor sensing interlock. A red LED is illuminated.
2. Turn the key to OFF position to switch the power off. A movement detector gives a signal to the BEMF unit once zero movement has been detected. This will illuminate a green LED. The key can now be released by pushing the green button. This key can be taken to unlock the access lock on the motor unit.
3. The motor stands still and power is off until the key is replaced in the BEMF motor sensing unit.

Usage

The BEMF motor sensing unit is designed to be part of a safety system and is used to switch off the power and detect zero motor movements before releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI or Salus.



The BEMF motor sensing unit is not designed for security purposes.

Installation

The BEMF motor sensing unit should be mounted to a surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The BEMF range of motor sensing units must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.




In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature	Minimum: -5°C [23°F]
	Maximum: 55°C [131°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Attachment	Millimeters: 240mm(H) x 140mm(W)
	Inches: 9.45"(H) x 5.51"(W)
Weight	5.0 kg
Material	Brass or Stainless steel lock portions, powder coated mild steel enclosure
Standards	EN60439-1 ,EN954
Cable Size	M20 Gland x 2
IP Rating	IP65, NEMA 4 enclosure
Standards	standstill detection components to UL (US, Canada)
Contact Rating	Continuous, unattended, remote
Use	Motor switch, circuit-breaker or control switch
Voltage	24 VDC and 240 VAC, 120 VAC
Max Motor Voltage	600V
Max Power Consumption	20VA / 18W

Application

The BEMF is designed to operate as part of an integrated safety system. The BEMF controls access to hazardous areas with rotary machinery. When the electric motor is running, the key of the BEMF interlock cannot be removed, hence preventing access to the hazardous area. To gain access to the area, the electrical motor must be switched off by turning the key to OFF position. This changes the switches of the electrical supply to the machine to a safe condition. A movement sensing detector sends a signal to the BEMF unit once a zero movement of the motor has been stated. A green LED illuminates. By pushing the green button, the key can now be removed and taken by the personell to the AI access interlock. The guard can only be opened when the electrical supply has been switched into a safe condition. The machine cannot be restarted until the door is closed and the key is removed and taken to the BEMF motor sensing unit.

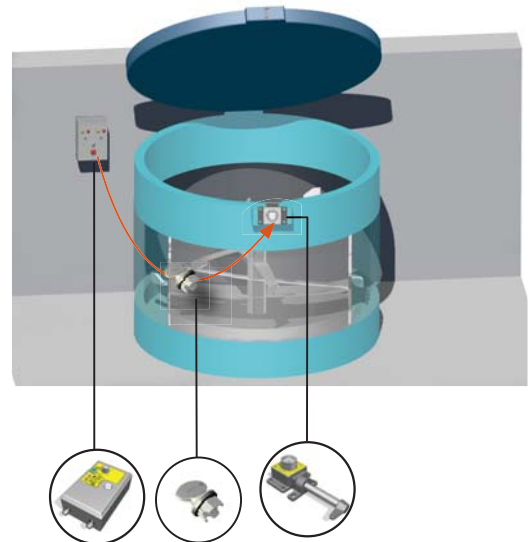

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm


Note: For safe mounting, use security screws

BEMF

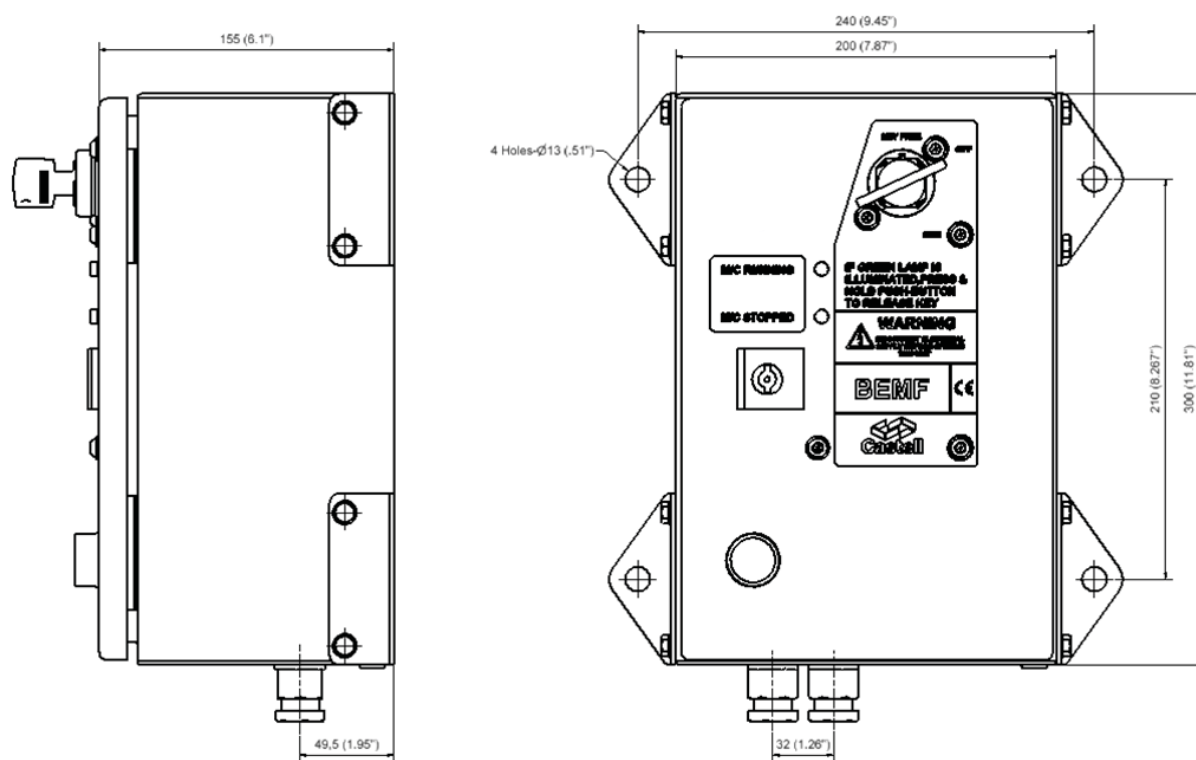

Wiring Diagram

3 Phase Motor With Star Delta Starting

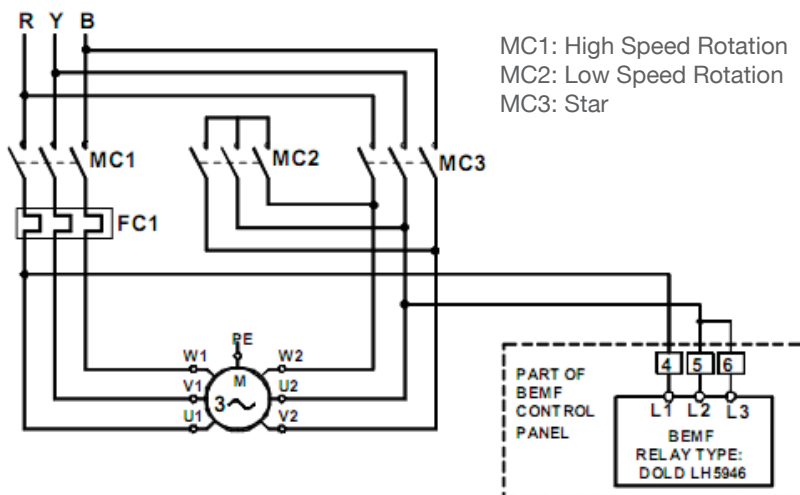


Motors With Switched Winding

Motors with star delta starting or motors with switched windings must be connected the same as a single phase motor as shown opposite in order to avoid interruption in the input circuit. Otherwise the unit will see this as a broken wire.

For motors with reversing circuit and multi speed motors please follow the same procedure. Whenever 3 phase connections are switched over, if interruption is greater than 2 sec, the BEMF unit will detect broken wire condition. In order not to store this failure the unit should be set as auto reset (i.e. link terminal X2 & X3 of BEMF relay)

3 Phase Motor With Variable Speed Drive

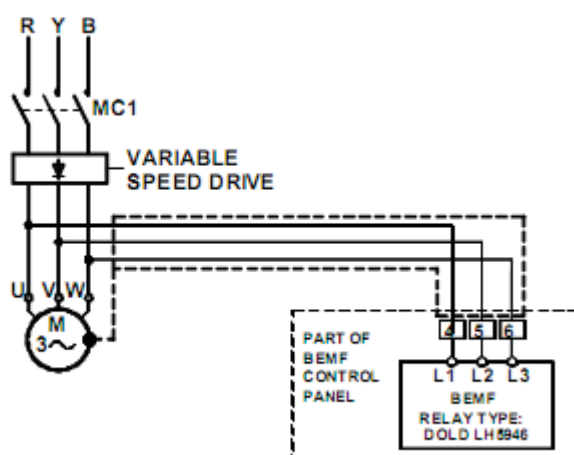


Operation With Electronic Motor Controller


When there are inverters in the installation, it is recommended to use screened cables to the motors. The screen can be connected to the motor housing.

Wiring Diagram

3 Phase Motor Direct on Line (DOL)

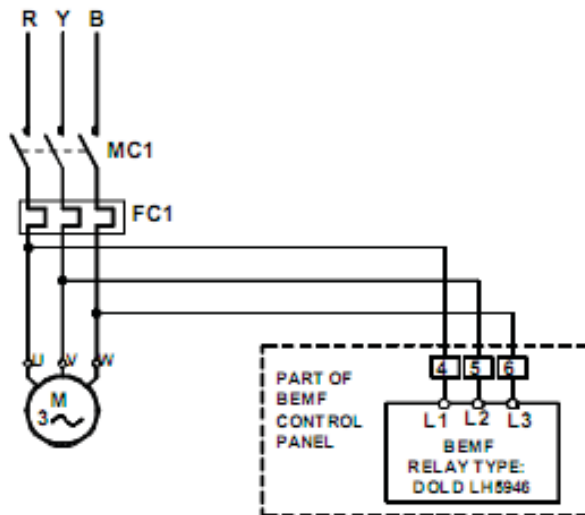

AC Single Phase or DC Motor

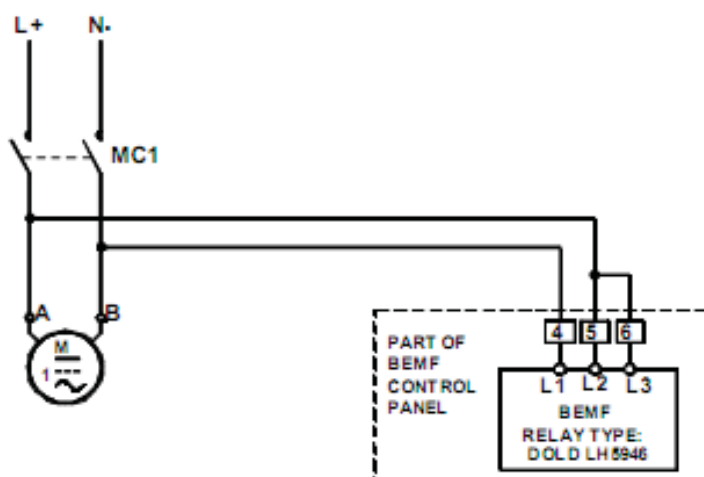

Operation With DC Motors

The connection is made similar to single phase motor. DC motor generate a remanence voltage during run down and unit will detect this as broken wire. In order not to store this failure the unit should be set as auto reset (i.e. link terminal X2 & X3 of BEMF relay)

Order Information

	Product Type	1	2	3	4	5	6
Part Number	BEMF						
Example	BEMF	FS	B	F	3	110	A
		7					
	ABC						


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
3	Mounting	F = Front of board mount, with enclosure (standard)
4	Number of poles	3, standard
5	Voltage	24 / 110 / 240 (standard)
6	Current	AC (use for 110V and 240V) / DC (use for 24V)
7	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



D-FSS-RE-STD-2 (Form 2)

The D type lock is a two-part interlock, comprising of a lock body and rear or front entry mounted catch. Typically, the D lock is used for interlocking electrical control cubicles and distribution panels. It is also suitable for use on light access doors or hatches. The catch is available in two options, one suited to well aligned doors, the other suited to poor, misaligned doors. The D lock is available as F style (figure style) or Q style of lock portions. The lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments.

Operation

The D lock range is used for interlocking electrical control cubicles and distribution panels.

D Panel Door Interlock, Form 2

① Key is free, catch is trapped



② Insert and turn key to release catch



③ Key is trapped, catch is free



1. While the catch is trapped, the key is free. The mechanism is locked keeping the door locked closed.
2. By inserting and turning the key in the D lock, you can release the catch. This will trap the key into the lock.
3. The key stays trapped while the catch is released and door opened.

The D panel door interlock is available with as rear or front entry mounted catch.

The catch is available as standard catch for well aligned doors or as MS catch for misaligned doors.

Usage

The D Panel Door Interlock should be used for interlocking electrical control cubicles and distribution panels.



The D Lock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the D Panel Door Interlock should normally be mounted to a panel using suitable fasteners (please refer to drawing on page 4 for more details)



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The D Panel Door Interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & F Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for F Type
Type of mounting	surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	1 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

The power supply to the system is switched on and the access doors to the hazardous area are locked closed.

The removal of the isolation key in the KSS20, isolates the electrical supply to the LV Panel. This key is then used to unlock the D panel door interlock interlock on the panel door.

The power cannot be switched on until the door is closed, the catch is trapped in the D panel door interlock and the key returned to the KSS20.

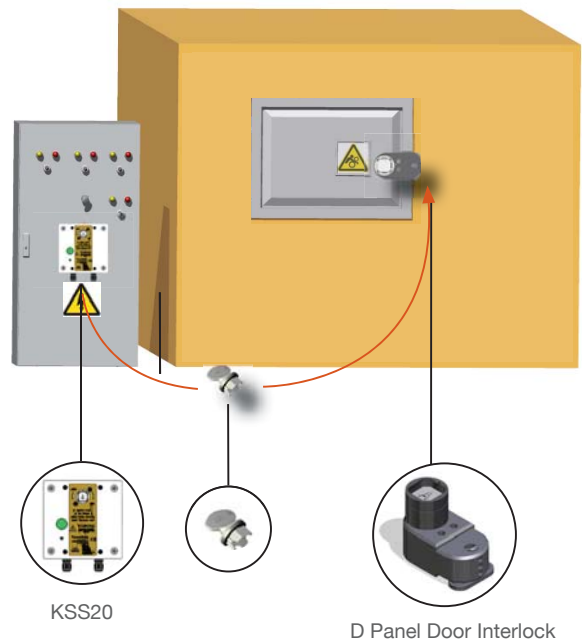

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

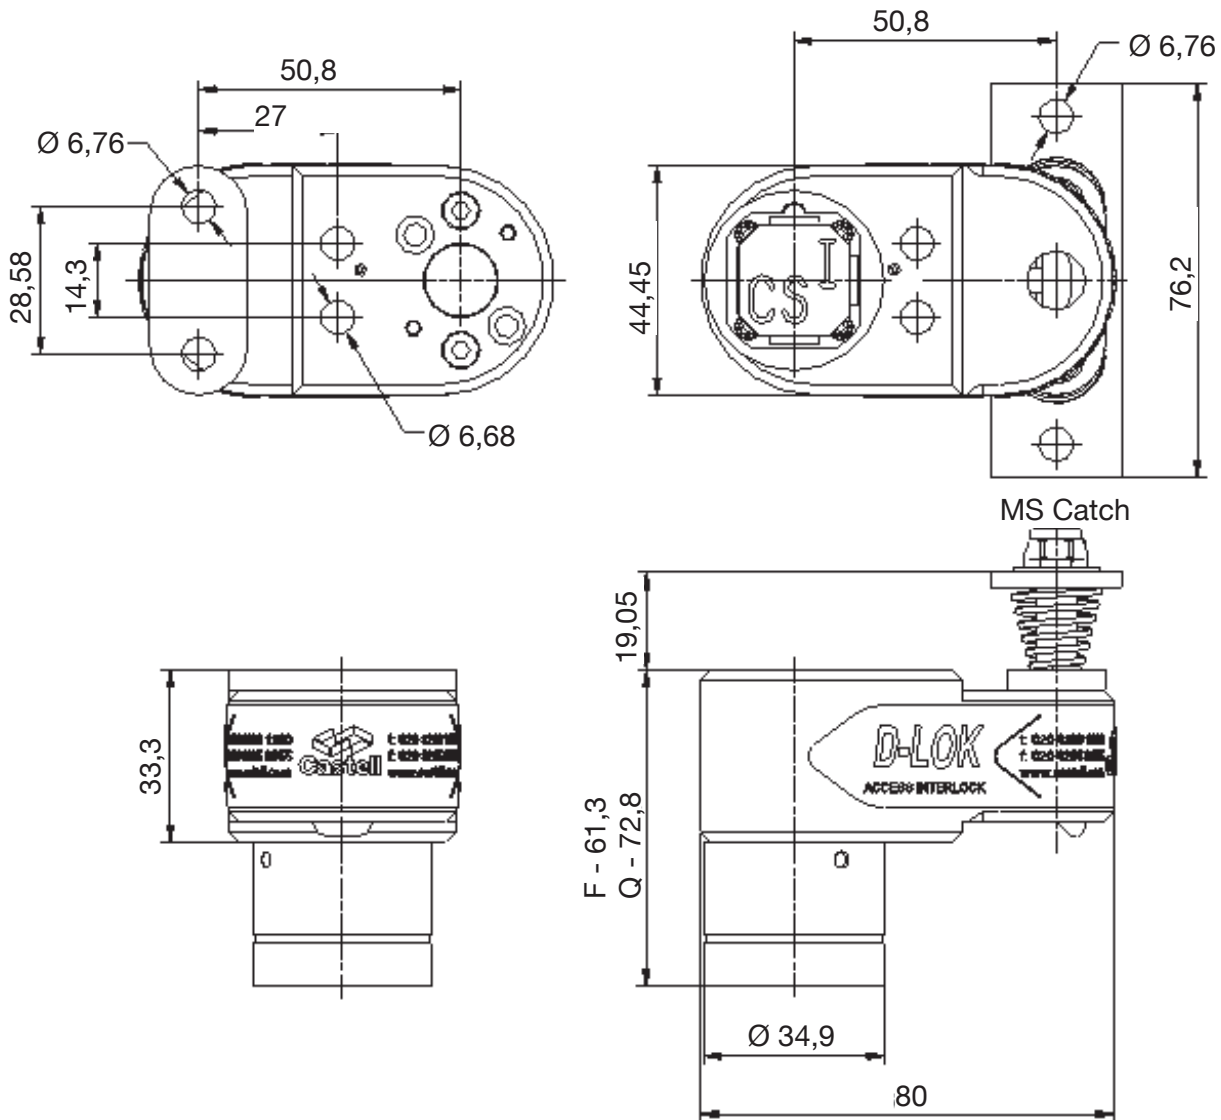

Order Information


	Product Type	1	2	3	4	5
Part Number	D					
Example	D	FS	B	RE	STD	1
	6	ABC				

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Catch entry	RE = Rear entry / FR = Front entry
4	Catch type	STD = standard catch, use for well aligned dors / MS = catch with spring, use for misaligned doors
5	Form	1 / 2 / 3 / 4 ⁽²⁾
6	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **F - Lock style** Up to 3 characters **Q - Lock style** Up to 6 characters




(2) **Form** 1 2 3 4

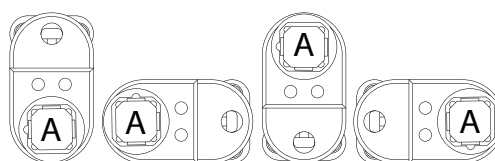

Accessories

Special construction available upon enquiry

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

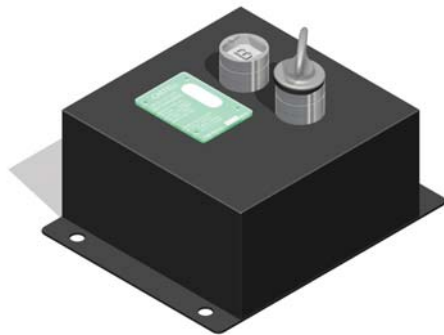

DAE-FSB-30

The DAE is a dual key controlled mechanical time delay unit designed to control access to dangerous machines which have a run-down time or where machinery must complete an operating cycle before access is permitted. The DAE is made for applications where the availability of the main power is limited or where the timer needs to be located in a potentially explosive atmosphere.

Operation

The Castell Mechanical Time Delay Units are used in various applications to control access to hazardous areas, where a run-down time of a machinery is required.

DAE Mechanical Time Delay, 30 sec

- ① Key B is trapped in the DAE, key A is held in a key switch while power is on
- ② Insert and turn key A to initiate time run-down. Once completed, release key B
- ③ While key B is released, key A is trapped



1. When the machine is running, key A is trapped in the key switch controlling the power. Key B is trapped in the mechanical time delay unit. This key is used to access the machine area, once machine has stopped running.
2. Key A is released from the key switch and the power supply is switched off. Key A is then inserted and turned in the DAE unit. Once turned, the time delay begins. Key B is held in the DAE until time elapses. Once the time delay has elapsed the indicator bar on the DAE rotates from red to white. Key B can now be turned and removed.
3. This traps key A in the DAE, key A cannot be released until key B is returned.

The DAE mechanical time delay unit is available with 30, 60 or 90 seconds time delay as standard versions.

Any time delay within a range between 30 seconds and 55 minutes is available on request.

The time delay must be longer than the machine run-down time.

Usage

The DAE is designed to operate as part of an integrated safety system, controlling access to hazardous areas. A typical example of machine isolation, time delay and access control.



The DAE mechanical time delay unit is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the DAE mechanical time delay unit should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The unit should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The DAE mechanical time delay unit must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224.6°F] Q Type / 140°C [284°F] FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	3,0 kg
Material	Mild steel
MTTF Certification	Available on request


Application

In a typical application, the DAE mechanical time delay unit is designed to operate as a part of an integrated safety system that controls access to hazardous areas.

The release of the isolation key (key A) from a key switch, e. g. KS20, interrupts the electrical supply to the machine.

Key A is then placed in the DAE time delay unit and turned, initiating the timer. After completion of the time out period key B can be released (the time delay must be longer than the machine run-down time).

Key B can then be taken to the AIE access interlock and the door to the machine room can be opened.

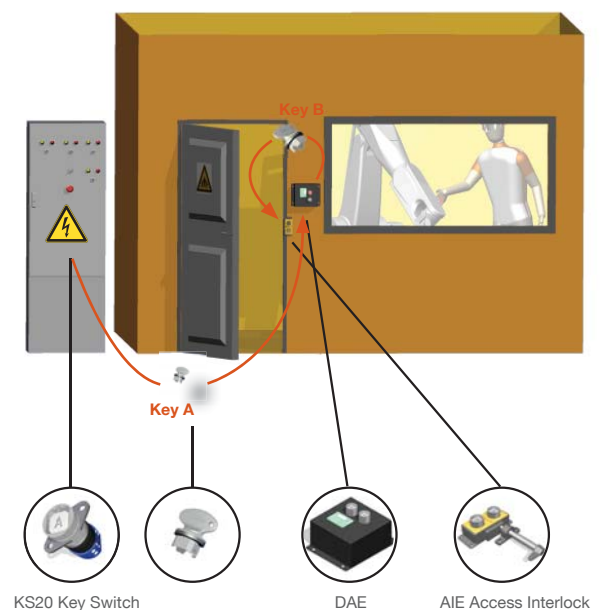

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

DAE

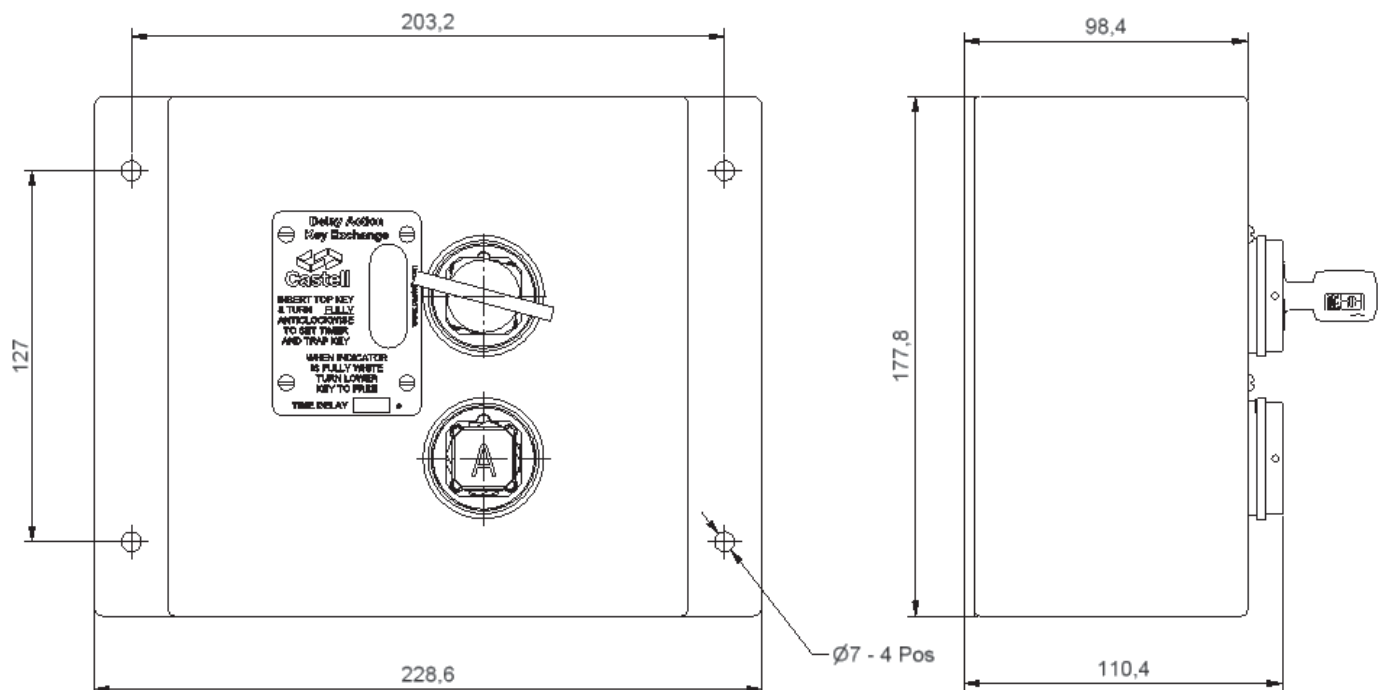

Order Information

	Product Type	1	2	3
Part Number	DAE			
Example	DAE	FS	B	30
	4			
	A			
	5			
	B			

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass
3	Time delay	30, 60 or 90 sec (as standard) or as required (max. 30min)*
4	Lock portion symbol: Top lock symbol (Free key symbol)	FS ⁽¹⁾ up to 3 digits / Q ⁽¹⁾ up to 6 digits
5	Lock portion symbol: Bottom lock symbol (Trapped key symbol)	FS ⁽¹⁾ up to 3 digits / Q ⁽¹⁾ up to 6 digits


(1) **FS - Lock type** Up to 3 symbols
Q - Lock type Up to 6 symbols



* The time delay of the DAE unit must be longer than the machine run-down time

Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



EDIX-FSS-BRI-1


The EDIX is a dual key access interlock complete with emergency exit system for use on hinged doors. The interlock is manufactured in durable stainless steel and comes with the stainless steel FS or Q style lock portions. Two internal crashbar options are available: a light duty two point aluminum and a heavy duty three point stainless steel. The EDIX interlock is ideal for use in harsh or corrosive environments where it is subject to heavy use. Typical industries using the EDIX are fire protection, turbine and offshore industry.

Operation

Castell dual key access interlocks are used in various applications to control full body access to hazardous areas.

EDIX dual key access interlock, Hand 1

- ① Door is locked closed while isolation key is free and personnel key is trapped.
- ② Insert and turn isolation key, then release personnel key and release catch from locking mechanism by operating the handle.
- ③ Door is unlocked, isolation key is trapped and personnel key is free.

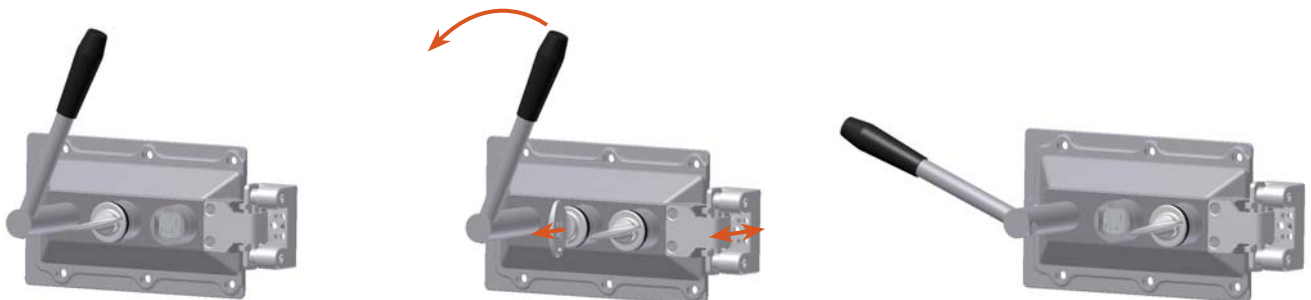

1. While the isolation key is free, the catch of the EDIX is trapped in the locking mechanism of the dual key access interlock. The door is locked and the personnel key is trapped.
2. By inserting and turning the isolation key in the interlock, you can release the personnel key and then release the catch by operating the handle. This will trap the isolation key in the lock. The released key should be taken by the personnel to the hazardous area.
3. The isolation key stays trapped until the personnel key is returned to the EDIX unit and the catch is trapped in the mechanism.

Usage

The EDIX dual key access interlock should be used to allow safe access to potential hazardous and dangerous areas. The EDIX dual key access interlock should be used on full body access doors where the use of personal safety keys is essential, to prevent accidental lock in.



The EDIX dual key access interlock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the EDIX dual key access interlock should normally be mounted on the static frame of the guard and the catch mechanism to the sliding or hinged door using suitable fasteners. Fixed bolt bracket is highly tolerant to misaligned guards and should be fitted with suitable fasteners. Please refer to the drawing on page 4 for maximum and minimum mounting distance for the housing, catch mechanism and mounting holes details. The EDIX interlocks are available in Hand 1 and Hand 2 version suitable for left or right hinged doors, respectively. Anti vibration pads should be used on machines that generate a high level of vibration.

IMPORTANT:



The EDIX dual key access interlock should be mounted on the guard using anti-tamper fasteners to prevent unauthorised removal.



The EDIX dual key access interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	Surface mount using suitable fasteners (see drawing on page 4 for mounting details)
Weight	Stainless steel: 14,0 kg
Material	Stainless steel
MTTF Certification	Available on request

Application

The EDIX is used as a part of a safety system to guard personnel when working within an area protected by a CO2 extinguishing system.

The safety system involves a KS key switch for the electrical supply to the extinguishing system controlling its operation mode. The removal of the key from the key switch changes the mode of the extinguishing system from automatic to manual. This key is then inserted in the MBV modular ball valve interlock fitted to the CO2 valve. With the key inserted, the valve is turned to the closed position, preventing the extinguishing system from being activated and allowing the removal of the secondary key from the MBV. This key is then inserted into the isolation lock on the EDIX and the personnel key removed. The door can now be opened by operating the handle. The personnel key is taken into the area by the operative. This prevents the ability of others to re-energise the extinguishing system while maintenance is being performed.

In case of an emergency the EDIX door lock can be overridden from the inside using the emergency exit crash bar.

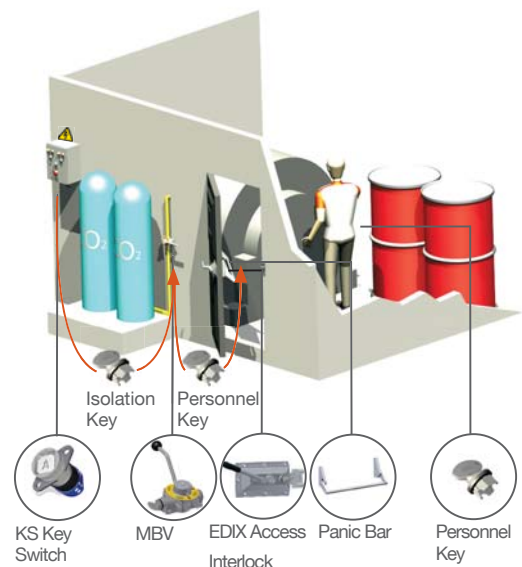

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm


Note: For safe mounting, use security screws

EDIX, Hand 1

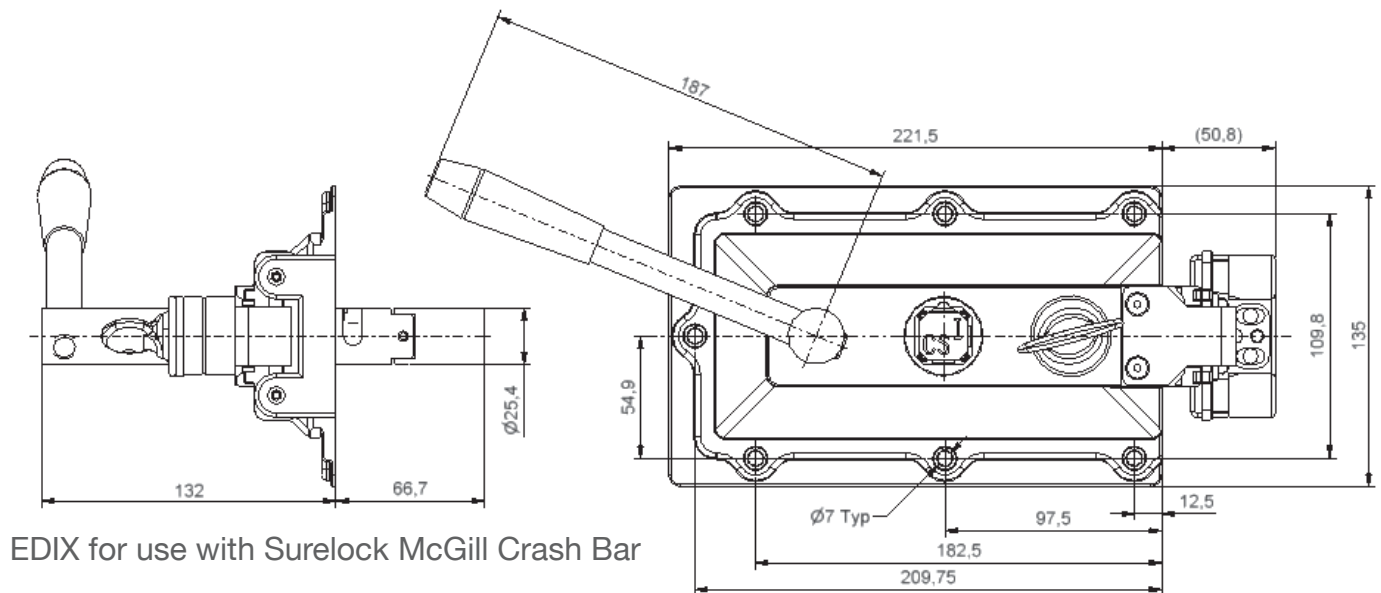

EDIX for use with Surelock McGill Crash Bar

EDIX, Hand 2

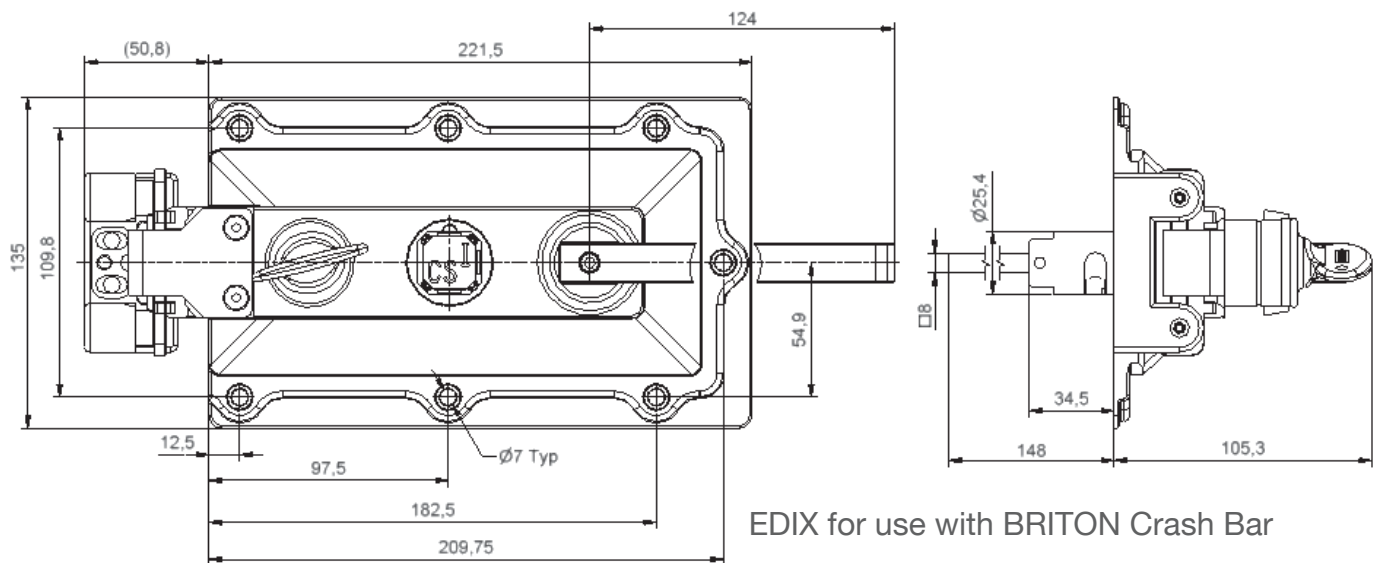

EDIX for use with BRITON Crash Bar

Order Information


	Product Type	1	2	3	4	5*	6
Part Number	EDIX						
Example	EDIX	FS	S	BRI	1	(LC)	TBA

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	S = Stainless steel, standard
3	Crash bar type	SUR = SURELOCK McGill crash bar BRI = BRITON crashbar
4	Handing	1 = Left hinged door ⁽¹⁾ 2 = Right hinged door ⁽¹⁾
5*	Optional	LC = Less crash bar MS = M/S crash bar
6	Lock portion symbol: Please advise for each lock portion separately as isolation key/lock symbol and personnel key/lock symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters
Q - Lock type Up to 6 characters



(2) **Handing**

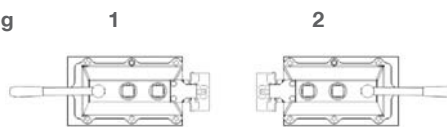

Special constructions available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



FLIP-S

The Castell protective cap is used to prevent dust ingress into the Castell F (Figure) style lock portion. In addition, the cap can be fitted with a padlock to prevent lock operation during maintenance.

Usage

The Castell FLIP-S is padlockable protective cap is used to prevent dust ingress getting into the Castell F (Figure) style lock portion.



Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & F Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for F Type
Weight	0,1 kg
Material	Stainless steel/brass /nickel plated/chome plated/nylon coated

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.


Empowered signatory:

Mr T.C. Whelan
Managing Director



Drawing

FLIP-S

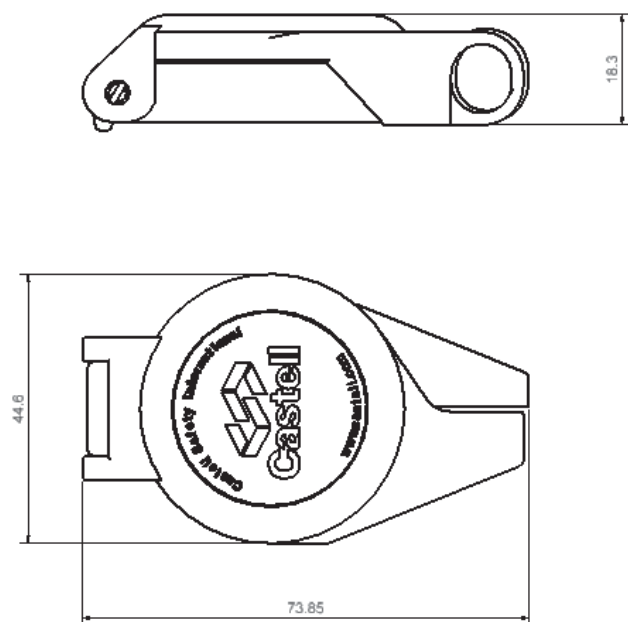

Order Information

Part Number

FLIP

-

S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



F1S-ACW-65-9.5-22

The FS and Q Interlocks are designed for use as a mechanical interlock for electrical switchgear. This is done through a mechanical connection to the isolation equipment. The standard unit is fitted with a 9.5mm square x 22mm spigot that can be used to operate an isolator. Inserting and turning the key moves the spigot through a predetermined angular position (45°/65°/90° clock or anti clock wise) moving the isolator to closed. Rotating the key in the opposite direction will open the isolator and will release the key. The free key can then be transferred to operate a parallel supply stream or an access interlock. The FS and Q locks are manufactured in brass or stainless steel making it ideal for harsh or corrosive environments.

Operation


The FS/Q switchgear interlocks are designed to control the operation of HV/LV switchgear.

FS/Q switchgear interlock

① Key is trapped,
HV/LV circuit is closed.



② Turn and release key to open
the HV/LV circuit.



③ Key is free and the
HV/LV circuit is open.



1. While the key is trapped, the isolator is closed providing the power supply.
2. Turning the key opens the isolator. The key can then be released.
3. The free key can be used to operate either a parallel supply stream or an access interlock.

The FS/Q switchgear interlocks are available in a 45° clockwise or in a 45° anti clockwise mounting position. A set range of rotational movement and spigot lengths are available (see page 5 for ordering details).

Usage

The FS/Q switchgear interlocks should be used as part of an integrated safety system, to control the operation of HV/LV switchgears.



The FS/Q switchgear interlocks are not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The FS/Q switchgear interlocks should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more details



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The FS/Q switchgear interlocks must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & F Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for F Type
Type of mounting	panel mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	0,2 kg
Material	Brass/Stainless steel/Nickel Plated
MTTF Certification	Available on request


Application

The FS/Q locks are used to ensure that multiple supplies are not applied to common bus bars.

When all incomers are closed the bus bars are open.
To close a bus bar, first the incomers must be switched to open.

In the shown is application to close Bus 1, either incomer AA or AB must be opened. The key is removed from either AA or AB connection and is then inserted into the bus switch A_ (A BLANK).

To close Bus 2, either incomer AB or BB must be opened and the key AB or BB transferred to the switch _B (BLANK B).

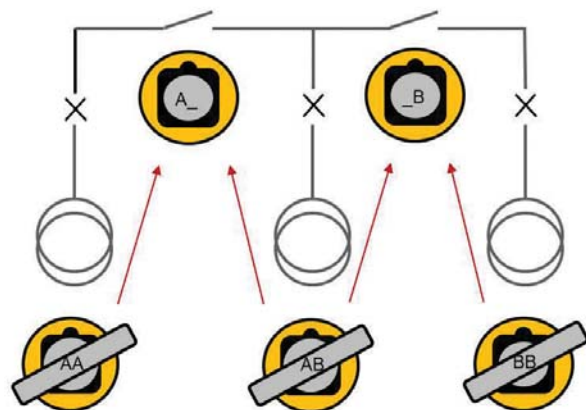

EC-Declaration

KSS20

D Panel Door Interlock

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

FS1 lock (45° clockwise mount)

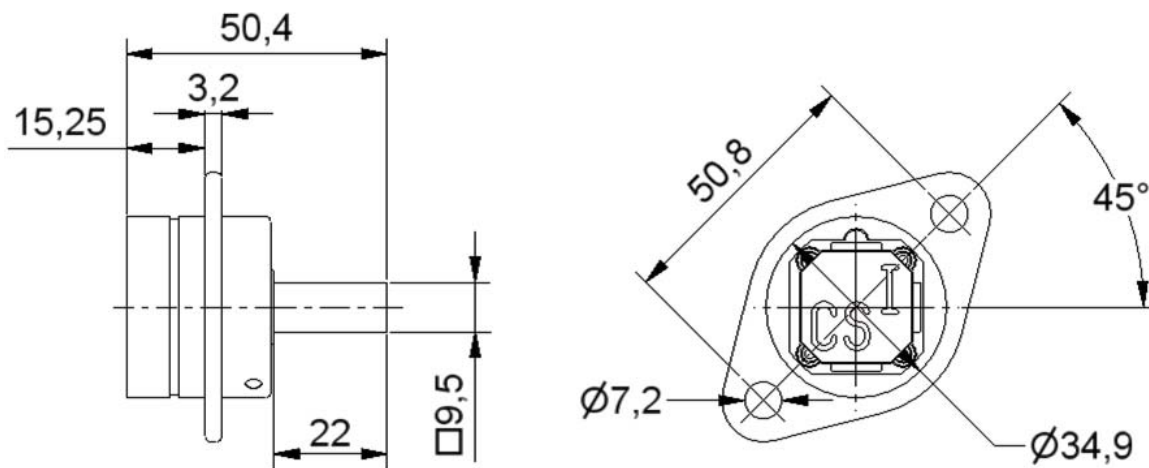

Q1 lock (45° clock wise mount)

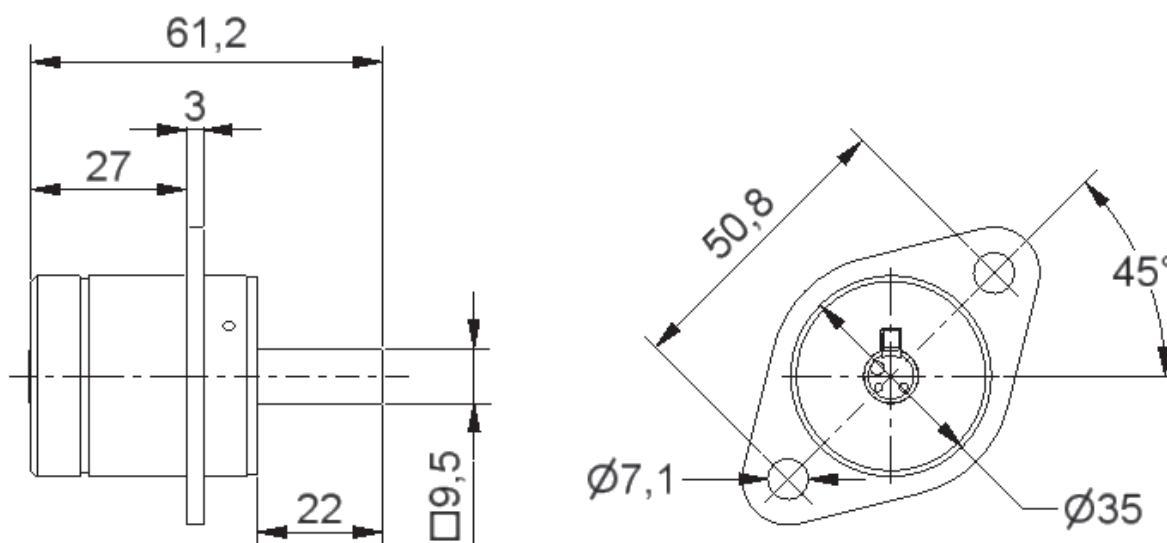

Order Information



	1	2	3	4	5	6	7
Part Number	FS/Q						
Example	FS	1	B	ACW	45	9.5	22
	8						
	ABC						

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Mounting position	1 = 45° clockwise / 2 = 45° anti clockwise ⁽²⁾
3	Material	B = Brass / S = Stainless steel / PL = Nickel plated
4	Rotational movement	CW = clock wise / ACW = anti clockwise
5	Key Rotation (degree movement)	45° / 65° / 90°
6	Spigot square profile	9,5 = 9,5 x 9,5 mm (standard)
7	Spigot length	22 = 22 mm (standard)
8	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **F - Lock style** Up to 3 characters
Q - Lock style Up to 6 characters




(2) **Mounting position**



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



K-FSS-6.4-4

The K Lock is a key operated mechanical bolt interlock that is suitable for the control of electrical switchgear. The standard unit comes with a 15.88 mm diameter bolt available in various lengths, that is used to control the rotation or movement of operating handles or toggles of electrical switchgear. Many suppliers of switchgear equipment have mounting kits available for Castell interlocks. The lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments.

Operation


The Castell K bolt interlock range is used in switchgear control to inhibit movement of cams, toggles or levers.

K bolt interlock, Form 4

① Key is free, bolt is extended



② Insert and turn key to drive bolt

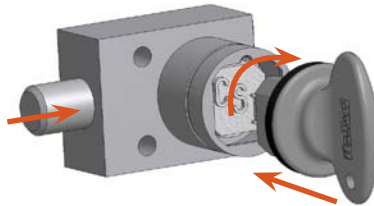

③ Key is trapped, bolt is retracted



1. While the side bolt is extended, the key is free. The mechanism is locked.
2. By inserting and turning the key in the bolt interlock, you can retract the bolt, e. g., releasing the disconnecter. This will trap the key into the lock.
3. The key stays trapped while the bolt is retracted.

The length of the bolt is available in various lengths to suit the application, but the travel of the bolt is always 19,05 mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in the bolt retracted position.

Usage

The K bolt interlocks are used as a part of a safety system to allow safe control of valves or disconnect switches.



The K bolt interlock is not designed for security purposes, such as a safe or external access to a building.
The K bolt interlock is not designed to interlock access gates or doors. Please refer to AI access interlocks.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the K bolt interlock should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The K bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,7 kg
	Stainless steel: 0,7 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application


The K bolt interlocks are used as a part of a safety system to allow safe control of valves or disconnect switches.

While power supply to the system is switched on, the access doors to the hazardous area are locked closed. Key A is trapped in the disconnect K bolt interlock (1) while the process is on.

To enter the hazardous area, the disconnect is turned to the off position and key A is released, locking the disconnect in the disengaged position.

Key A is then taken to the grounding switch. Key A enters the second K lock (2) which retracts the bolt enabling the cammed switch lever to be rotated to engage the ground. Once rotated, the recess in the cam aligns with the next K lock (3) with key B trapped in its lock. Key B can now be removed from K lock (3), which now locks the lever in place ensuring that the ground connection cannot be broken.

The system is now disconnected and grounded, key B can be taken to operate the access interlock on the door of the hazardous area to gain access into it.

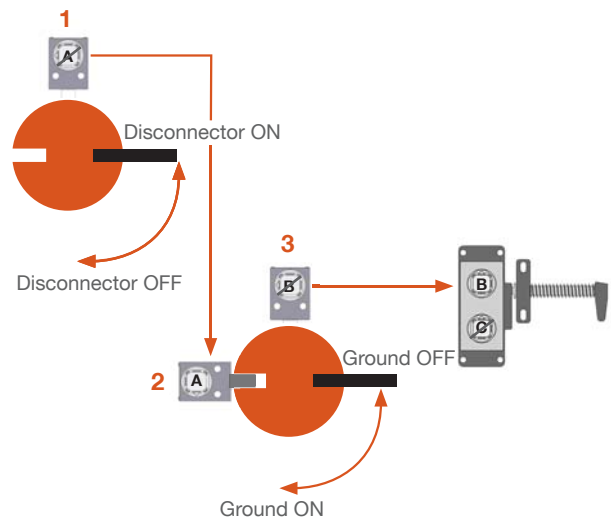

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

K, form 4

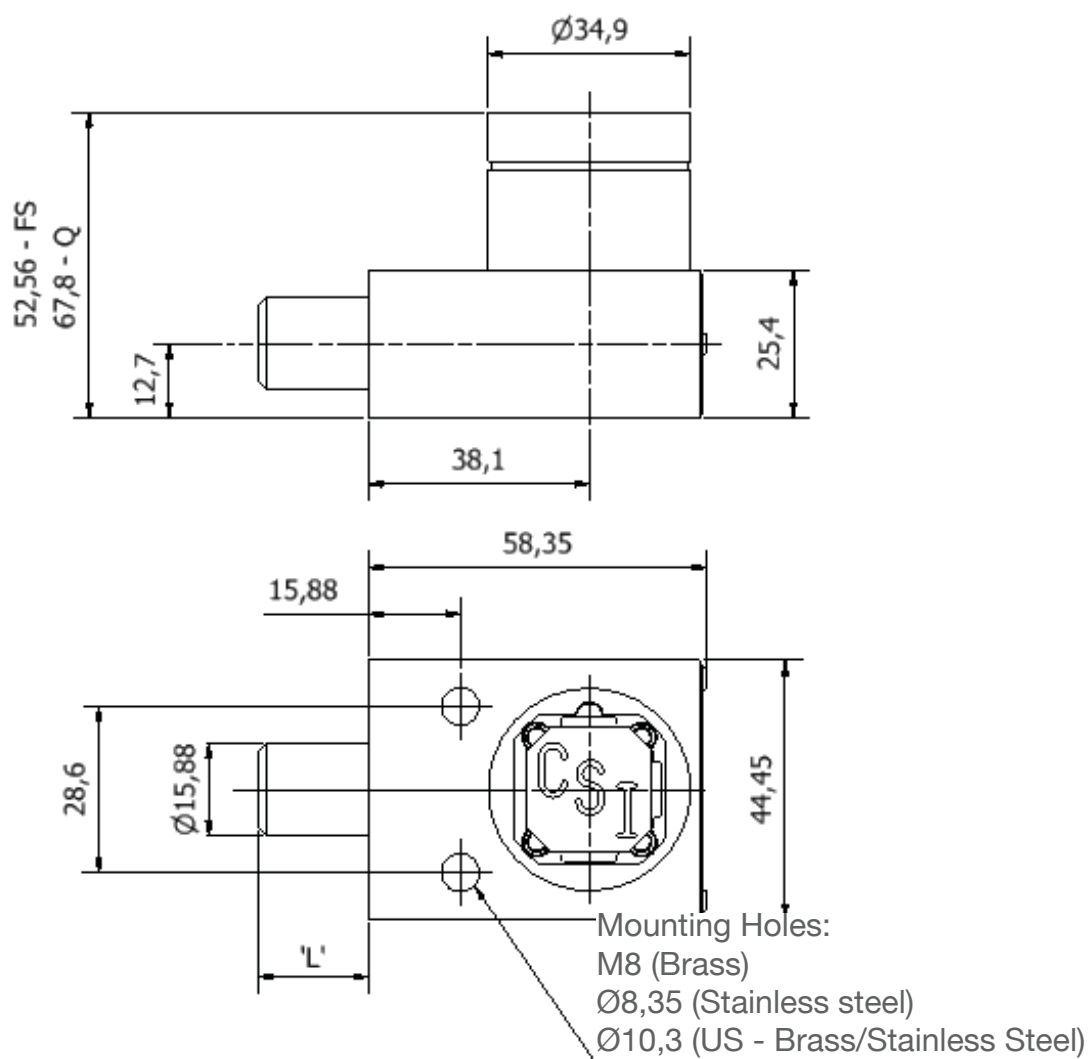

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

Order Information


	Product Type	1	2	3	4
Part Number	K				
Example	K	FS	B	6,4	1
	5	ABC			

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
4	Form	1 / 2 / 3 / 4 ⁽²⁾
5	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters
Q - Lock type Up to 6 characters




(2) **Form**

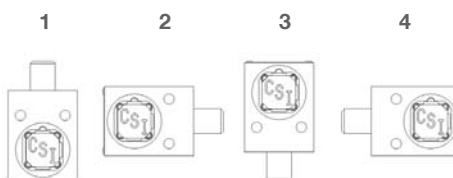

Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



The KC Lock is a key operated mechanical bolt interlock suitable for the control of electrical switchgear. The standard unit comes with a 16 mm diameter bolt fitted with a claw, that is used to control the rotation or movement of the operating handles or toggles of electrical switchgear. The bolt length and claw dimensions are variable to suit the particular requirement. The lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments.


K-FSS (Form 4)

Operation

The Castell claw interlocks range is used in switchgear control to lock off power supply and control accesses to hazardous areas.

KC Claw Interlock, Form 4

- ① Key is trapped, claw bolt is retracted. Switch is unlocked or in ON position.
- ② Extend the claw bolt. Then turn and release key to lock the claw in extended position and lock the switch OFF.
- ③ Key is free, claw bolt is extended and switch is locked OFF.

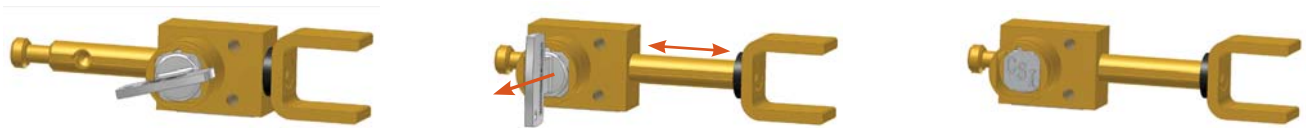

1. While the claw bolt is retracted, the switch is in ON position. The mechanism is unlocked while the key is trapped.
2. Extend the claw bolt manually and lock the claw in extended position by turning and releasing the key. This locks the switch in OFF position.
3. The released key can be used to access a hazardous area via an access interlock. The switch cannot be unlocked and switched on until the key is replaced and turned in the KC claw interlock.

The standard KC claw interlock comes with a 16mm diameter bolt fitted with a claw. The bolt length and claw dimensions are variable and need to be advised when ordering.

Usage

The KC claw interlock is designed to be part of a safety system and is used to lock off switches which then allows to gain access to a hazardous area.



The KC claw interlock is not designed for security purposes, such as external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KC claw interlock should normally be mounted to a panel using suitable fasteners (please refer to drawing on page 4 for more details)



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KC claw interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	N/A
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

The Castell KC claw interlock is used as a part of a safety system, typically in machine guarding applications. It is usually used in combination with an Access Interlock such as the Salus for part body access or an Access Interlock with an exchange key for full body access control.

While the power supply is switched on, the key is trapped in the KC claw interlock. To lock off the power supply switch, manually edrive the bolt to extended position. This will release the key keeping the bolt extended and the switch locked off. The key is released and taken by the personnell to unlock the AI access interlock on the HV cabinet. While the access door is opened, the key remains trapped in the AI lock.

The system has to be designed so that the bolt of the KC claw interlock cannot be retracted to unlock the power supply until the door to the HV cabinet is locked, the key removed from AI access lock and the replaced into the KL claw interlock.

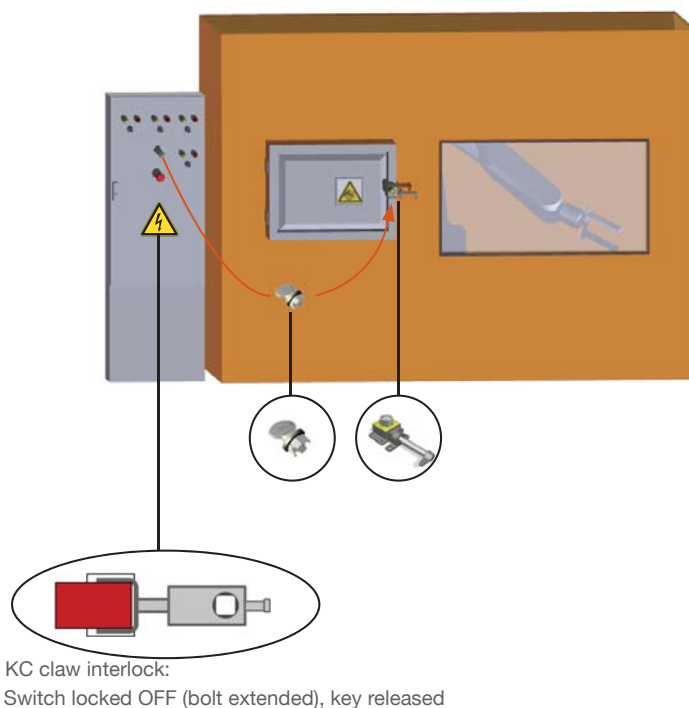

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

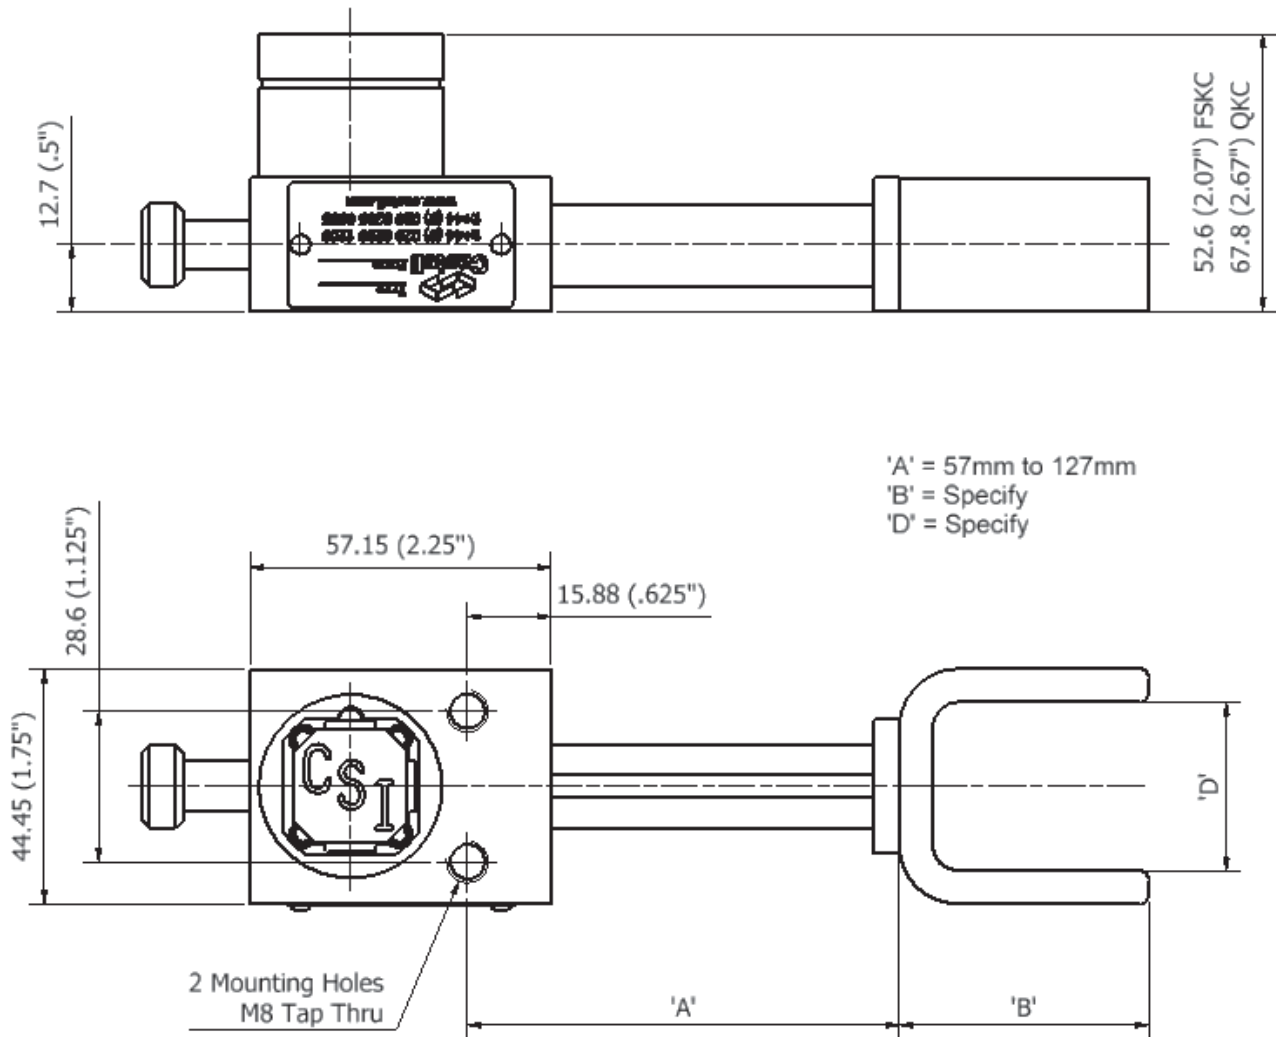

Order Information

Product Type

Part Number KC - 1 2 - 3

Example KC - FS B - 4

4

19.1mm A Dimension

5

60mm B Dimension

6

28.9mm D Dimension

7


ABC Lock Portion Symbol

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Form	1 / 2 / 3 / 4 ⁽²⁾
4	A dimension (bolt travel)	please specify: from 57mm to 127mm
5	B dimension (see page 4 for claw details)	please specify
6	D dimension (see page 4 for claw details)	please specify
7	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Up to 3 characters
Q - Lock type Up to 6 characters



(2) Form

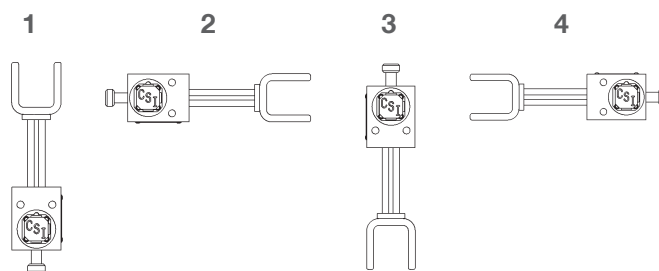

Contact Information

Special construction available upon enquiry

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

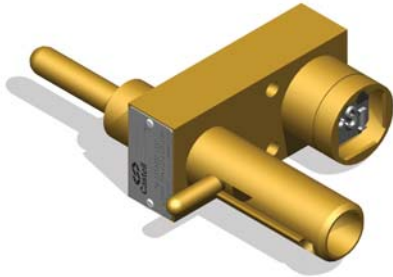

KE-FSB-6.4-4


The KE lock is a one piece access interlock comprising of a main body and sliding bolt. The lock is designed to suit sliding doors of various sizes and thicknesses. The interlock is manufactured in brass and comes with the brass figure or Q type lock portions and is ideal for use in dry, non-corrosive environments where the lock is subject to medium to heavy use. Typical industries using the KE lock are automotive and steel production.

Operation


The Castell KE sliding door interlock range is used in switchgear control to inhibit movement of cams, toggles or levers.

KE sliding door lock, Form 4

① Key is free, bolt is extended

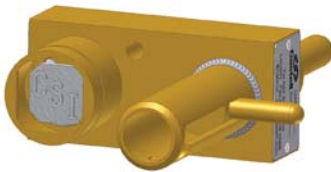

② Insert and turn key to drive bolt

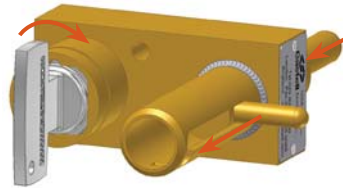

③ Key is trapped, bolt is retracted



1. While the side bolt is extended, the key is free and usually held in the power isolation unit.
2. Inserting and turning the key in the KE door interlock allows the bolt to retract unlocking the access door to the machine area. This will trap the key in the lock.
3. The key stays trapped while the bolt is retracted.

The length of the bolt is 50,8mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in the bolt retracted position.

Usage

The KE sliding door lock should be used to allow safe control of sliding doors.



The KE lock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KE sliding door lock should normally be mounted to a panel using suitable fasteners. See drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KE sliding door lock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 19KN.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CKE Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,7 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request


Application

The KE bolt interlocks are used as a part of a safety system, typically in machine guarding applications.

The power supply to the system is switched on and the access door to the hazardous area is locked closed.

The removal of the isolation key in the KS20, isolates the electrical supply to the LV Panel. This key is then used to unlock the KE sliding door interlock interlock on the sliding door.

The power cannot be switched on until the door is closed, the bolt is trapped in the KE sliding door interlock and the key returned to the KS20.

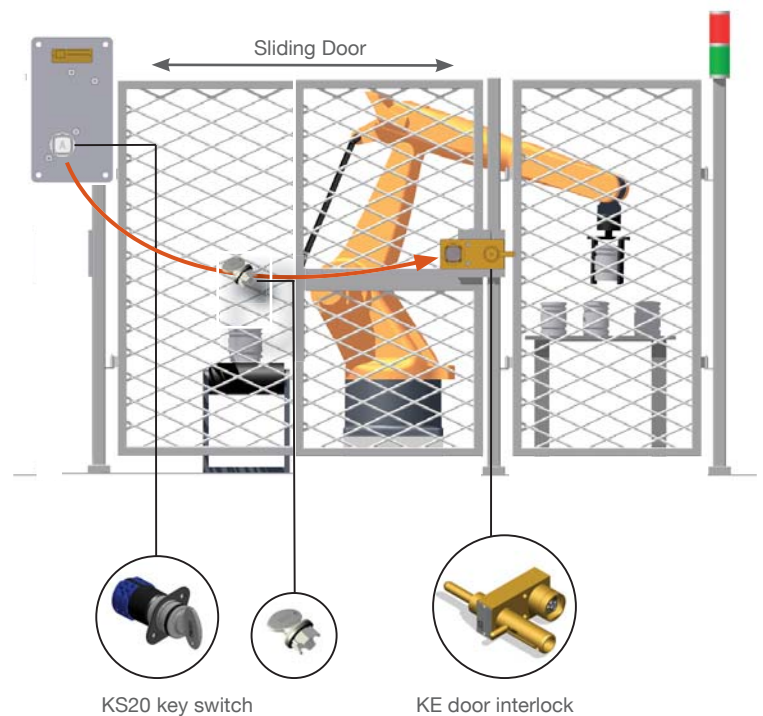

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

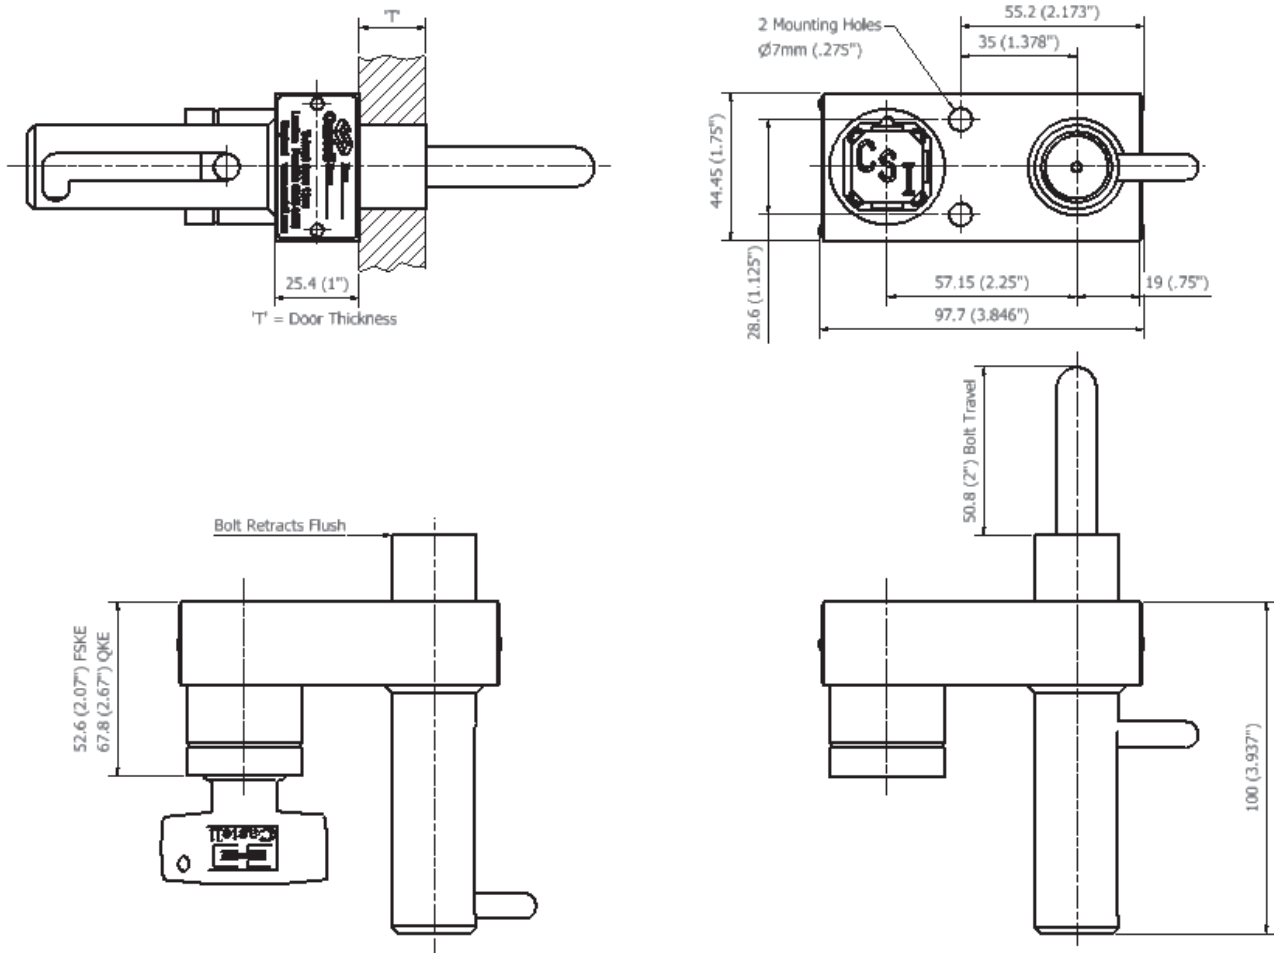

Order Information

	Product Type	1	2	3
Part Number	KE			
Example	KE	FS	B	1
	4			
	9mm			
	5			
	ABC			


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
4	Form	1 / 2 / 3 / 4 ⁽²⁾
5	Door thickness	please advise
6	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - lock type Q - lock type
Up to 3 characters Up to 6 characters




(2) Form


1




2



3




4



Accessories

Special construction available upon enquiry

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



FKW6-S

A selection of keys is available to suit a range of applications, from the basic nickel plated key to the stainless steel sealing key. The F range of keys fit the figure style lock portion whilst the Q range fits the Q style lock portion.

Operation

Two different types of keys are available: F range for figure style and Q range for Q style lock portions:



F keys (Figure style)

- Stainless steel, brass and plated range of keys
- Customised coding
- **SYMBOL (CODE) TO BE ADVISED WHEN ORDERING**
 - select up to 3 characters
 - any alpha- (A-Z) and numeric (0-9) configurations
 - do not use letter O, use Zero instead
 - do not use lower case
 - for spacing as a character advise TABLET (submaster key)*
- 47,988 code options available
- Master and submaster keys available*



Q keys (Q style)

- Stainless steel, brass and plated range of keys
- Customised coding
- **SYMBOL (CODE) TO BE ADVISED WHEN ORDERING**
 - select up to 6 characters
 - any alpha- (A-Z) and numeric (0-9) configurations
 - additional, non alphanumeric characters available: (*), (/), (-) and (_)
 - do not use letter O, use Zero instead
 - do not use lower case
- over 3,6 billion code options available
- Recorded in internal data base to avoid duplications

***The disclaimer on page 2 applies when ordering master, submaster and spare keys**

Disclaimer

IMPORTANT:

We must draw your attention to the potential danger of issuing spare, master or submaster keys.



Trapped key interlocks control procedural events in a strict sequence. If this sequence is altered, through the use of spare or master keys, the integrity of your safety system may be compromised, possibly resulting in serious or even fatal injury to persons or damage to processes and plant.

In the wrong hands, spare or master keys could expose person(s) to the very hazard from which the interlocking system is intended to protect them.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & F Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for F Type
Type of mounting	M6
Weight	0,1 kg
Material	Stainless steel/brass /nickel plated/chrome plated/nylon coated

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director



F Keys



FK4-NI /
FK4-MASTER



FKW6-S /
FKW6-S-MASTER



FKW6-NI



FKW3-RED



KSD-R



CL1062



006512



SHORT KEY /
SHORT KEY-ENG BOTHSIDE

Order Information/ Part Number

Description

FK4-NI	FK4 NICKEL PLATED KEY
FK4-MASTER	FK4 MASTER KEY
FKW6-S	FKW6 STAINLESS STEEL SEALING KEY
FKW6-S-MASTER	FKW6 STAINLESS STEEL MASTER KEY
FKW6-NI	FKW6 NICKEL PLATED SEALING KEY
FKW3-RED	FKW3 T HANDLE SEALING KEY RED NYLON COATED
KSD-R	SWITCH DISCONNECTOR KEY
006512	SALVO KEY - FKW6-S KEY COMPLETE WITH ID TAG
CL1062	MERLIN GERIN KEY SK20165 MASTER PACT RANGE
SHORT KEY	SCHNEIDER AND ABB SWITCHGEAR APPLICATIONS KEY, NICKEL PLATED

Special keys available upon enquiry

The disclaimer on page 2 applies when ordering master, submaster and spare keys

Q Keys



QS-S



QS-B



QS-NI

Order Information/ Part Number

Description

QS-S	QS KEY - STAINLESS STEEL
QS-B	QS PLAIN BRASS Q KEY
QS-NI	QS KEY - NICKEL PLATED


Special keys available upon enquiry

The disclaimer on page 2 applies when ordering spare keys


Drawings

F Keys


Dimensions:
in mm




FK4-NI / FK4-MASTER

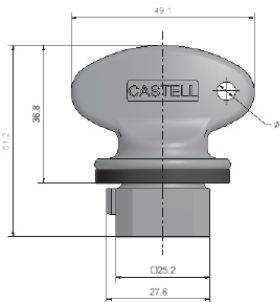


FKW6-S / FKW6-S-MASTER

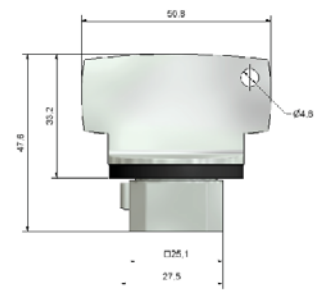


FKW6-NI

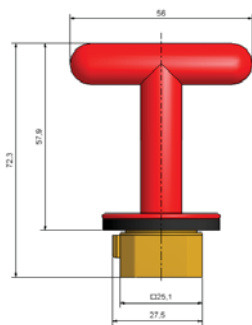


FKW3-RED

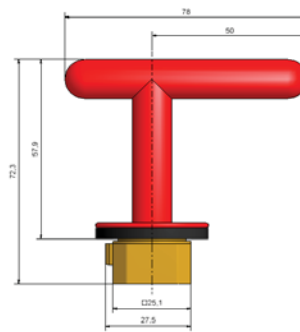


KSD-R

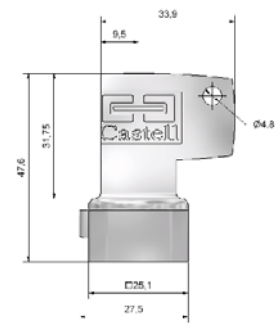

CL1062

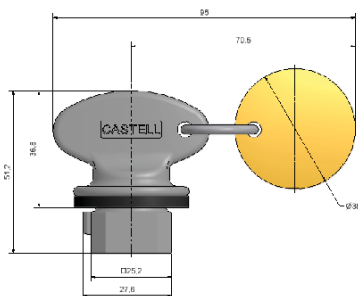

006512



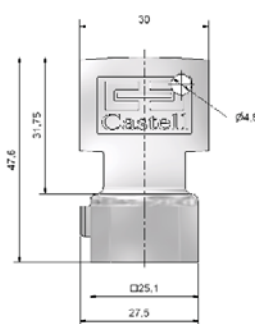


SHORT KEY

Drawings

Q Keys

Dimensions:
in mm

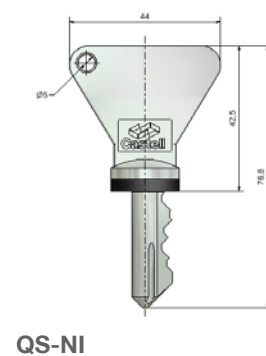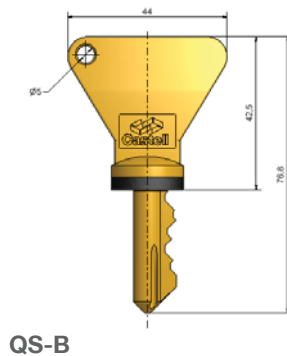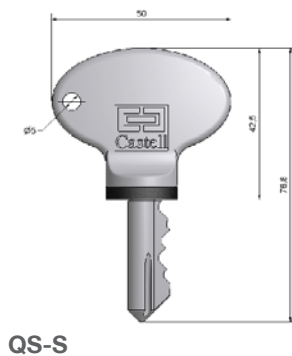

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

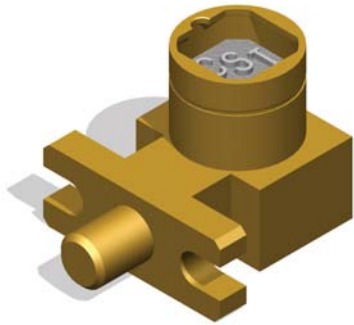

KF-FSB-6.4-4


The KF Lock is a key operated mechanical bolt interlock for the control of electrical switchgear. The standard unit comes with a 16 mm diameter bolt of variable length, that is used to control the rotation or movement of operating handles or toggles of electrical switchgear. The KF interlock comes equipped with a flange to allow for different sorts of mounting. This lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments.

Operation


The Castell KF bolt interlock range is used in switchgear control to inhibit movement of cams, toggles or levers.

KF bolt interlock, Form 4


① Key is free, bolt is extended

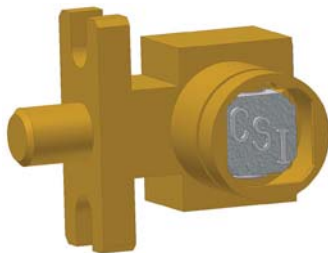

② Insert and turn key to drive bolt

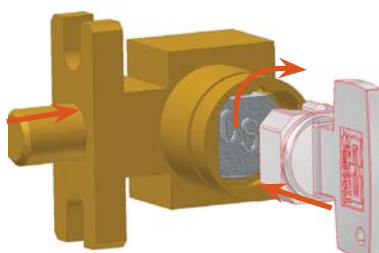

③ Key is trapped, bolt is retracted

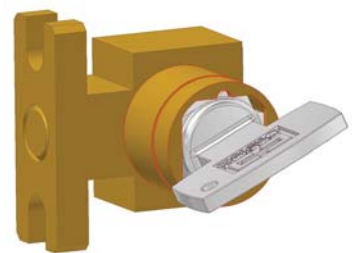

1. While the side bolt is extended, the key is free. The mechanism is locked.
2. By inserting and turning the key in the bolt interlock, you can retract the bolt, e. g., releasing the disconnecter. This will trap the key into the lock.
3. The key stays trapped while the bolt is retracted.

The length of the bolt is available in various lengths to suit the application, but the travel of the bolt is always 19,05 mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in the bolt retracted position.

Usage

The KF bolt interlocks are used as a part of a safety system to allow safe control of valves or disconnect switches.



The KF bolt interlock is not designed for security purposes, such as a safe or external access to a building.
The KF bolt interlock is not designed to interlock access gates or doors. Please refer to AI access interlocks.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KF bolt interlock should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KF bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,7 kg
	Stainless steel: 0,7 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application


The KF bolt interlocks are used as a part of a safety system to allow safe control of valves or disconnect switches.

While power supply to the system is switched on, the access doors to the hazardous area are locked closed. Key A is trapped in the disconnecter KF bolt interlock (1) while the process is on.

To enter the hazardous area, the disconnecter is turned to the off position and key A is released, locking the disconnecter in the disengaged position.

Key A is then taken to the grounding switch. Key A enters the second KF lock (2) which retracts the bolt enabling the cammed switch lever to be rotated to engage the ground. Once rotated, the recess in the cam aligns with the next KF lock (3) with key B trapped in its lock. Key B can now be removed from KF lock (3), which now locks the lever in place ensuring that the ground connection cannot be broken.

The system is now disconnected and grounded, key B can be taken to operate the access interlock on the door of the hazardous area to gain access into it.

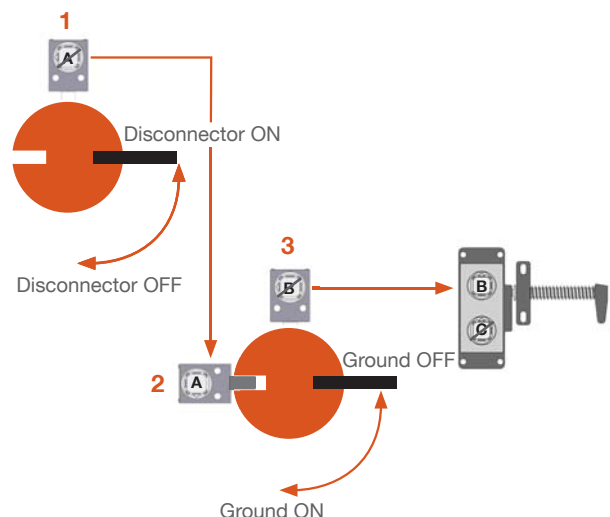

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

KF, form 4

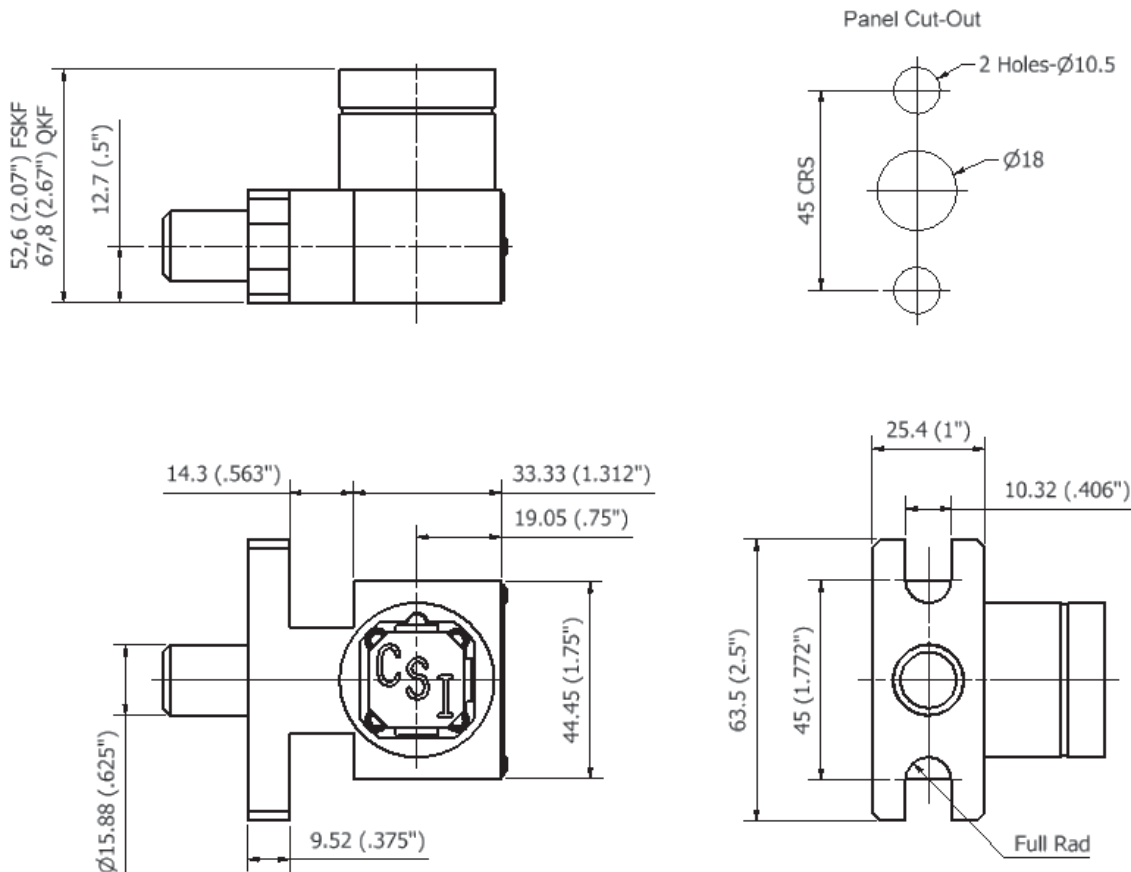

Mounting Holes:

M8 (Brass)

Ø8,35 (Stainless steel)

Ø10,3 (US - Brass/Stainless Steel)

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

Order Information


	Product Type	1	2	3	4
Part Number	KF				
Example	KF	FS	B	6,4	1
	5				
	ABC				

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
4	Form	1 / 2 / 3 / 4 ⁽²⁾
5	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters
Q - Lock type Up to 6 characters




(2) **Form**

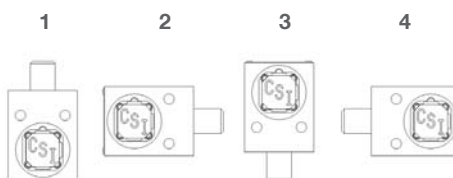

Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

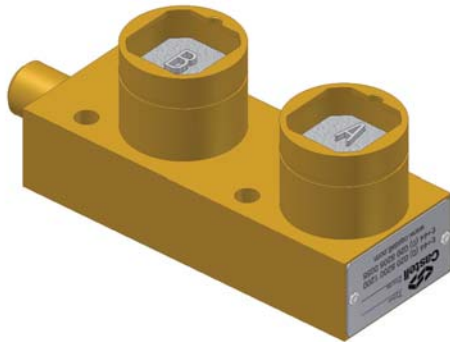

KL-FSB-6.4-4-D


The KL dual key bolt interlock is a key operated mechanical bolt interlock suitable for the control of electrical switchgear. The standard unit comes with a 15,88 mm diameter bolt of variable length, that is used to control the rotation or movement of operating handles or toggles of electrical switchgear. Many suppliers of switchgear equipment have mounting kits available for Castell's interlocks. The lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments. The KL bolt interlock is available in a double key or exchange key condition.

Operation


The Castell KL bolt interlock range is used on control of switchgear to inhibit movement of cams, toggles or levers.

KL dual key bolt interlock, exchange key condition


- ① Key A is free, while key B is trapped and bolt is extended.

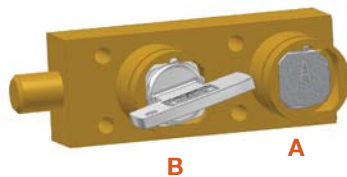

- ② Insert and turn key A, then turn key B to drive bolt, releasing key B.

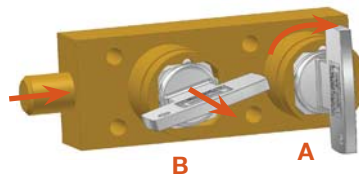


- ③ Key B is free, key A is trapped and bolt is retracted.

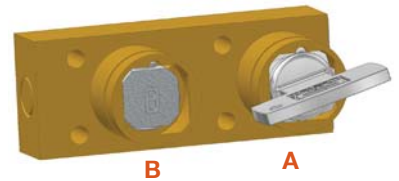


1. While the side bolt is extended and key B is trapped, key A is free. The disconnecter is locked by the extended bolt of the KL.
2. Inserting and turning key A in the bolt interlock enables rotation of key B, releasing the mechanism. This will trap key A into the lock.
3. Key A stays trapped while the bolt is retracted and key B is released.

KL dual key bolt interlock, double key condition


- ① Key A and key B are free, bolt is extended.

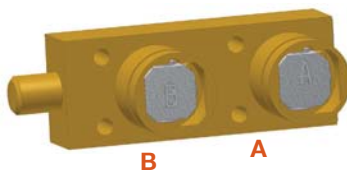

- ② Insert and turn both keys to drive bolt.

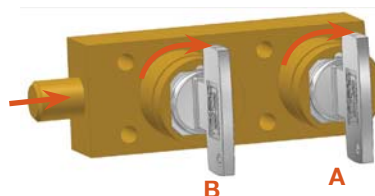

- ③ Keys are trapped, bolt is retracted.

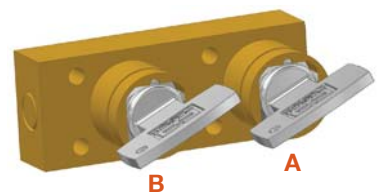

1. While the side bolt is extended, key A and key B are free. The disconnecter is locked.
2. By inserting and turning key A and key B in the bolt interlock, you can retract the bolt, releasing the disconnecter. This will trap both keys into the lock.
3. Both keys stay trapped while the bolt is retracted.

The length of the bolt can be varied to suit the application but travel of the bolt is always 19,05 mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in bolt retracted position.

Usage

The KL dual key bolt interlock should be used as a part of a safety system to allow safe control of disconnect switches.



The KL bolt interlock is not designed for security purposes, such as safe or external access to a building.
The KL bolt interlock is not designed to interlock gates or doors. Please refer to the AIE access interlock.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KL bolt interlock should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KL bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of detected defects please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS-Type
	Maximum: 107°C [224,6°F] for Q-Type/140°C [284°F] for FS-Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	1,4 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

KL dual key bolt interlocks are used as a part of a safety system. A typical application is where the electrical and pneumatic supplies to the machine are switched on and the access doors to the hazardous area are locked closed.

Key A and B are trapped in the KL bolt interlock, preventing access to the machine area. To enter the area, the pneumatic supply must be turned off. Turning the keys in the KL bolt interlock will extend its bolt. The released keys ensure the bolt remains in extended position locking off the disconnecter. The released keys can now be taken to the machine area to gain access via the AI access interlocks.

The disconnecter cannot be switched on until both access doors are locked closed and both keys replaced in the KL bolt interlock.

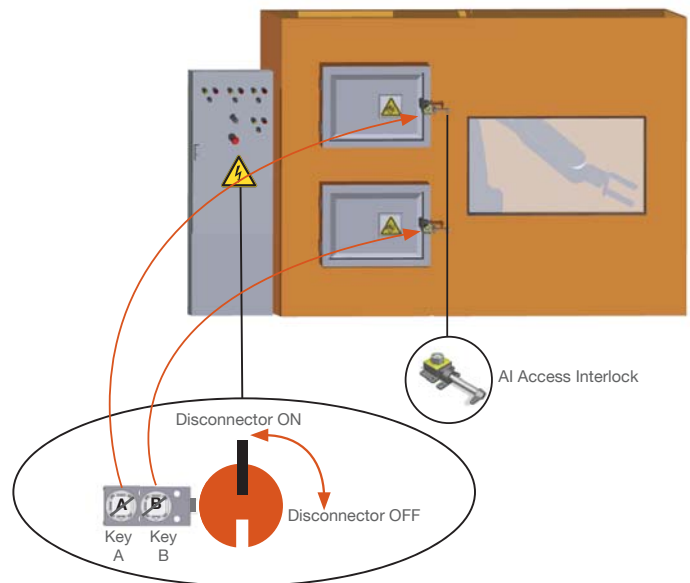

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

KL, form 4

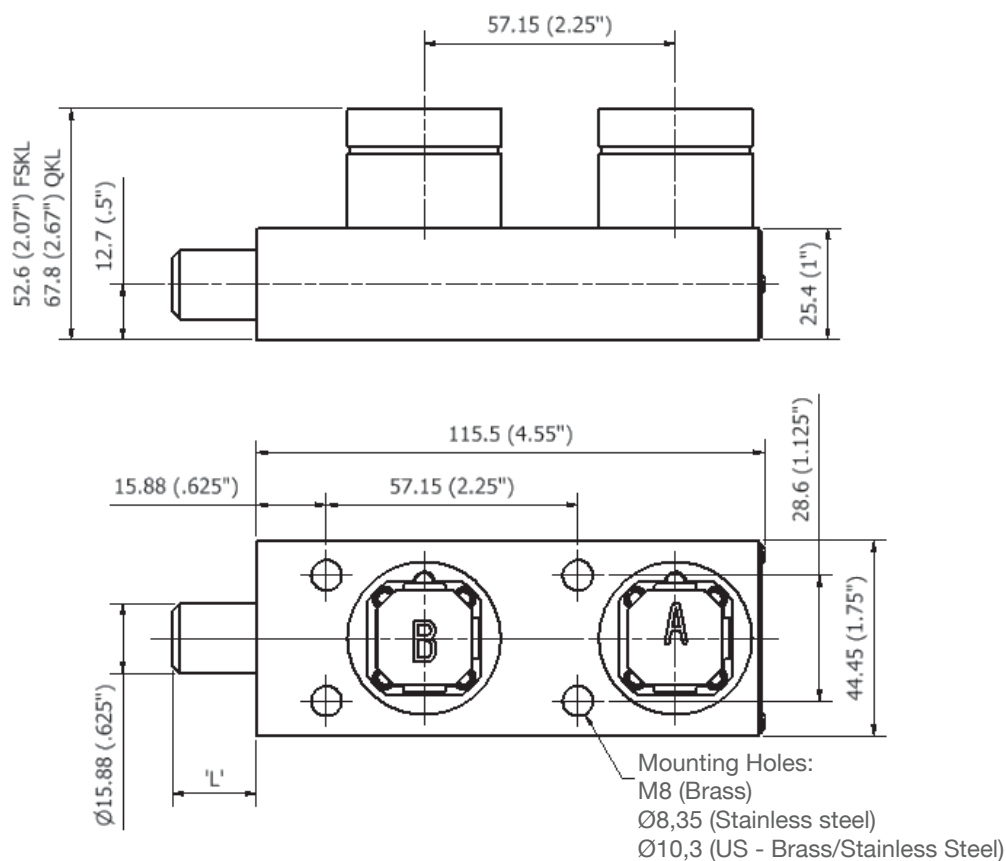

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

Order Information

	Product Type	1	2	3	4	5	6
Part Number	KL						
Example	KL	FS	B	1S	6,4	1	D

7	A1	Isolation Key Symbol (exchange key condition)
	OR	
		Primary Key Symbol (double key condition)

8	B1	Personnel Key Symbol (exchange key condition)
	OR	
		Secondary Key Symbol (double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Number of lock portions	1S = 1 secondary key (2 locks) 2S = 2 secondary keys (3 locks) 3S = 3 secondary keys (4 locks)
4	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
5	Form	1 / 2 / 3 / 4 ⁽²⁾
6	Key Condition	D = double key condition / E = exchange key condition (see operation details, page 1)
7	Lock portion symbol: Isolation key (for exchange key condition) or Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
8	Lock portion symbol: Personnel key(s) (for exchange key condition) or Secondary key(s) (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters


(1) FS - Lock type
Up to 3 symbols



Q - Lock type
Up to 6 symbols



(2) Form

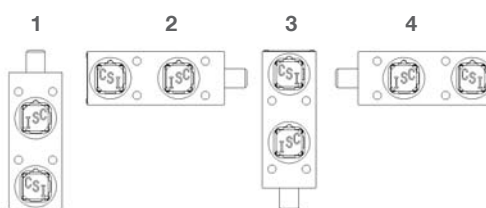

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

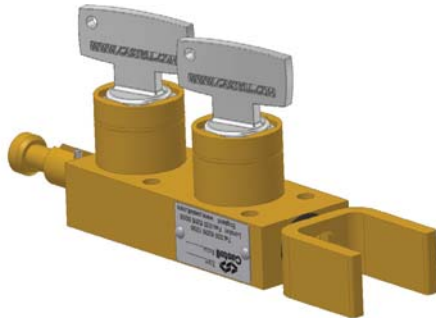

KLC-FSB (Form 4)



The KLC dual key claw interlock is a multi-key operated mechanical bolt interlock suitable for the control of electrical switchgear. The standard unit comes with a 16mm diameter bolt fitted with a claw that is used to control the rotation or movement of operating handles or toggles of electrical switchgear. The lock is manufactured in brass or stainless steel which is ideally suited to use in harsh or corrosive environments.

Operation

The Castell claw interlocks range is used in switchgear control to lock off power supply and control accesses to hazardous areas.

KLC dual key claw interlock, exchange key condition

- ① Key A is free, key B is trapped and claw is retracted.
- ② Insert and turn key A and drive the bolt manually to extend the claw. Turn and release key B.
- ③ Key B is free, key A is trapped and the claw is locked in extended position.

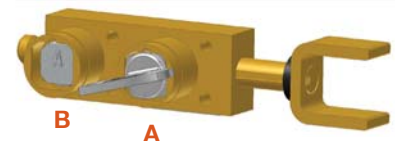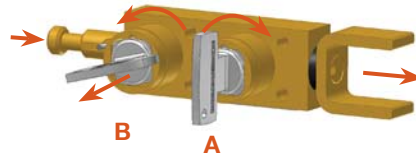


1. While key A is free, the claw is locked in retracted position, allowing the switch to turn or move.
2. By inserting and turning key A in the KLC claw interlock, you can unlock the claw and manually extend the bolt. The claw now constrains the switch in the off position. Releasing key B will lock the claw in the extended position and trap key A. The released key B can be used as personnel key to gain access to the hazardous area via an access interlock.
3. The switch cannot be switched on until key B is replaced in the KLC claw interlock, the bolt is retracted and key A released locking the claw in the retracted position.

The length of the bolt can be varied to suit the application but travel of the bolt is always 50,08 mm.

Operation

KLC dual key claw interlock, double key condition

- ① Keys A and B are trapped, the claw is retracted
- ② Drive the bolt to extend the claw. Turn and release key A and B to lock the claw in extended position.
- ③ Both keys are released and the claw is locked in extended position.

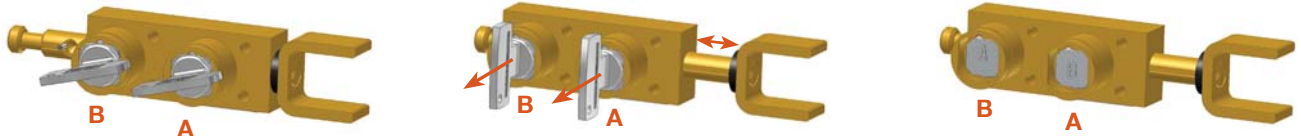

1. While both keys are trapped, the claw is locked in retracted position, unconstraining the switch.
2. Driving the bolt, the claw is extended. Turning and releasing both keys will lock the claw in extended position constraining the switch in the off position. The released keys can be used as personnel keys to gain access to the hazardous area via an access interlock.
3. The switch cannot be switched on until key A and B are replaced in the KLC claw interlock and the claw is retracted.

The length of the bolt can be varied to suit the application but travel of the bolt is always 50,08 mm.

Usage

The KLC dual key claw interlock is designed to be part of a safety system and is used to lock off switches which then allows to gain access to a hazardous area.



The KLC claw interlock is not designed for security purposes, such as external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KLC dual key claw interlock should normally be mounted to a panel using suitable fasteners (please refer to drawing on page 4 for more details)



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KLC claw interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	N/A
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

The Castell KLC claw interlock is used as a part of a safety system, typically in machine guarding applications. It is usually used in combination with an Access Interlock such as the Salus for part body access or an Access Interlock with an exchange key for full body access control.

While the power supply is switched on, both keys are trapped in the KLC claw interlock. To lock off the power supply switch, drive the bolt to extended position. The design has to be such that the bolt cannot be extended when the system is turned on. This will release the keys keeping the bolt extended and the switch locked off. The released keys are taken by the personnel to unlock the AI access interlocks on the HV cabinet. While the access doors are opened, the keys remain trapped in the AI locks.

The bolt of the KLC claw interlock cannot be retracted to unlock the power supply until both doors to the HV cabinet are locked, keys removed from AI access interlocks and the replaced into the KLC claw interlock.

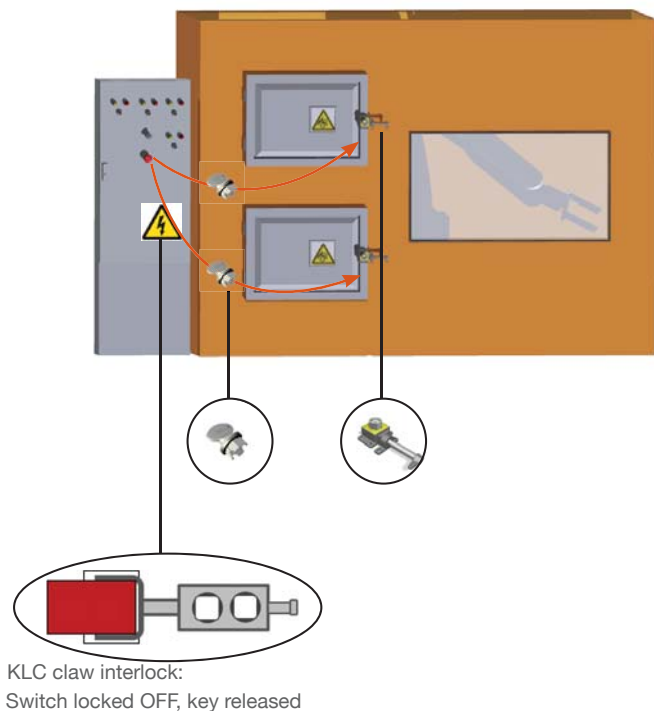

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

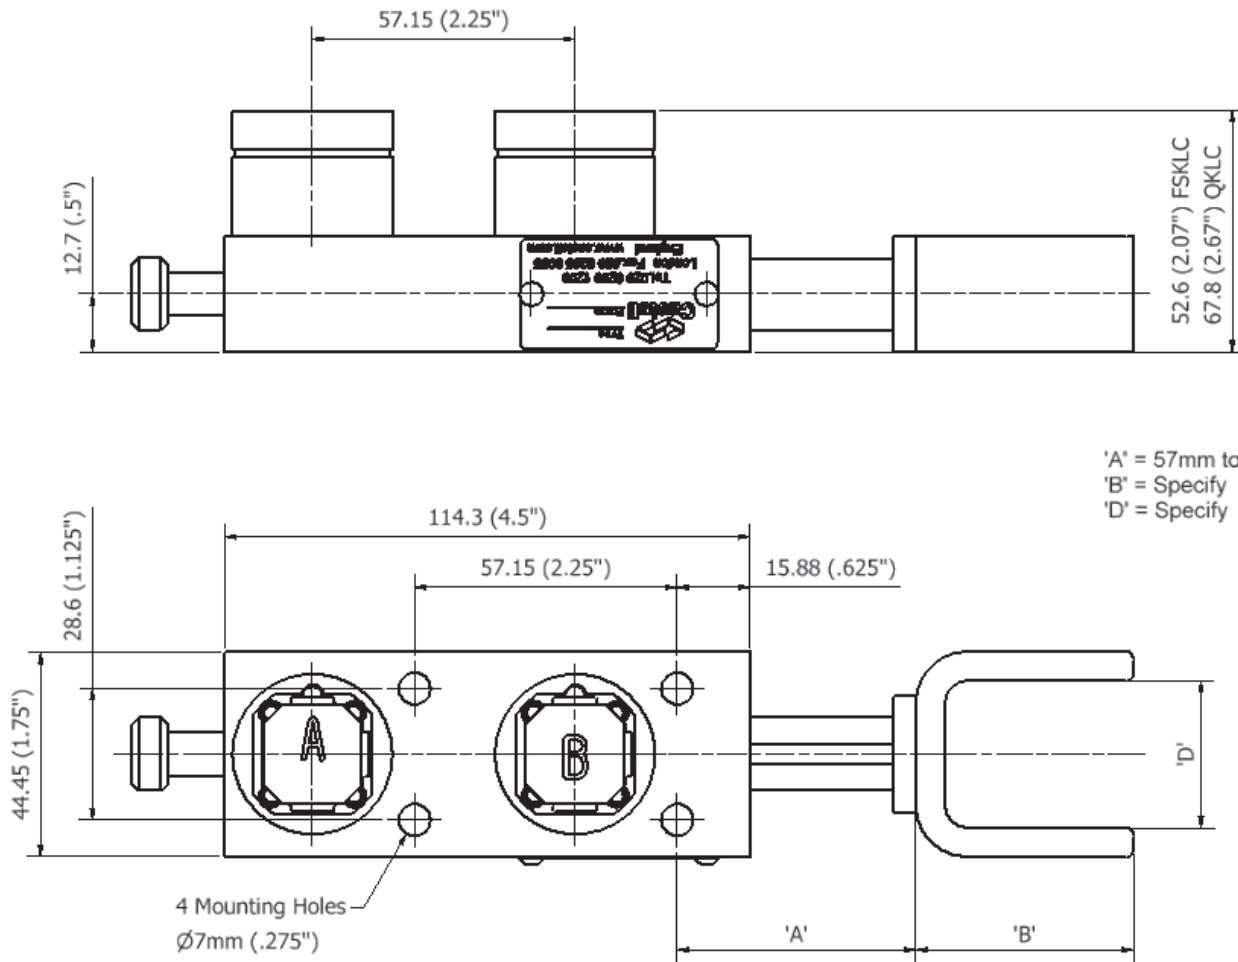

'A' = 57mm to 127mm
'B' = Specify
'D' = Specify

Order Information



Product Type	1	2	3
Part Number	KLC	-	-
Example	KLC	-	-
	FS	B	4
4	19.1mm		
5	60mm		
6	28.9mm		
7	A	Isolation Key Symbol (exchange key condition)	
	OR	Primary Key Symbol (double key condition)	
8	B	Personnel Key Symbol (exchange key condition)	
	OR	Secondary Key Symbol (double key condition)	

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Form	1 / 2 / 3 / 4 ⁽²⁾
4	A dimension (bolt travel)	please specify: from 57mm to 127mm
5	B dimension (see page 4 for claw details)	please specify
6	D dimension (see page 4 for claw details)	please specify
7	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition, located next to the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
8	Lock portion symbol: Personnel key (for exchange key condition) Secondary key (for double key condition - this key drives the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters
Q - Lock type Up to 6 characters



(2) **Form**



Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KLE-QB-6.4-4




The KLE double key sliding door interlock is a one piece access interlock comprising of a main body and sliding bolt. The lock is designed to suit sliding doors of various sizes and thicknesses. The interlock is manufactured in brass and comes with the brass F (Figure) or Q style lock portions and is ideal for use in dry, non-corrosive environments where the lock is subject to medium to heavy use. Typical industries using the KLE lock are automotive and steel production. The KLE door interlock is available in a double key or exchange key condition.

Operation

The Castell KLE sliding door interlock range is used in machine guarding applications control access to hazardous areas.

KLE bolt interlock, exchange key condition




- ① Key A is free, while key B is trapped and bolt is extended.
- ② Insert and turn key A and then retract the bolt. Turn and release key B.
- ③ Key B is free, key A is trapped and bolt is retracted.

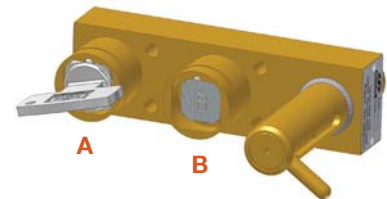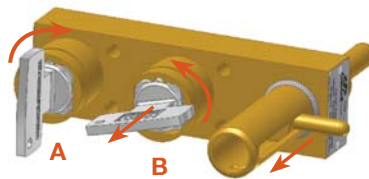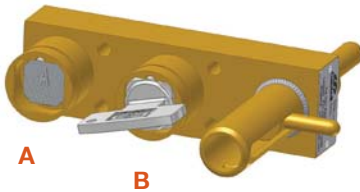

1. While the side bolt is extended and key B is trapped, key A is free. The door is locked closed.
2. Inserting and turning key A in the bolt interlock enables you to rotate key B, releasing the mechanism. This will trap key A into the lock. Key B can now be taken by the personnel to the machine area.
3. Key A stays trapped until the door is open and key B returned to the KLE sliding door interlock.

KLE bolt interlock, double key condition

- ① Key A and key B are free, bolt is extended.
- ② Insert and turn both keys and then retract the bolt.
- ③ Both keys are trapped, bolt is retracted.

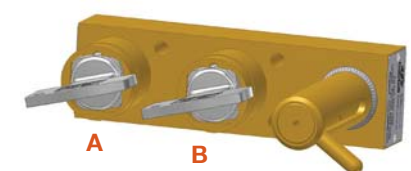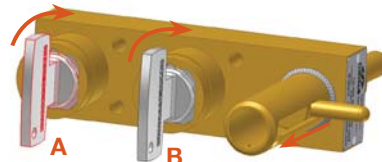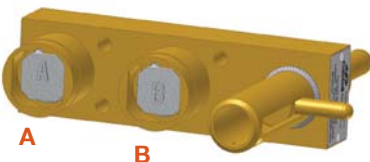

1. While the side bolt is extended, key A and B are free. The door is locked closed.
2. Inserting and turning the keys will allow the bolt to retract. The door can now be unlocked.
3. The keys stay trapped as long the door is opened and bolt is retracted.

The length of the bolt can be varied to suit the application but travel of the bolt is always 50,08 mm.

Usage

The KLE sliding door lock should be used to allow safe control of sliding doors.



The KLE lock is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KLE sliding door lock should normally be mounted to a panel using suitable fasteners (please refer to drawing on page 4 for more details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KLE sliding door lock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 19KN.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CKLE Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,7 kg
Material	Brass
MTTF Certification	Available on request


Application

The KLE bolt interlocks are used as a part of a safety system, typically in machine guarding applications.

The power supply to the system is switched on and the access door to the hazardous area is locked closed.

The removal of the isolation key in the KS20 unit, isolates the electrical supply to the LV Panel. The key is then used to unlock the KLE sliding door interlock on the sliding door. This will release the second key (key B), which can be taken by personnel into the machine area.

The power cannot be switched on until key B is returned to the access interlock, the door is closed, the bolt and key B are trapped in the KLE unit and key A returned to the KS20.

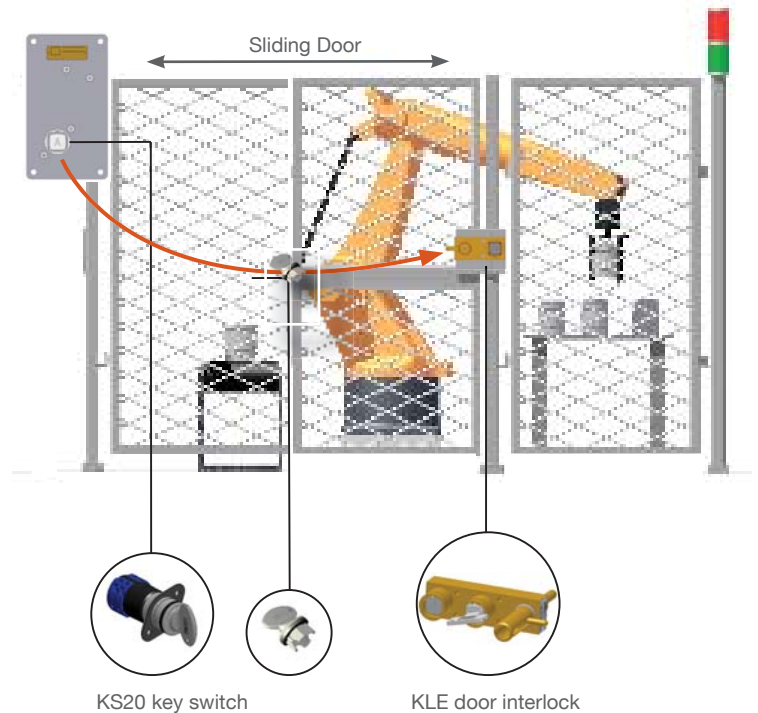

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

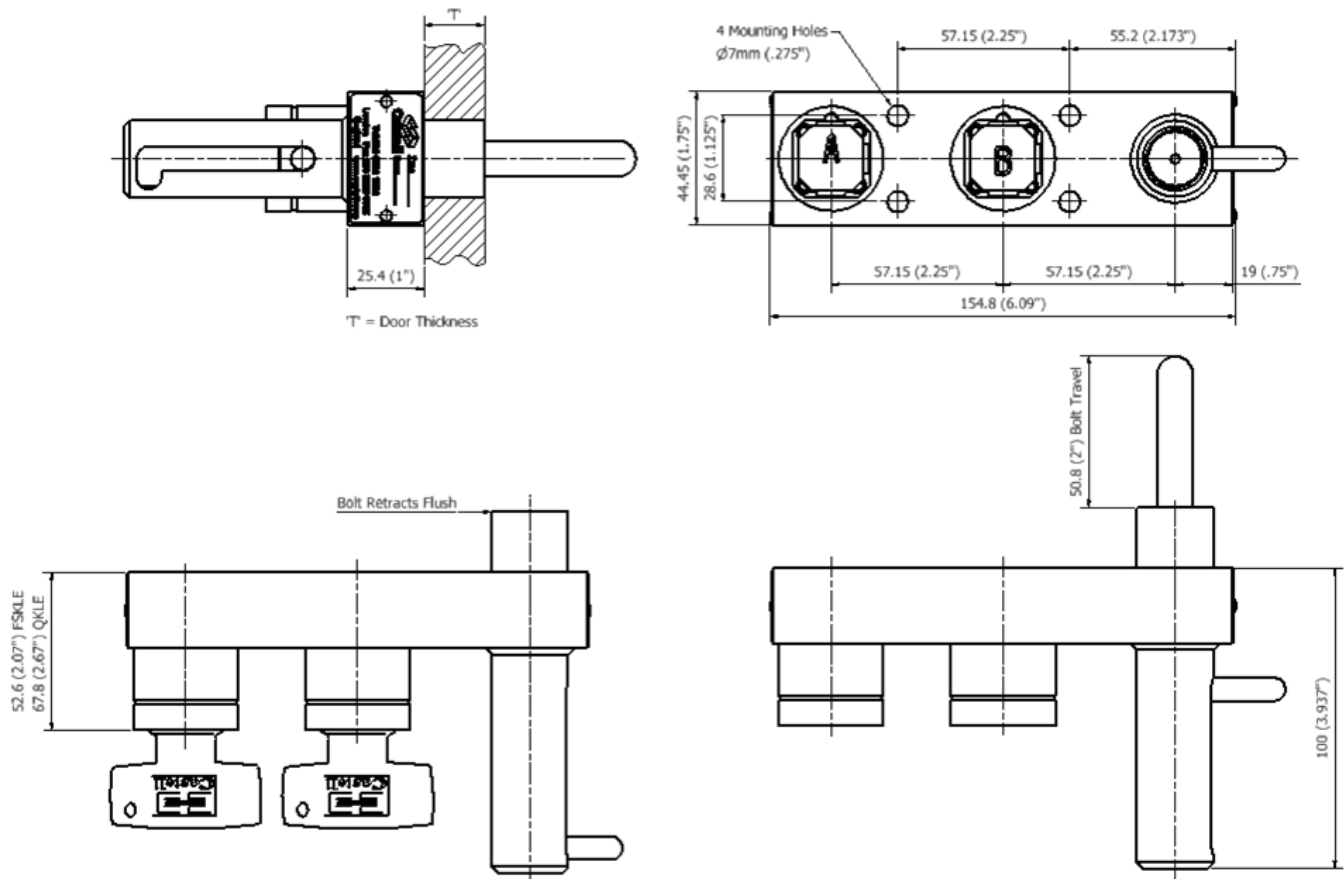

Order Information


	Product Type	1	2	3	4	5	6	
Part Number	KLE							
Example	KLE	FS	B	1	E	50,8	4	
	7	9mm						
8	<div> <div>A</div> <div>OR</div> <div></div> </div>		<div> <div>Isolation Key Symbol (exchange key condition)</div> <div>Primary Key Symbol (double key condition)</div> </div>		<div> <div>B</div> <div>OR</div> <div></div> </div>			<div> <div>Personnel Key Symbol (exchange key condition)</div> <div>Secondary Key Symbol (double key condition)</div> </div>

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
3	Number of secondary lock portions	1 (standard)
4	Key condition	E = Exchange key condition / D = Double key condition (simultaneous removal of all keys)
5	Bolt length	50,8 mm (standard)
6	Form	1 / 2 / 3 / 4 ⁽²⁾
7	Door thickness	please advise
8	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition, located next to the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
9	Lock portion symbol: Personnel key (for exchange key condition) Secondary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - lock type
Up to 3 symbols

Q - lock type
Up to 6 symbols

(2) Form

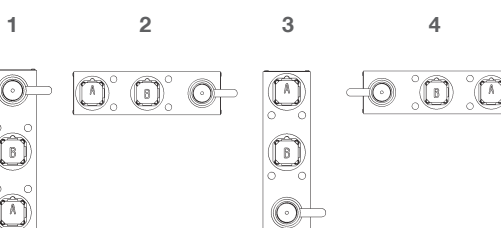

Contact Information

Special construction available upon enquiry

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

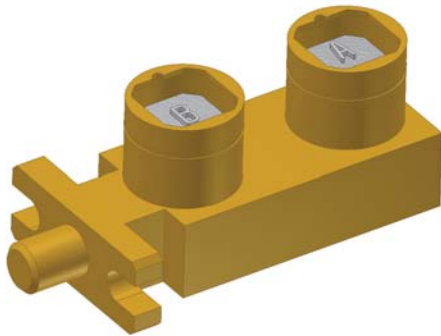

KLF-FSB-0-4-D


The KLF Lock is a multi-key operated mechanical bolt interlock for the control of electrical switchgear. The standard unit comes with a 16 mm diameter bolt of variable length, that is used to control the rotation or movement of operating handles or toggles of electrical switchgear. The KLF bolt interlock comes equipped with a flange to allow for different sorts of mounting. This lock is manufactured in brass or stainless steel making it ideal for use in harsh or corrosive environments. The KLF bolt interlock is available in a double key or exchange key condition.

Operation


The Castell KLF bolt interlock range is used on control of switchgear to inhibit movement of cams, toggles or levers.

KLF dual key bolt interlock, exchange key condition


- ① Key A is free, while key B is trapped and bolt is extended.

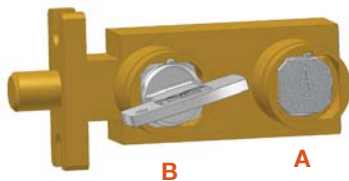

- ② Insert and turn key A, then turn key B to drive bolt, releasing key B.

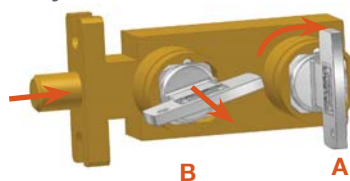


- ③ Key B is free, key A is trapped and bolt is retracted.

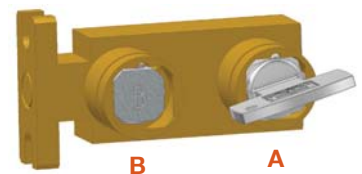


1. While the side bolt is extended and key B is trapped, key A is free. The disconnecter is locked by the extended bolt of the KLF.
2. Inserting and turning key A in the bolt interlock enables rotation of key B, releasing the mechanism. This will trap key A into the lock.
3. Key A stays trapped while the bolt is retracted and key B is released.

KLF dual key bolt interlock, double key condition


- ① Key A and key B are free, bolt is extended.

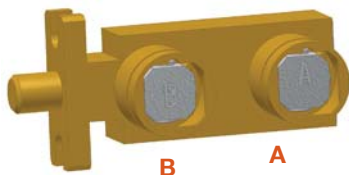

- ② Insert and turn both keys to drive bolt.

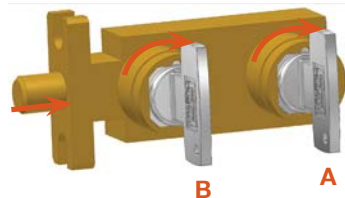

- ③ Keys are trapped, bolt is retracted.

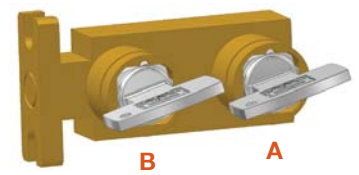

1. While the side bolt is extended, key A and key B are free. The disconnecter is locked.
2. By inserting and turning key A and key B in the bolt interlock, the bolt can be retracted, releasing the disconnecter. This will trap both keys into the lock.
3. Both keys stay trapped while the bolt is retracted.

The length of the bolt can be varied to suit the application but travel of the bolt is always 19,05 mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in bolt retracted position.

Usage

The KLF dual key bolt interlock should be used as a part of a safety system to allow safe control of disconnect switches.



The KLF bolt interlock is not designed for security purposes, such as a safe or external access to a building.
The KLF bolt interlock is not designed to interlock gates or doors. Please refer to the AIE access interlock.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KLF bolt interlock should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KLF bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of detected defects please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS-Type
	Maximum: 107°C [224,6°F] for Q-Type/140°C [284°F] for FS-Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	1,4 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

KLF dual key bolt interlocks are used as a part of a safety system. A typical application is where the electrical and pneumatic supplies to the machine are switched on and the access doors to the hazardous area are locked closed.

Key A and B are trapped in the KLF bolt interlock, preventing access to the machine area. To enter the area, the pneumatic supply must be turned off. Turning the keys in the KLF bolt interlock will extend its bolt. The released keys ensure the bolt remains in extended position locking off the disconnecter. The released keys can now be taken to the machine area to gain access via the AI access interlocks.

The disconnecter cannot be switched on until both access doors are locked closed and both keys replaced in the KLF bolt interlock.

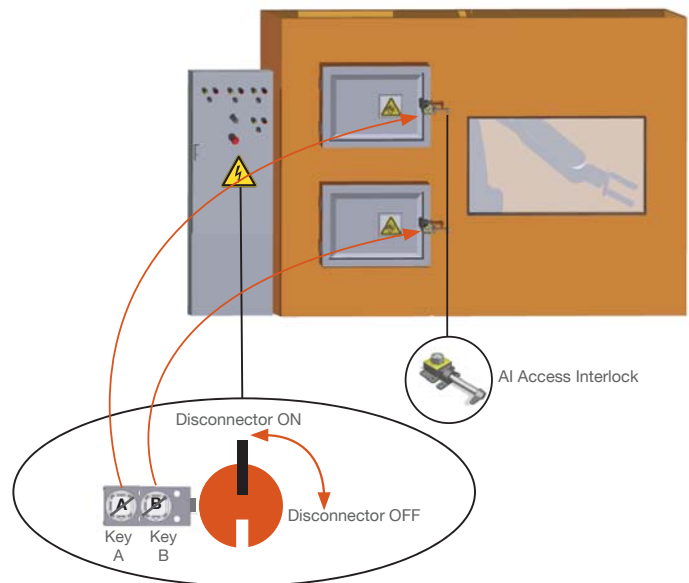

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

KLF, form 4

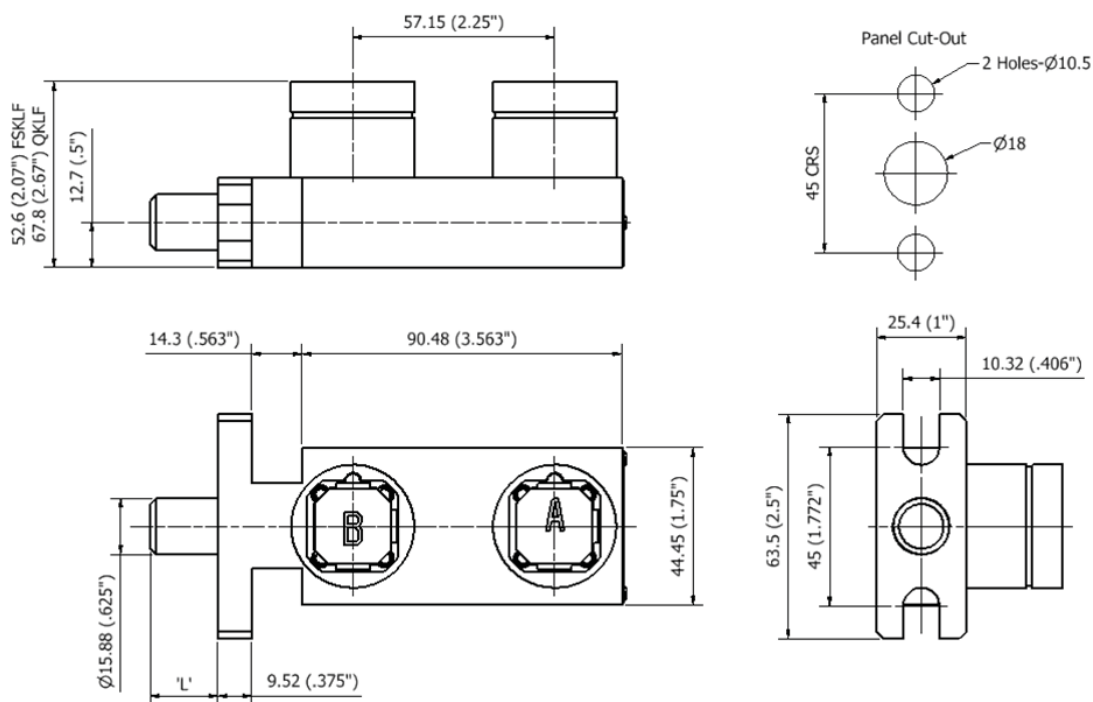

Mounting Holes:
M8 (Brass)
Ø8,35 (Stainless steel)
Ø10,3 (US - Brass/Stainless Steel)

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

Order Information

	Product Type	1	2	3	4	5	6
Part Number	KLF						
Example	KLF	FS	B	1S	6,4	1	D

7	A1	Isolation Key Symbol (exchange key condition)	8	B1	Personnel Key Symbol (exchange key condition)
	OR				
		Primary Key Symbol (double key condition)			

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Number of lock portions	1S = 1 secondary key (2 locks) 2S = 2 secondary keys (3 locks) 3S = 3 secondary keys (4 locks)
4	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
5	Form	1 / 2 / 3 / 4 ⁽²⁾
6	Key Condition	D = double key condition / E = exchange key condition (see operation details, page 1)
7	Lock portion symbol: Isolation key (for exchange key condition) or Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
8	Lock portion symbol: Personnel key(s) (for exchange key condition) or Secondary key(s) (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters


(1) FS - Lock type
Up to 3 symbols



Q - Lock type
Up to 6 symbols



(2) Form

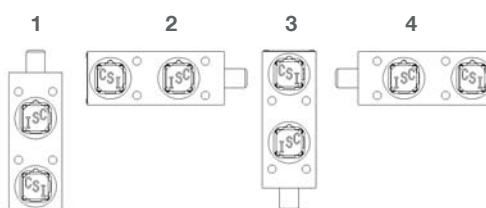

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KLP2-FSB-1S-0-FR-4-D




The KLP bolt interlock is a key operated mechanical bolt interlock complete with position monitoring electrical contacts for the control of electrical switchgear or valves. The KLP lock comes with a 16 mm diameter bolt of variable length, that is used to control the rotation or movement of operating handles or toggles. The KLP1 comes with 2N/C 1N/O 10 amp contacts and the KLP2 has 4N/C 2N/O 10 amp contacts, these are used to provide remote indication of the bolt position or to switch the control circuitry on the machine. The locks are manufactured in brass or stainless steel making them ideally suited to use in harsh or corrosive environments.

Operation

The Castell KLP bolt interlocks with safety switches are used in switchgear control to break circuitry and inhibit movement of cams, toggles or levers simultaneously.

KLP multi key bolt interlock with safety switch, rear entry, exchange key condition

- ① Key A is free, while key B is trapped and bolt is retracted.
- ② Insert and turn key A to extend the bolt. Release key B to trap key and change the contacts condition of the switch.
- ③ Key B is free, key A is trapped and bolt is extended. Switch contacts are reversed.

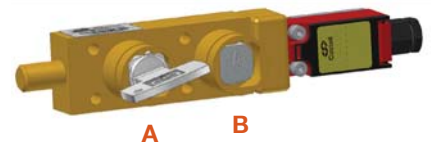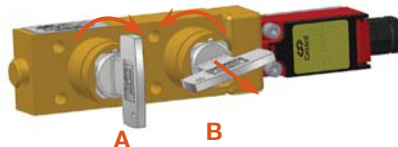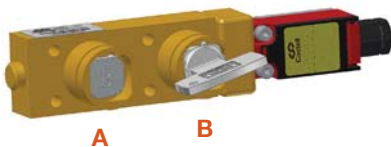


1. While the side bolt is retracted, key B is trapped and key A is free.
2. Inserting and turning key A in the KLP bolt interlock drives the bolt to extended position and allows to turn and release key B. This changes the contacts condition in the KLP switch. The extended bolt locks the power disconnector in the OFF position. Key B can now be taken by personnel into machine area.
3. With key B released and key A trapped in the KLP, the bolt stays extended, ensuring the disconnector is in the safe condition.

Operation

KLP multi key bolt interlock with safety switch, rear entry, double key condition

- ① Key A and B are trapped, while the bolt is retracted.
- ② Turn and release both keys, to drive the bolt and change switch condition.
- ③ Both keys are free and bolt is extended. Switch contacts are reversed.

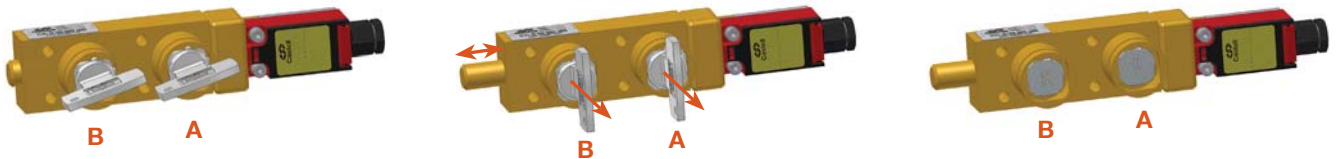

1. While the side bolt is retracted and key B is trapped, key A is free.
2. Turning and releasing key A in the KLP bolt interlock changes the contacts condition in the KLP switch and enables the rotation of key B to drive the bolt. The extended bolt locks the power disconnecter in the OFF position. Both keys can now be taken by the personnel to the machine area.
3. With both keys released, the bolt stays extended, ensuring the disconnecter is in the safe condition until both keys are inserted and turned KLP bolt interlock.

Usage

The KLP multi key bolt interlock with safety switch should be used to allow safe control of valves or disconnect switches.



The KLP multi key bolt interlock is not designed for security purposes, such as a safe or external access to a building.

Installation

The housing of the KLP bolt interlock can be mounted either to a panel or on a surface using suitable fasteners. Please refer to drawing on page 4 for more details



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KLP bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	-25°C ice free to +55°C
Type of mounting	panel or surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	KP1: Front of board mount = 0,8 kg / back on board mount = 0,6 kg KP2: Front of board mount = 0,8 kg / back of board mount = 1 kg
Material	Brass/Stainless steel
Switch approvals	CE, CCC, cCSAus, IP65
MTTF Certification	Available on request

Application

Castell KLP bolt interlocks with safety switches are used as a part of a safety system, typically in switchgear applications.

The electrical supply of the machine is on, and the protective doors to the hazardous area are locked. Both keys are trapped in the KLP unit. Before entering the machine area the disconnecter lever needs to be rotated to isolate the power to the machine. To lock the disconnecter lever in the safe position both keys in the KLP bolt interlock need to be released. This extends the bolt of the KLP, locks it in the extended position and changes the contacts in the KLP switch. This is connected to a traffic light or another display, indicating the access to machine area can be gained.

The removed keys are taken to the AI access interlocks to open the doors. The power supply cannot be switched back on while the keys are trapped in the access interlocks.

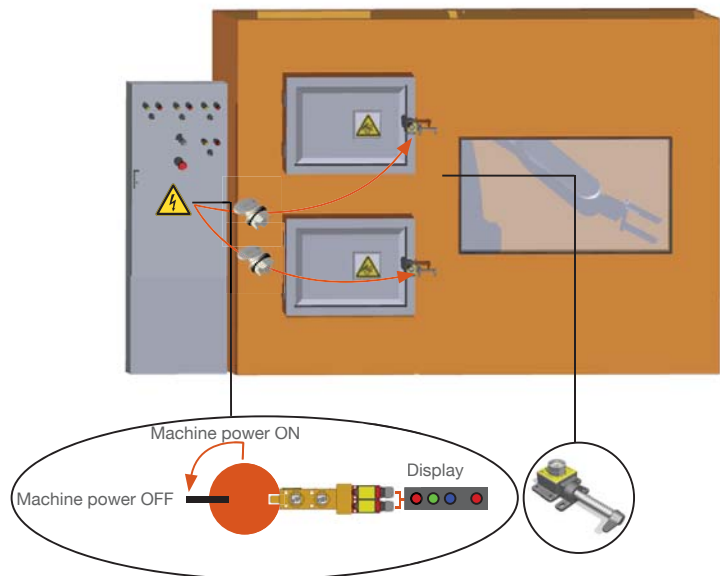

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KLP2, REAR MOUNTED SWITCH

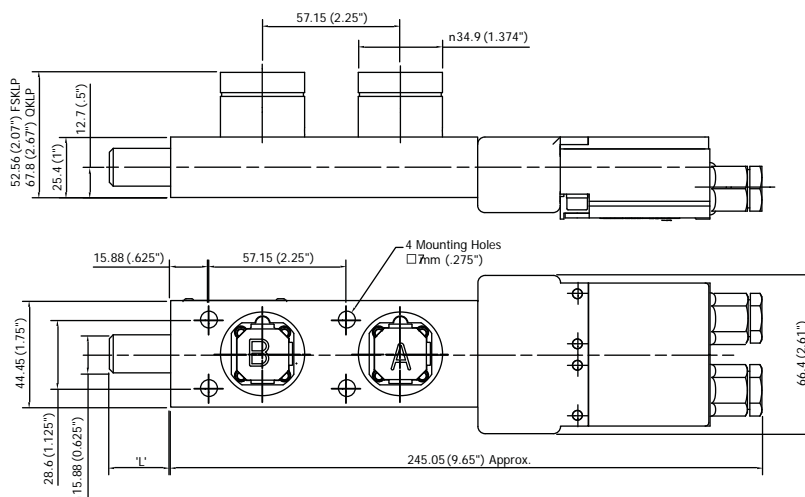


KLP1, FRONT MOUNTED SWITCH

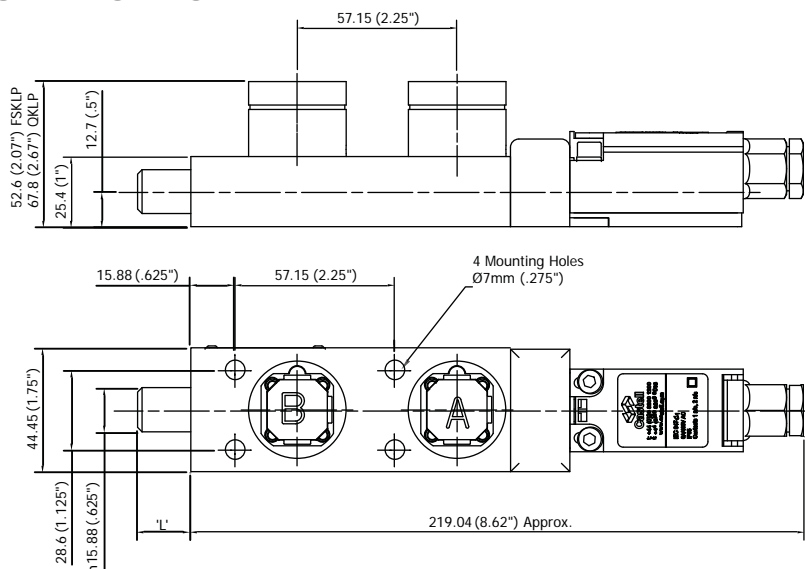

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

Wiring Diagram

Bolt retracted - switch on: 2 N/C - 1 N/O

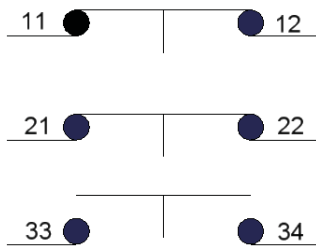

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	KLP								
Example	KLP	2	FS	B	1S	0	FR	4	D


7	A	Isolation Key Symbol (exchange key condition)	OR		Primary Key Symbol (double key condition)
8	B	Personnel Key Symbol (exchange key condition)	OR		Secondary Key Symbol (double key condition)

1	Switch specification	1 = 2NC/1NO (1 switch) ⁽²⁾ 2 = 4NC/2NO (2 switches) ⁽²⁾
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Secondary lock portion(s) Secondary lock portions are provided for personnel keys, primary lock portion for the isolation key	1S / 2S / 3S / 4S / 5S or 6S = 1 / 2 / 3 / 4 / 5 or 6 secondary lock portions respectively
6	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
6	Switch entry	FR = Front entry switch / RE = Rear entry switch ⁽³⁾
7	Form	1 / 2 / 3 / 4 ⁽⁴⁾
8	Key condition	E = Exchange key condition / D = Double key condition (removal of all keys)
7	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition, located next to the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
8	Lock portion symbol: Personnel key (for exchange key condition) Secondary key (for double key condition - this key drives the bolt)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters


(1) FS - Lock type Up to 3 characters Q - Lock type Up to 6 characters




(2) Switch specification



(3) Switch entry

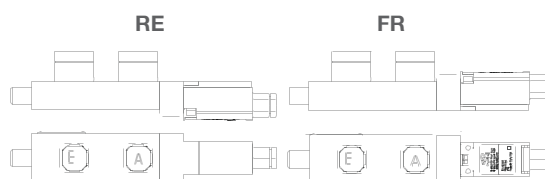

(4) Form

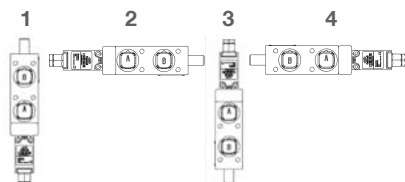

Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

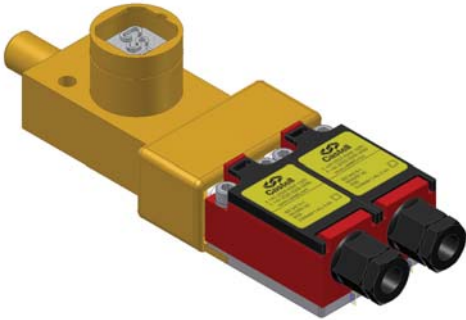

KP2-FSB-6.4-FR-4

The KP bolt interlock is a key operated mechanical bolt interlock complete with position monitoring electrical contacts for the control of electrical switchgear or valves. The KP lock comes with a 16 mm diameter bolt of variable length, that is used to control the rotation or movement of operating handles or toggles. The KP1 comes with 2N/C 1N/O 10 amp contacts and the KP2 has 4N/C 2N/O 10 amp contacts, these are used to provide remote indication of the bolt position or to switch the control circuitry on the machine. The locks are manufactured in brass or stainless steel making them ideally suited to use in harsh or corrosive environments.

Operation

The Castell KP bolt interlocks with safety switches are used in switchgear control to break circuitry and inhibit movement of cams, toggles or levers simultaneously.

KP bolt interlock with safety switch, rear entry, form 4

- ① Key is trapped, bolt is retracted.
- ② Turn and release key to drive the bolt and change the switch contacts condition.
- ③ Key is free, bolt is extended, switch contacts are reversed.



1. While the power is on, the key is trapped the side bolt is retracted. The KP switch contacts are opened.
2. Turning the key drives the bolt to extended position, e.g. locking off the movement of a disconnecter. Turning the key also changes the contacts in the KP switch, which is connected to a traffic light or other display. The display then indicates that the access can be gained in the machine area. The released key can now be taken to open the door lock to the machine area.
3. The power disconnecter cannot be unlocked until the key is replaced and turned in the KP bolt interlock.

The KP bolt interlock is available as a KP1 or KP2 version with either one or two safety switches respectively. The KP bolt interlock is available with as rear or front entry mounted switch (panel or surface mount respectively).

The length of the bolt is available in various lengths to suit the application, but the travel of the bolt is always 19,05 mm. The key is trapped when the bolt is extended. Rotation of the key anti clockwise will retract the bolt and change contacts in the switch.

Usage

The KP bolt interlock with safety switch should be used to allow safe control of valves or disconnect switches.



The KP bolt interlock is not designed for security purposes, such as a safe or external access to a building.

Installation

The housing of the KP Bolt Interlock can be mounted either to a panel or on a surface using suitable fasteners. Please refer to drawing on page 4 for more details



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KP bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	-25°C ice free to +55 °C
Type of mounting	panel or surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	KP1: Front of board mount = 0,8 kg / back on board mount = 0,6 kg KP2: Front of board mount = 0,8 kg / back of board mount = 1 kg
Material	Brass/Stainless steel
Power isolation	10 amp
Switch approvals	CE, CCC, cCSAus, IP65
MTTF Certification	Available on request

Application

Castell KP bolt interlocks with safety switches are used as a part of a safety system, typically in switchgear applications.

The electrical supply of the machine is on, and the protective door to the hazardous area is locked. The key is trapped in the KP bolt interlock. Before entering the machine area the disconnecter lever needs to be rotated to isolate the machine. To lock the disconnecter lever in the safe position the key in the KP bolt interlock needs to be turned extending the bolt of the KP. Removing the key traps the bolt in the extended position. The operation of the KP also changes the contacts in the KP switch. This is connected to a traffic light or another display, indicating the access to machine area can be gained.

The removed key is taken to the AI access interlock to open the door. The power supply cannot be switched back on while the key is trapped in the access interlock.

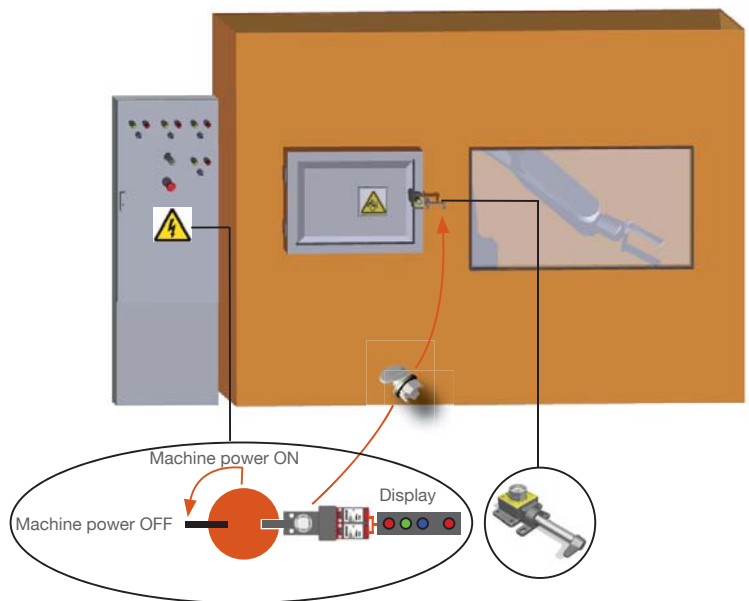

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KP1, FRONT MOUNTED SWITCH

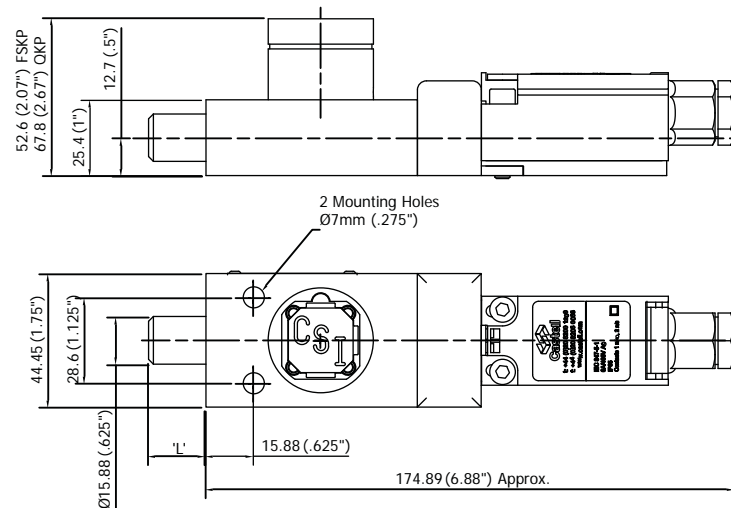

KP2, REAR MOUNTED SWITCH

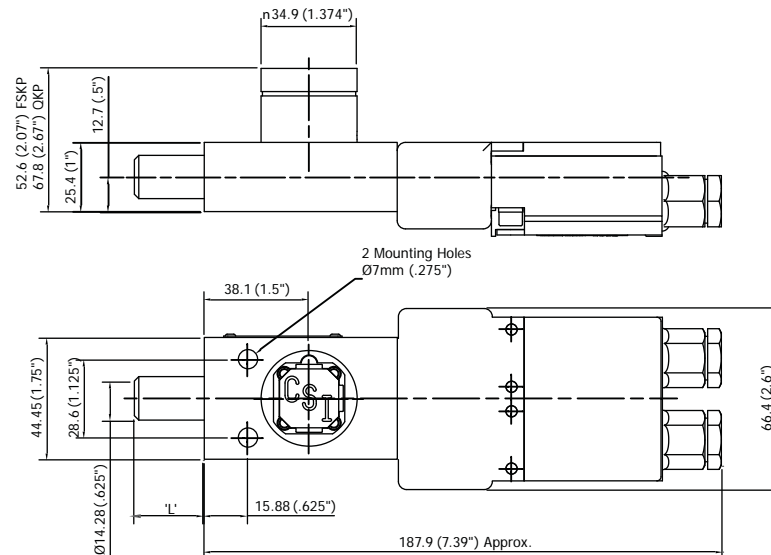

L Dimension Retracted bolt length (in mm)	Extended bolt length (in mm)
0	19,05
6,35	25,40
12,70	31,75
19,05	38,10
25,40	44,45

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Order Information


	Product Type	1	2	3	4	5	6
Part Number	KP						
Example	KP	2	FS	B	6.4	FR	4
	7	ABC					

1	Switch specification (number of switches)	1 = 2NC/1NO ⁽²⁾ 2 = 4NC/2NO ⁽²⁾
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	L Dimension (bolt length when retracted) in mm	0 / 6,4 / 12,7 / 19,1 / 25,4
5	Switch entry	FR = Front entry switch / RE = Rear entry switch ⁽³⁾
6	Form	1 / 2 / 3 / 4 ⁽⁴⁾
7	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters


(1) FS - Lock type Up to 3 characters
Q - Lock type Up to 6 characters




(2) Switch specification



(3) Switch entry

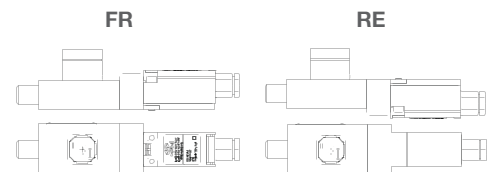


(4) Form

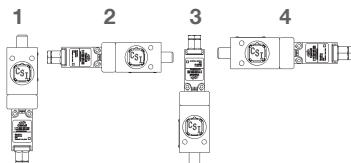

Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KS20-FSS-P-C/O4

The KS is a key driven electrical switch designed for machine control circuits. This type of isolator should be used for short term, off load isolation. The KS is manufactured from either brass or stainless steel making it ideal for use in normal and harsh corrosive environments where the lock is subject to heavy use. The unit is able to be mounted into an existing panel or for surface mounting within its own polycarbonate IP65 rated enclosure.

Operation

The Castell KS powersafe electrical key switch is used for machine isolation in order to protect the hazardous area from access while power is on.

KS20 powersafe electrical switch, back on panel mount

① Key is trapped, while power is on.



② Turn and remove key to switch the power off by changing the contacts arrangement.



③ Key is free, power is off.



1. While the power is on and a machine is running, the key is trapped in the KS key switch.
2. By turning and removing the key out of the switch, the contacts condition in the KS changes, switching the power off.
3. The key now can be taken to open the door lock and gain access to the machine area.

The KS is available for different switching loads as KS20, KS32 or KS63 (20, 32 or 63 amps power isolation respectively). Please refer to drawing on page 6 for more details.

The KS comes with 4 contacts as standard with contacts arrangements as 2NO/2NC, 4NC, but auxiliary set of contacts are available on request.

The KS is available as a back of panel mount version or as a front of panel mount with an enclosure. Please refer to drawing on page 6 for more details.

Usage

The KS powersafe electrical key switch is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KS key switch is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

Front of panel units should be mounted to a flat surface using 4 off suitable fixing screws. Offer up back box of enclosure in desired position and use mounting holes as a drilling template.

Back of panel units should be mounted to a flat surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch (via the cable gland for front of panel) in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (see drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KS range of switches must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.

Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions. Please see Contact section for contact details.

Technical Data


Temperature rating	-25 °C ice free to 55 °C
Type of mounting	Surface or panel mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	KS20: Front of board mount = 0,8 kg / back on board mount = 0,6 kg
	KS32: Front of board mount = 0,8 kg / back of board mount = 1 kg
	KS63: 1,5 kg
Material	Brass/Stainless steel
Enclosure	Polycarbonate IP65
Power isolation	20A, 32A, and 63A options available
Motor Isolation (AC Values)	KS20: AC-23A 7.5kW or AC-3 5.5kW
	KS32: AC-23A 15kW or AC-3 11kW
	KS63: AC-23A 30kW or AC-3 18.5kW
Switch approvals	CE, CCC
MTTF Certification	Available on request

Application

A typical application of KS powersafe electrical switch is machine guarding. It is usually used in combination with an access interlock such as the Salus for part body access or an access interlock with an exchange key for full body access control such as AIE.

The KS breaks the machine safety circuit, ensuring a machine is shut down when the key is turned and removed. The key can then be taken to the Salus automatic access interlock to enable access to the machine.

The machine cannot be restarted until the door is closed, the bolt is trapped in the access interlock and the key is removed and taken to the KS key switch.

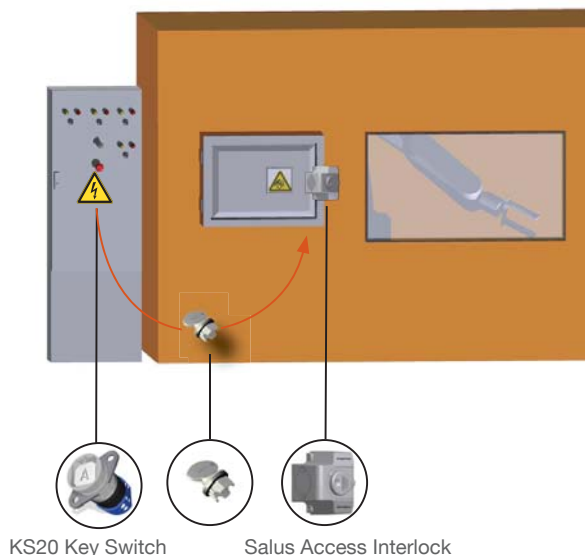

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KS20, FOB (Front of board, enclosure)

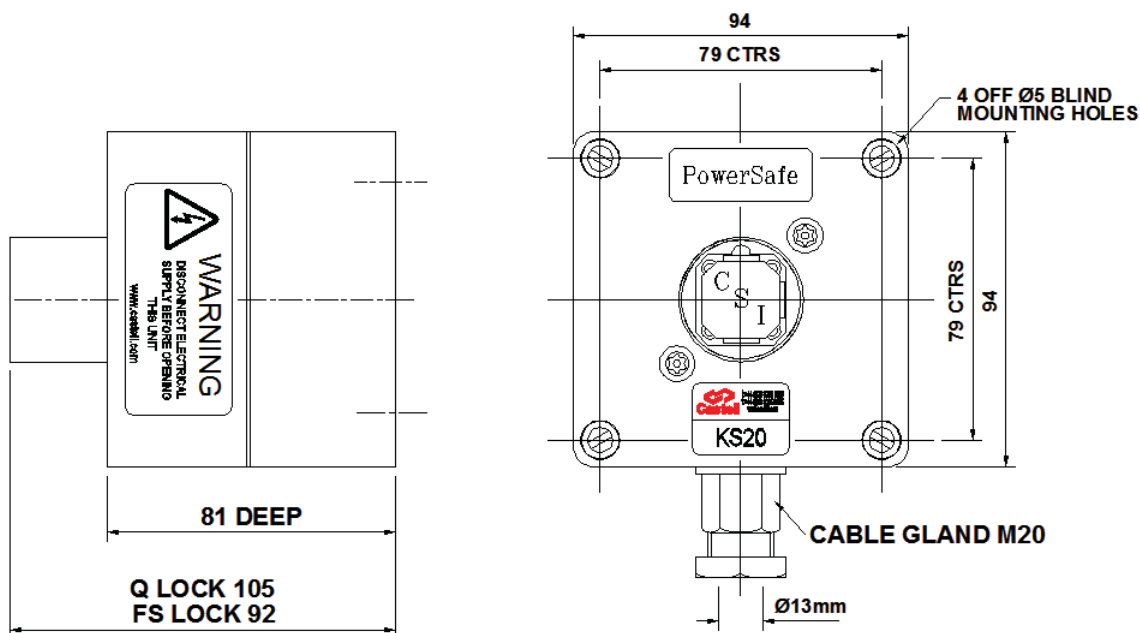


KS20, BOB (Back of board)

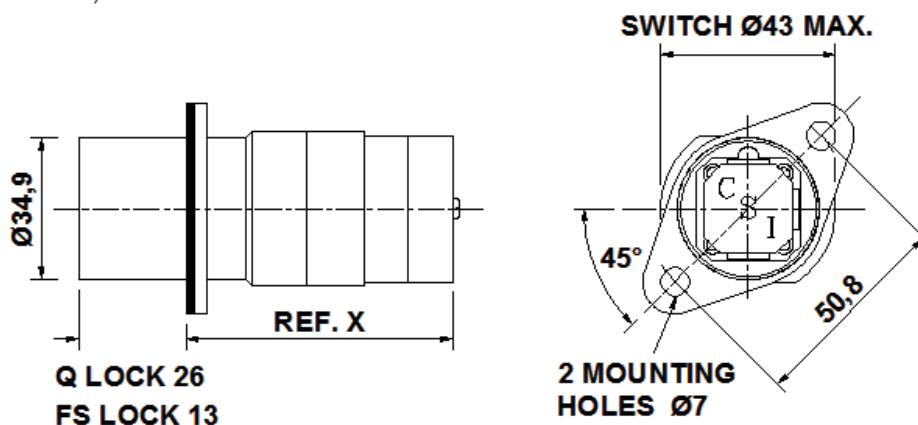

DIMENSION REFERENCE 'X'	
No. OF POLES	LENGTH
4 POLES	66,6mm
6 POLES	76,1mm
8 POLES	85,6mm
10 POLES	95,1mm
12 POLES	104,6mm


Wiring Diagram

Key Free, Switch off

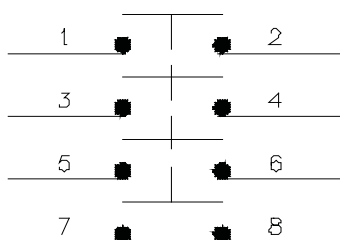

KEY FREE – SWITCH OFF

Key Free, 2 NO/2NC

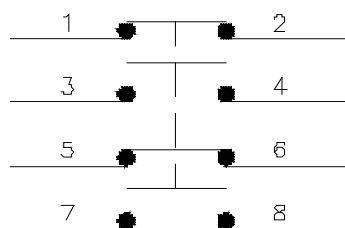

KEY FREE – 2 N/O & 2 N/C

Order Information

	Product Type	1	2	3	4	5	6
Part Number	KS						
Example	KS	20	FS	B	P	C/O	4
	7	ABC					


1	Isolation	20 amps 32 amps 63 amps
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Mounting	P = Panel mount (back of board) F = Front of board mount, with enclosure
5	Contacts arrangement in normal position	C/O = NO/NC arrangement (contacts closed/opened) CC = NC arrangement (all contacts closed)
6	Contacts number	4 (standard)
7	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Up to 3 characters Q - Lock type Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

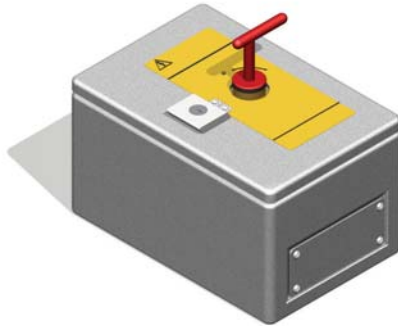

KSD32-FSS-F-CC4-C/O2

The KSD is a key driven switch disconnecter for the isolation of currents. The standard KSD comes with 6 poles plus 2 auxiliary early break contacts. The KSD is manufactured from either brass or stainless steel making it suitable for use in standard or harsh corrosive environments. The unit is supplied suitable for mounting into an existing panel or for surface mounting within its own IP65 rated lockable mild steel enclosure.

Operation

The Castell KSD Switch Disconenctor is typically used for machine isolation applications in order to protect the hazardous area from access while power is on.

KSD Switch Disconnecter

① Key is trapped, power is on.



② To switch power off turn and release the key.



③ Key is released, power is off.



1. While the power is on and a machine is running, the key is trapped in the KSD Switch Disconnecter.
2. To switch the power off turn and release the key from the KSD unit. This will alter the condition of the contacts within the switch, from closed to open.
3. The power is off until the is replaced in the KSD Switch Disconnecter.

The KSD is available for different switching loads as KSD32, KSD63, KSD125, KSD160, KSD250 or KSD315 (32, 63, 125, 160, 250 or 315 amps power isolation respectively. Please refer to page 6 for more ordering details.

Usage

The KSD Switch Disconnecter is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KSD Switch Disconnecter is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The KSD unit should be mounted to a surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSD range of Switch Disconnectores must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature Rating	Minimum: -5°C [23°F]
	Maximum: 55°C [131°F]
Type of mounting	3/8" or M10
Weight	KS32 = 4,5kg KS63 = 4,5kg KS125 = TBA KS160 = TBA KS250 = TBA KS315 = TBA
Material	Brass or Stainless steel, IP65 steel enclosure
Power isolation	32A, 63A, 125A, 160A, 250A and 315A options available
Motor Isolation (AC Values) / Switch polarity	32A: AC-23 at 400V = 15kW / available in 3P, 4P or 6P
	63A: AC-23 at 400V = 30kW / available in 3P, 4P or 6P
	125A: AC-23 at 400V = 55kW / available in 3P or 4P
	160A: AC-23 at 400V = 75kW / available in 3P or 4P
MTTF Certification	Available on request


Application

The KSD is designed to operate as part of an integrated safety system, controlling access to hazardous areas.

Typical machinery using the KSD range are motor driven, high risk applications where complete isolation of the power supply is required before access is granted.

The removal of the key in the KSD changes the condition of the electrical supply to the machine to a safe condition. This key can be removed and used to unlock the door via AIE Access Interlock.

The guard can only be opened when the electrical supply has been switched into a safe condition. The machine cannot be restarted until the door is closed and the key is removed and taken to the KSD Switch Disconnecter.

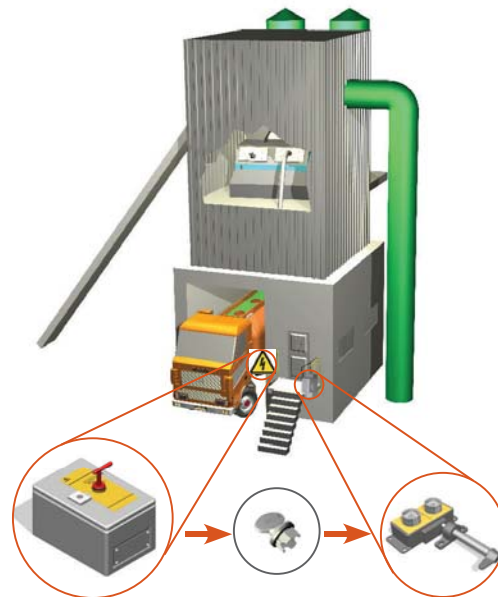

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

KSD - surface mount

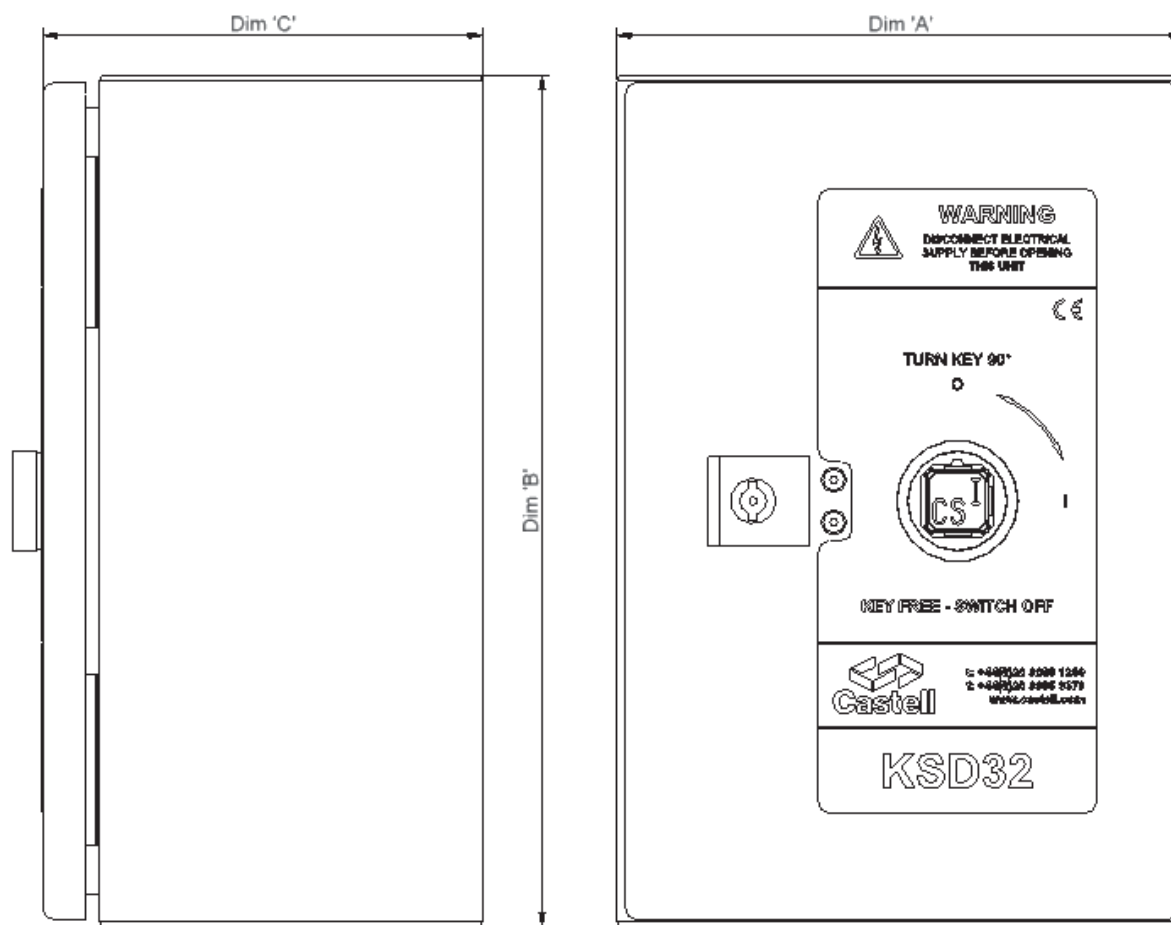


KSD Enclosure Dimensions


Dim	KSD32	KSD63	KSD125	KSD160	KSD250	KSD315
A	200mm	200mm	300mm	300mm	380mm	380mm
B	300mm	300mm	400mm	400mm	600mm	600mm
C	155mm	155mm	210mm	210mm	210mm	210mm

Wiring Diagram


Note: For safe mounting, use security screws




3 Pole 2N/O AUX




3 Pole 1N/O 1N/C AUX



4 Pole 1N/O AUX

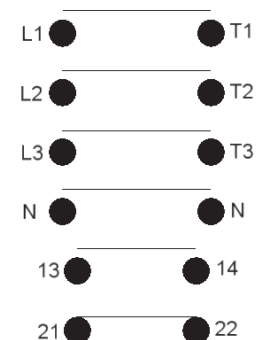

4 Pole 1N/O 1N/C AUX

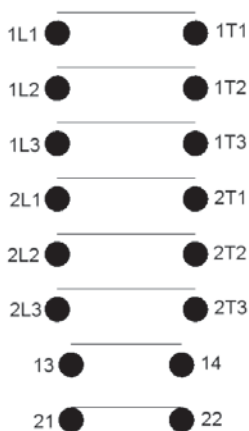

6 Pole 1N/O 1N/C AUX

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	KSD								
Example	KSD	32	FS	S	F	CC	4	C/O	2
		9							
	ABC								


1	Isolation	20 amps (UL:20A/CSA:16A) / 32 amps (UL&CSA:30A) 63 amps (UL&CSA:65A)
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Mounting	P = Panel mount (back of board)/ F = Front of board mount, with enclosure
5	Contacts arrangement in normal position	CO = no/nc arrangement (contacts closed/opened)/ CC = nc arrangement (all contacts closed)
6	Number of contacts	4 = standard contacts number
7	Contacts arrangement in normal position	*see item 5
8	Number of contacts	2 = standard contacts number
9	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KSE20-FSS-2S-F-E-C/O4

The KSE is a multi-key controlled electrical switch suitable for the isolation or switching of 20, 32, 63 or 150 amp (maximum) current. This type of isolator should be used for short term, off load isolation and operated by suitably qualified personnel. The unit is supplied for mounting into an existing panel or for surface mounting within its own IP65 rated lockable steel enclosure. It is available in FS or Q type lock portions. The KSE is manufactured from either brass or stainless steel making it ideal for use in standard or harsh corrosive environments.

Operation

Castell dual key access interlocks are used in various applications to control full body access to hazardous areas.

KSE multi key powersafe electrical switch, exchange key condition

- ① Power is on, isolation key is free and personnel keys are trapped
- ② Insert and turn isolation key to switch power off and release personnel keys
- ③ Power is off, isolation key is trapped and personnel keys are free



1. While the isolation key is free, the power is on. The personnel keys are trapped.
2. By inserting and turning the isolation key in the KSE unit, the contact condition changes switching the power off. The personnel keys can now be released and taken by the personnel to unlock the door in the machine area.
3. The isolation key stays trapped ensuring power is off as long as the personnel keys are free.

KSE multi key powersafe electrical switch, double key condition

- ① Power is on, all keys are trapped
- ② Turn and release all keys to switch power off
- ③ Power is off, all keys are free



1. While the power is on, all keys are trapped.
2. By turning the keys, the contact condition changes switching the power off. The keys can now be released and taken by the personnel to unlock the doors in the machine area.
3. The power is off until all keys are replaced in the powersafe electrical switch.

Usage

The KSE powersafe electrical switch is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KSE powersafe electrical switch is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

Back of panel units should be mounted to a flat surface. Panel and surface mount using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 4 for installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSE range of solenoid controlled switches must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.


Technical Data

Temperature rating	-25°C ice free to 55°C
Type of mounting	1/4" or M6
Weight	KS20: Front of board mount = 0,8 kg / back of board mount = 0,6 kg
	KS32: Front of board mount = 0,8 kg / back of board mount = 1 kg
	KS63: 1,5 kg
Material	Brass/Stainless steel
Enclosure	Polycarbonate IP65
Power isolation	20A, 32A, and 63A options available
Motor Isolation (AC Values)	KS20: AC-23A 7.5kW or AC-3 5.5kW
	KS32: AC-23A 15kW or AC-3 11kW
	KS63: AC-23A 30kW or AC-3 18.5kW
Switch approvals	CE or CCC
MTTF Certification	Available on request

Application

A typical application of KSE powersafe electrical switch is machine guarding. It is usually used in combination with an access interlock such as the Salus for part body access or an access interlock with an exchange key for full body access control.

A typical system will isolate machinery and control access to hazardous areas. Inserting the power isolation key in the KSE unit changes the condition of the electrical supply to the machine to a safe condition and enables the release of the personnel keys. These keys are then used to unlock the AIE double key access interlocks. The guards can only be opened when the electrical supply has been switched into a safe condition and only once all the keys have been returned to the KSE interlock can the machine be restarted.

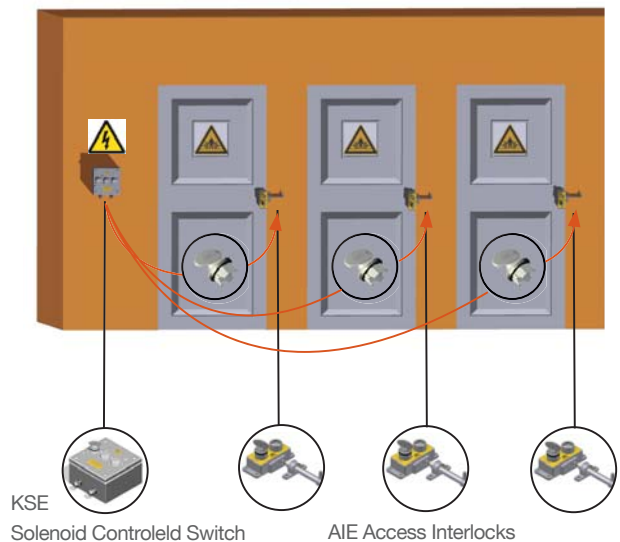

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director





Drawing



Dimensions:
in mm

Note: For safe mounting, use security screws

KSE, panel mount (3 lock portions)

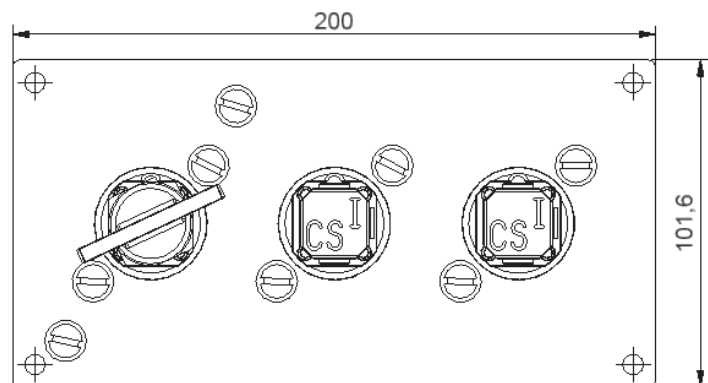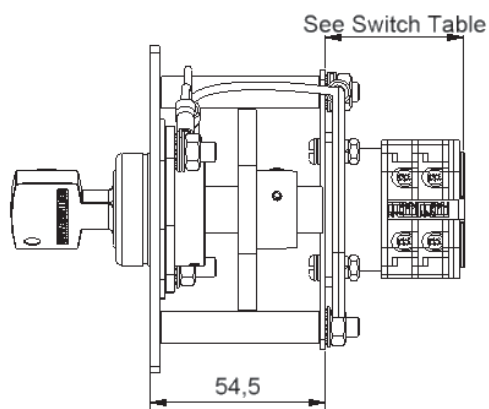

KSE, surface mount (3 lock portions)

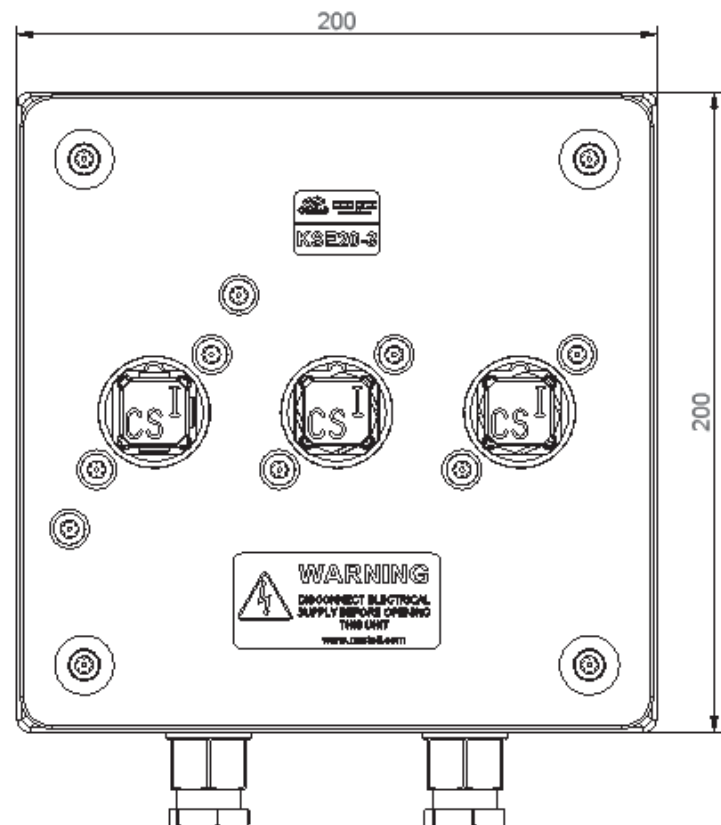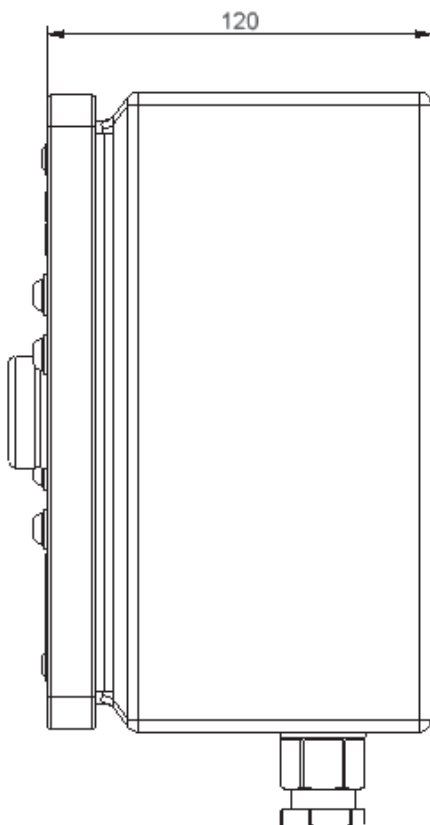


Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KSE, 2 lock portions

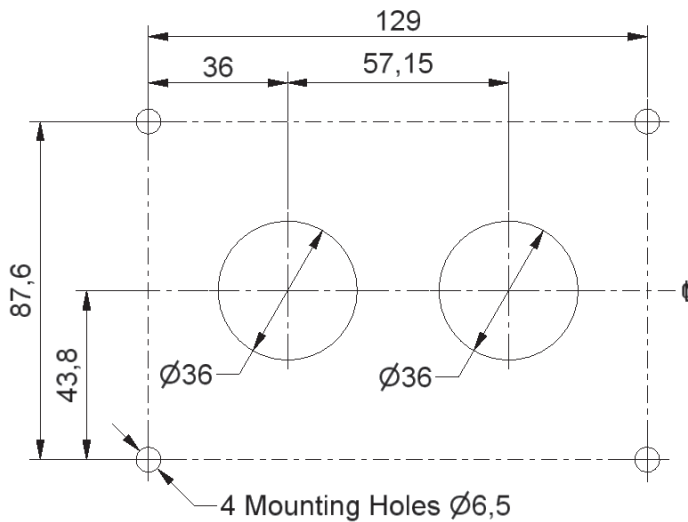


KSE, 3 lock portions

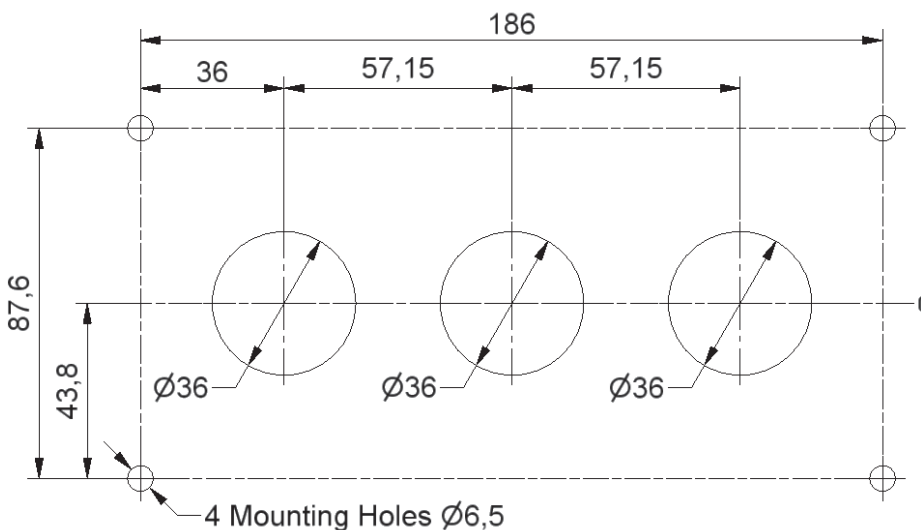


Wiring Diagram

Key Free, Switch off



Key Free, 2 NO/2NC



Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	KSE								
Example	KSE	20	FS	B	1S	P	D	C/O	4

9	A1	Isolation Key Symbol (exchange key condition)	10	B1	Personnel Key Symbol (exchange key condition)
	OR			OR	
		Primary Key Symbol (double key condition)			Secondary Key Symbol (double key condition)

1	Isolation	20 amps (standard)
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Secondary lock portion(s) Secondary lock portions are provided for personnel keys, primary lock portion for the isolation key	1S / 2S / 3S / 4S / 5S or 6S = 1 / 2 / 3 / 4 / 5 or 6 secondary lock portions respectively
5	Mounting	P = Panel mount (back of board) / F = Front of board mount, with enclosure
5	Key condition	E = Exchange key condition / D = Double key condition (simultaneous removal of all keys)
7	Contacts arrangement in normal position	C/O = no/nc arrangement (contacts closed/opened)/ CC = nc arrangement (all contacts closed)
8	Number of contacts	4 / 6 (standard)
11	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
12	Lock portion symbol: Personnel key (for exchange key condition) Secondary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

⁽¹⁾ FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KSP-FSS-0-4

The KSP is a spring loaded version of the Castell K Lock using an internal spring to automatically extend the bolt to the full extend position when permitted to do so. The KSP lock is a key operated mechanical bolt interlock that is suitable for the control and locking of mechanisms. The standard unit comes with a 15.88 mm diameter bolt that is used to lock movement. The bolt is retracted against the spring by turning the key. This process enables automatic release of the key under certain permitted conditions.

Operation


The Castell KSP spring bolt interlock is used to inhibit movement of mechanical systems.

KSP bolt interlock, Form 4

① Key is free, bolt is extended



② Insert and turn key to drive bolt

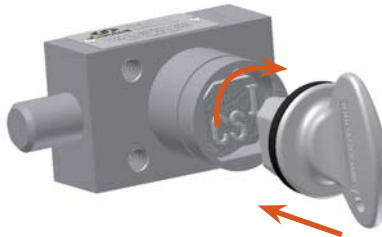

③ Key is trapped, bolt is retracted



1. While the side bolt is extended, the key is free. The mechanism is locked.
2. Inserting and turning the key retracts the bolt against the spring load. This will trap the key into the lock. The key must be held in this position until bolt movement is inhibited by the mechanism.
3. The key stays trapped while the bolt is retracted. The bolt extends only when permitted to do so by the mechanism.

The travel of the bolt is always 19,05 mm. The key is free when the bolt is extended. Insertion and rotation clockwise of the key will retract the bolt. The key will be trapped in the bolt retracted position.

Usage



The KSP spring bolt interlocks are used as a part of a safety system to allow safe control of mechanisms.

The KSP bolt interlock is not designed for security purposes, such as a safe or external access to a building.
The KSP bolt interlock is not designed to interlock access gates or doors. Please refer to AI access interlocks.

No hazardous substances are used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the KSP bolt interlock should normally be mounted to a panel using suitable fasteners. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSP bolt interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Force required to shear lock bolt is 30KN for stainless steel and 19KN for brass interlocks.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS Type
	Maximum: 107°C [224,6°F] for Q Type/140°C [284°F] for FS Type
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 0,7 kg
	Stainless steel: 0,7 kg
Material	Brass/Stainless steel
MTTF Certification	Available on request

Application

KSP bolt interlocks are used to allow safe locking of simple actuating mechanisms.

The bolt is held in the retract position by the mechanism, trapping the key. Whenever the aperture in the lever or mechanism is aligned, the bolt is permitted to extend using its internal spring action and will be locked in the extended position. The key can then be removed.

The key must be inserted and turned, retracting the bolt, to allow the actuating lever to be moved again.

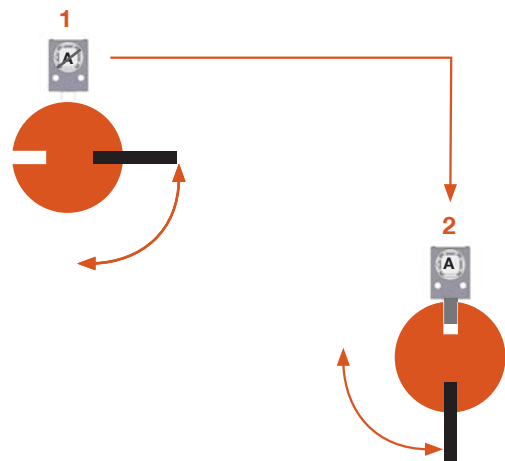

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

KSP, form 4

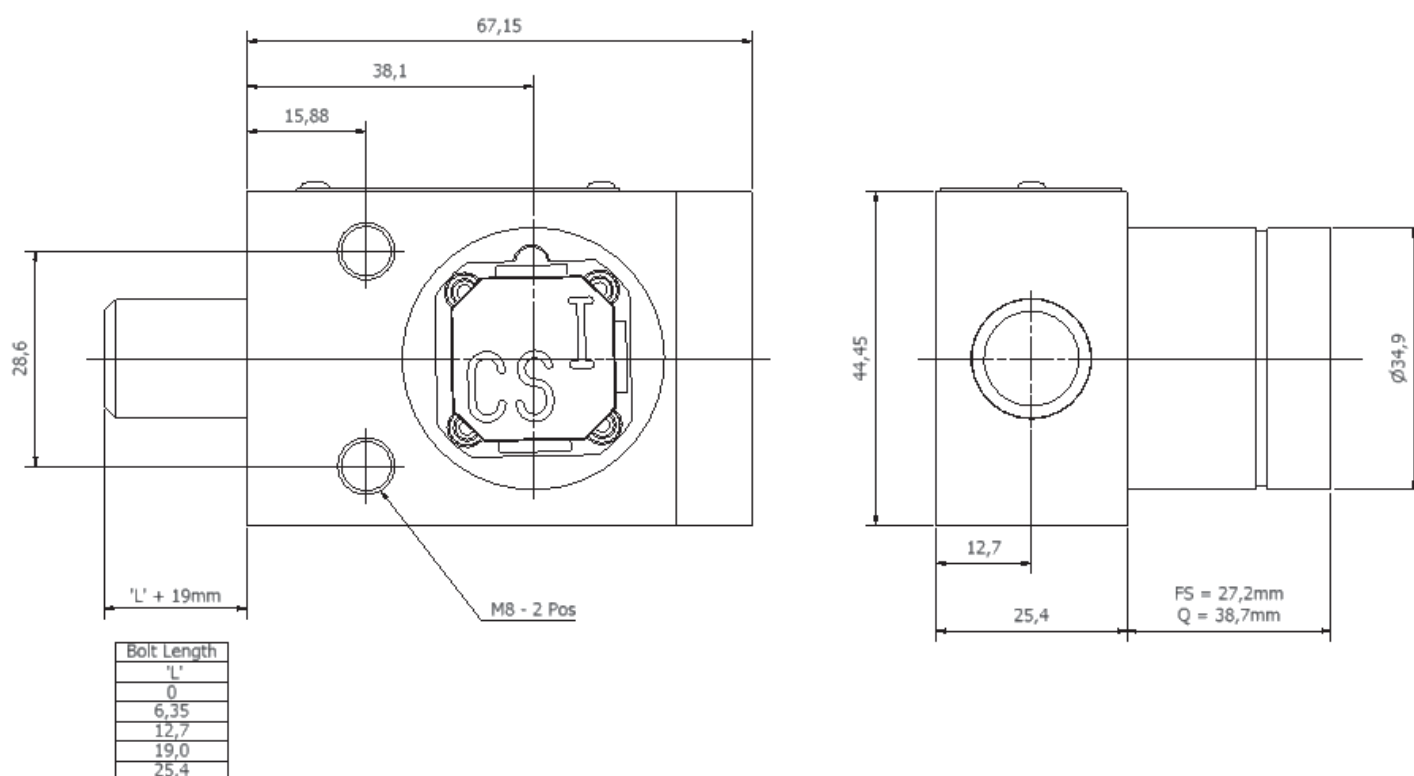

Order Information


	Product Type	1	2	3	4
Part Number	KSP				
Example	KSP	FS	B	0	1
	5				
	ABC				

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	L Dimension (bolt length when retracted) in mm	0 / 6,35 / 12,7 / 19 / 25,4
4	Form	1 / 2 / 3 / 4 ⁽²⁾
5	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Up to 3 characters Q - Lock type Up to 6 characters




(2) Form

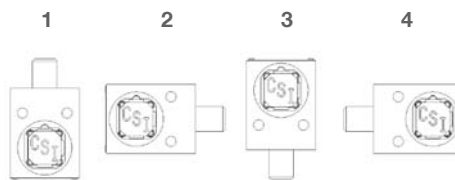

Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



S20-FSB-F-CC4-110A

The KSS is a heavy-duty solenoid controlled key driven electrical switch interlock ideal for the controlled isolation or switching of low current. This product is used where a process can send a signal to release a key, e.g. a robot has to finish a cycle prior to isolation. Upon removal of the key, the KSS switch contacts change to isolate the process. This type of isolator should be used for short term, off load isolation. The unit is ready for mounting into an existing panel or for surface mounting within its own IP65 rated lockable steel enclosure. The KSS is manufactured from either brass or stainless steel making it suitable for use in standard or harsh corrosive environments.

Operation

The Castell KSS Solenoid Controlled Switch is typically used for machine isolation in applications where a machine has to finish a cycle prior to isolation.

KSS Solenoid Controlled Switch

- ① Key is trapped while power is on, solenoid is de-energised.
- ② An external signal is received and LED is illuminated. Push the button to energise the solenoid and remove the key.
- ③ Solenoid is energised, switch is locked out and key is free.



1. While the power is on and a machine is running, the key is trapped in the Solenoid Controlled Switch.
2. To release the key, an external signal must be received to energise the solenoid. With the solenoid energised, the LED will illuminate to confirm that the key can be removed ensuring the power is off.
3. The key can now be removed and taken to open the door lock and gain access to the machine area.

The KSS is available for different switching loads as KSS20 and KSS32 (20 amps power isolation respectively. See order information on page 7 for more details).

The KSS is available with different solenoid voltages as AC: 24, 110 or 240 V or DC: 12, 24, 110, 240 V (see order information on page 7 for more details).

The KSS comes with 4 or 6 contacts as standard with contacts arrangements as 2NO/2NC, 4NC or 3NO/3NC or 6NC.

The KSS is available as a back of panel mount (BOB) and as a surface mount version with an enclosure (FOB).

Usage

The KSS solenoid controlled switch is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KSS solenoid controlled switch is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

Back of panel units should be mounted to a flat surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (see drawing on page 6 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSS range of solenoid controlled switches must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	-25°C to +55°C
Type of mounting	Surface mount using suitable fasteners (see drawing on page 4-5 for hole details)
Weight	2kg
Material	Brass locks with powder coated mild steel enclosure
Power isolation	20A
Switch approvals	BS,UL,CSA & VDE or CCC
MTTF Certification	Available on request

Application

A typical application of KSS solenoid controlled switch is machine guarding. It is usually used in combination with an access interlock such as the Salus for part body access or an access interlock with an exchange key for full body access control.

The KSS breaks the machine safety circuit, ensuring a machine is shut down. Once the machine has completed the cycle, an external signal is received by the solenoid, which is indicated by an illuminated LED. Activating the green button on the KSS will enable the key to be turned and removed ensuring the power is locked out. The key can then be taken to the AIE access interlock to enable access to the machine.

The machine cannot be restarted until the door is closed, the bolt is trapped in the AIE access interlock and the key is removed and taken to the KSS solenoid controlled switch.

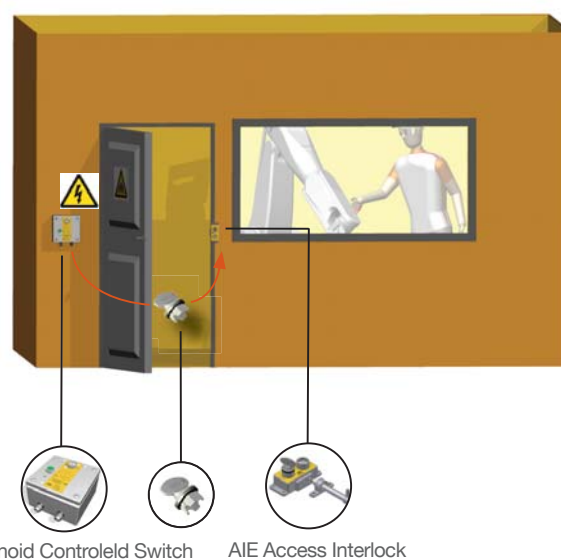

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KSS, panel mount (BOB: back of board)

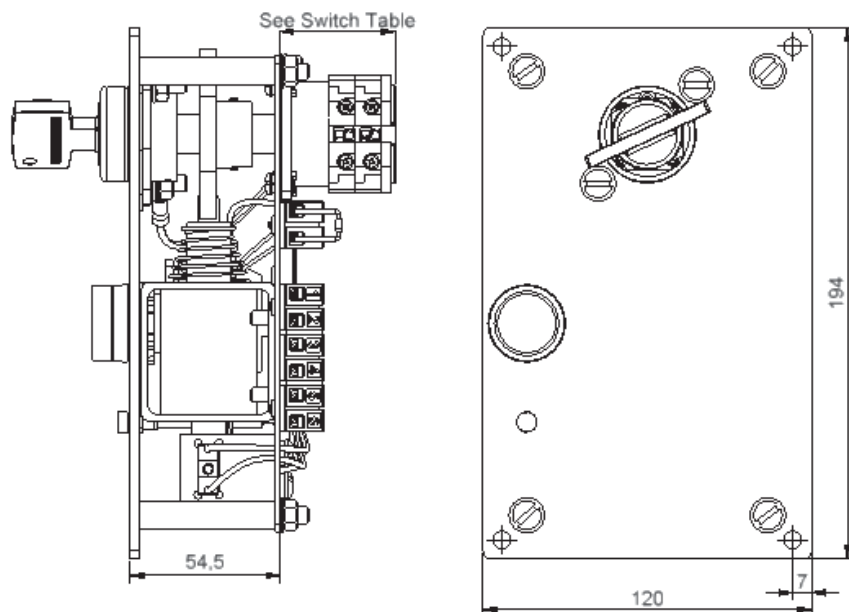

KSS, surface mounting (FOB: front of board)

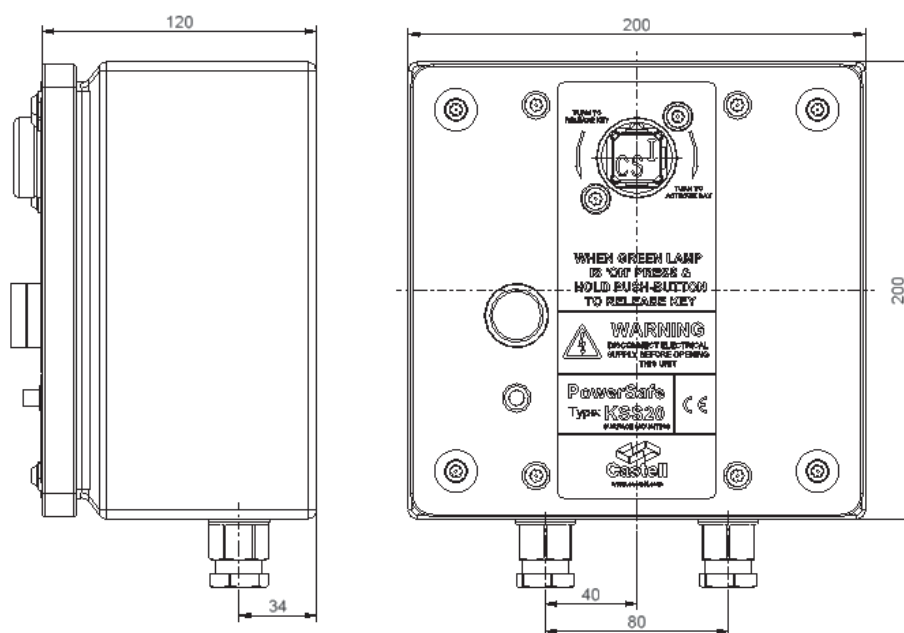


Drawing

Dimensions:
in mm


Note: For safe mounting, use security screws

KSS

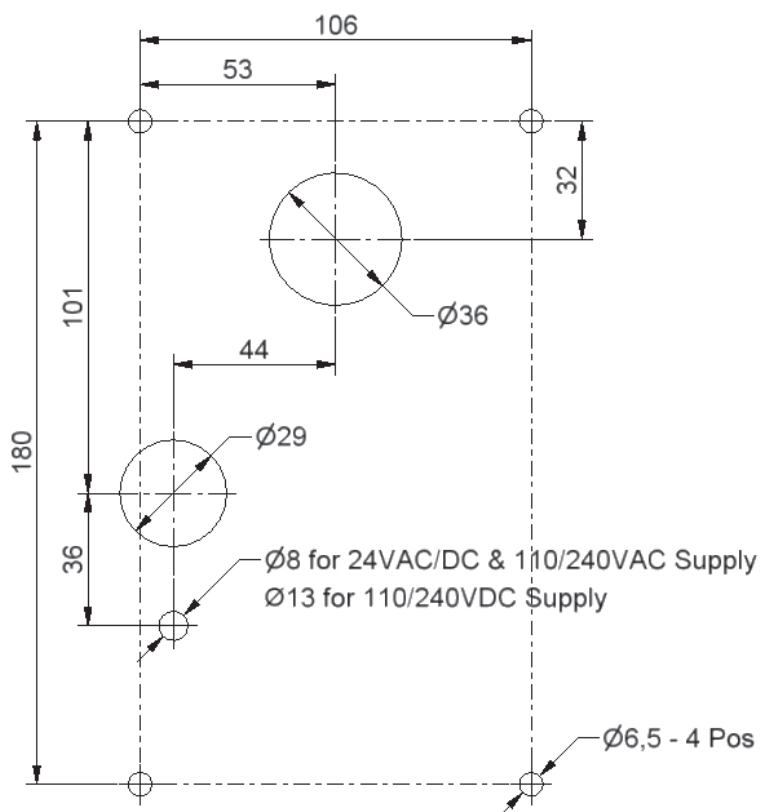


Wiring Diagram

KSS, AC

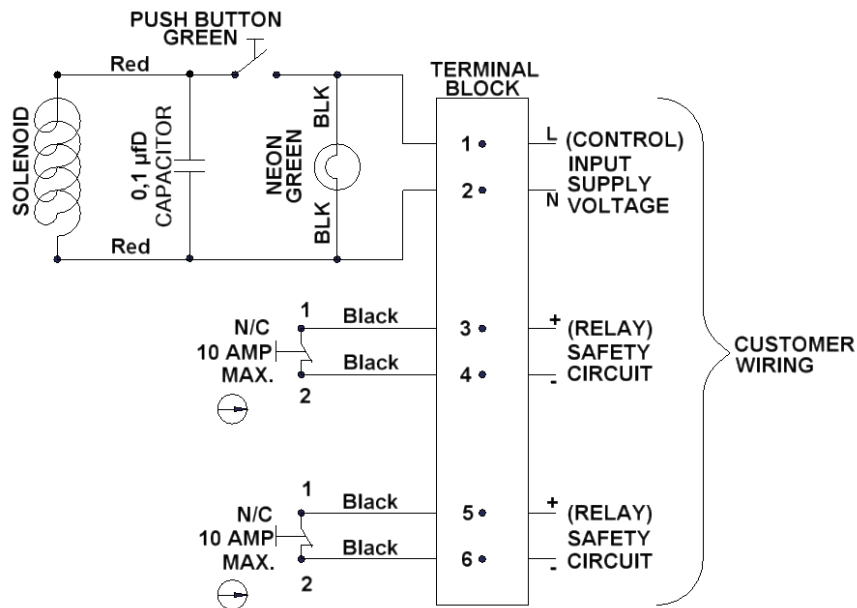

KSS, DC

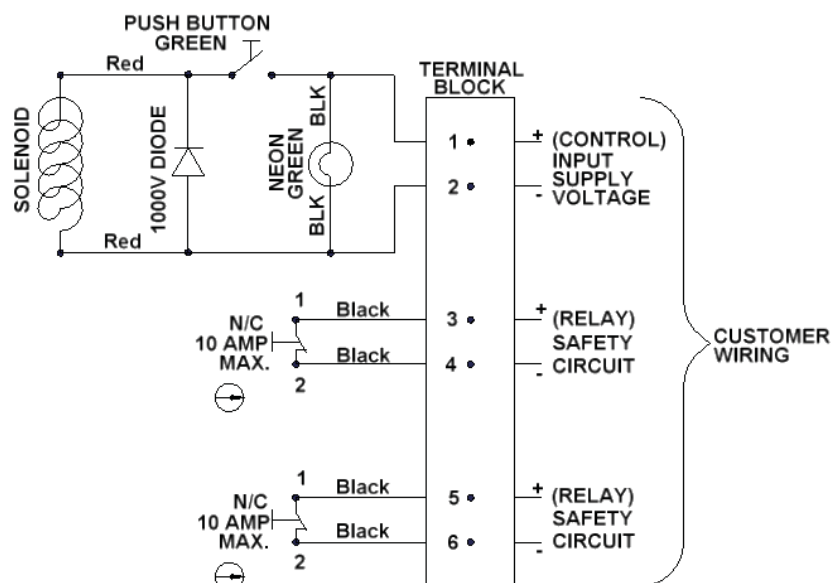

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	S								
Example	S	20	FS	B	F	CC	4	110	A
	9	ABC							


1	Isolation	20 amps (standard)
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Mounting	P = Panel mount (back of board) / F = Front of board mount, with enclosure
5	Contacts arrangement in normal position	CO = no/nc arrangement (contacts closed/opened) / CC = nc arrangement (all contacts closed)
6	Number of contacts	4 / 6 (standard)
7	Control voltage	110 / 24 / 240 (standard)
8	Current	VAC / VDC
9	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



E20-FSS-3D-F-C/O4-110A

The KSSE is a solenoid controlled, multi-key electrical switch for the controlled isolation of low current. This product is used where the controlled isolation of a machine needs to take place, i.e. where a robot has to finish a cycle prior to isolation and where multiple entry points to the protected area are required. The solenoid is continuously rated, and its position is electrically monitored. This type of isolator should be used for short term, off load isolation. The unit is supplied capable of being mounted into an existing panel or for surface mounting within its own IP65 rated lockable steel enclosure. The KSSE is manufactured from either brass or stainless steel making it ideal for use in standard or harsh corrosive environments.

Operation

Castell multi key solenoid controlled switches are typically used for machine isolation in applications where a machine has to finish a cycle prior to isolation.

KSSE multi key solenoid controlled switch, exchange key condition

- ① Isolation Key is free while power is on, solenoid is de-energised. Personnel keys are trapped.
- ② Insert and turn isolation key to switch power off. Once external signal is received (LED illuminates), push the button to energize the solenoid and release personnel keys.
- ③ Power is off, isolation key is trapped and personnel keys are free.



1. While the isolation key is free, the power is on. Personnel keys are trapped.
2. By inserting and turning the isolation key in the KSSE, the contact condition changes switching the power off. Once the machine has finished the cycle, a signal is sent to the KSSE illuminating an LED. Pushing the button energises the solenoid. The personnel keys can now be released by pushing the button. These keys can be taken by personnel to unlock the doors in the machine area.
3. The Isolation Keys stay trapped ensuring power is off until all personnel keys are replaced in the KSSE unit.

Operation

KSSE multi key solenoid controlled switch, double key condition

- ① All keys are trapped while power is on, solenoid is de-energised.
- ② Wait for an external signal (sent to the unit upon machine cycle is completed). Once signal is received, an LED illuminates. Push the button to energize the solenoid and release the keys. This changes the switch contacts condition.
- ③ While all keys are free, the power supply is interrupted.



1. While all keys are trapped, the switch for the main power supply is closed enabling the power supply.
2. Once the machine has finished the cycle, a signal is sent to the KSSE to energise the solenoid. This illuminates the LED. The keys can now be released by pushing the button. This changes the switch contacts condition, interrupting the power supply. The released keys should be taken by the personnel to unlock the doors in the machine area.
3. The power is off until all keys are replaced in the KSSE unit and turned, switching the contact condition to open.

Usage

The KSSE multi key solenoid controlled switch is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KSSE multi key solenoid controlled switch is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

Back of panel units should be mounted to a flat surface using suitable fasteners. Please refer to drawing on page 5 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (see drawing on page 5 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSSE range of multi key solenoid controlled switches must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	-25°C ice free to +55°C
Type of mounting	Surface (with enclosure) or panel mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	4 kg (2 lock portions unit)
Material	Brass/Stainless steel
Power isolation	20A
Switch approvals	BS,UL,CSA & VDE
MTTF Certification	Available on request

Application

A typical application of KSSE multi key solenoid controlled switch is machine guarding. It is usually used in combination with an access interlock such as the Salus for part body access or an AIE access interlock with an exchange key for full body access control.

The KSS breaks the machine safety circuit, ensuring a machine is shut down once the isolation key is inserted and turned into the unit. Once the machine has completed the cycle, an external signal is received by the solenoid, which is indicated by an illuminated LED. Activating the green button on the KSSE will enable the personnel keys to be turned and removed ensuring the power is locked out. The keys can then be taken to the AIE double key access interlocks to enable access to the machine.

The machine cannot be restarted until all doors are closed, and all personnel keys returned to the KSSE multi key solenoid controlled switch.

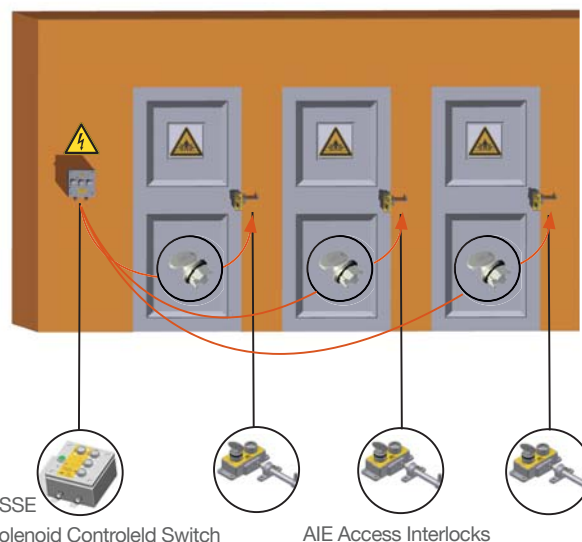

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director





Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KSSE

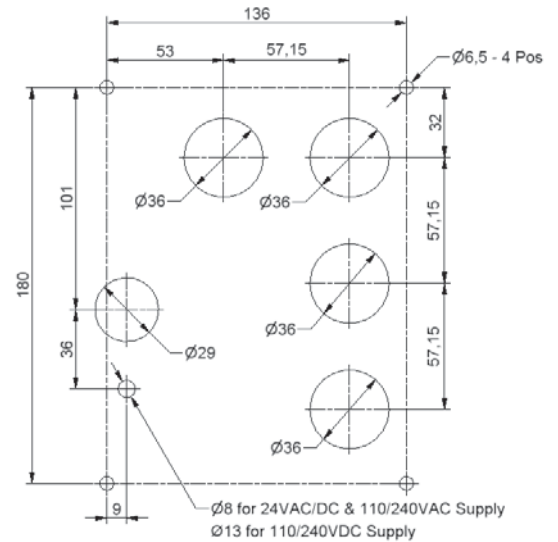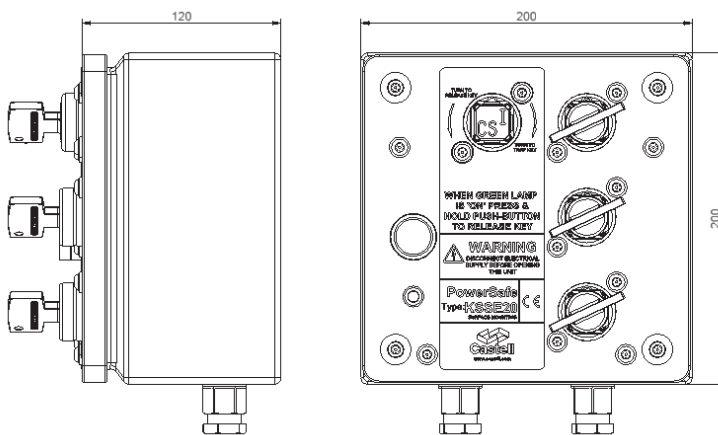


Panel Cut-Out Details

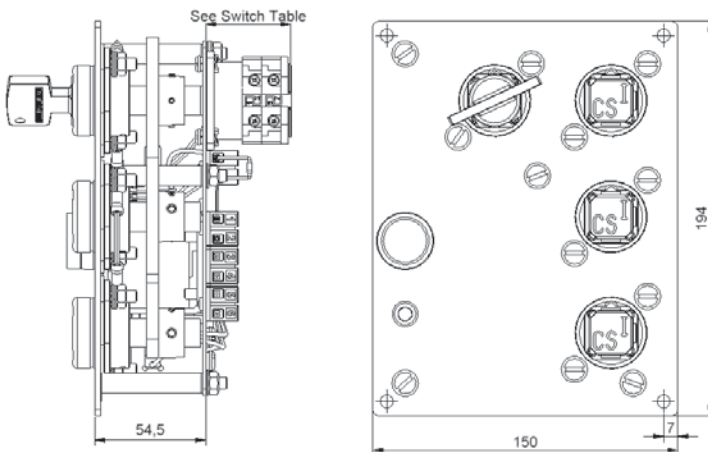


Wiring Diagram

KSSE, Wiring Diagram DC

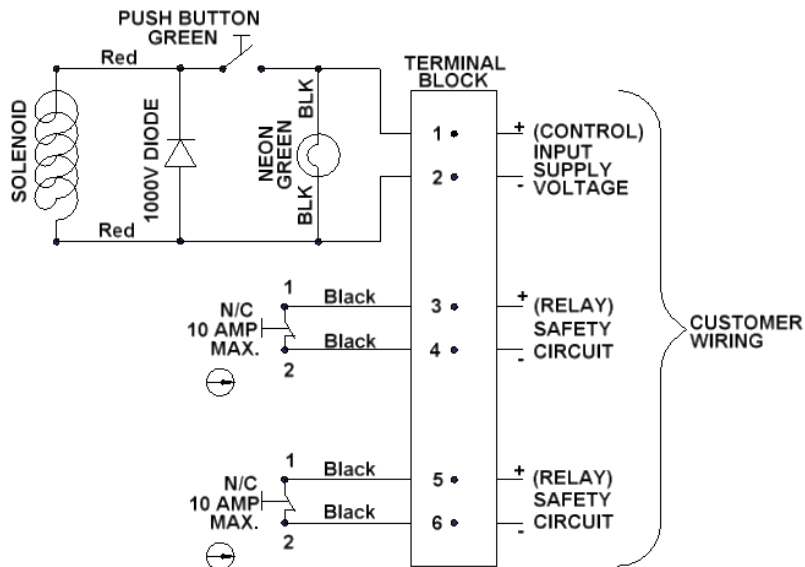

KSSE, Wiring Diagram AC

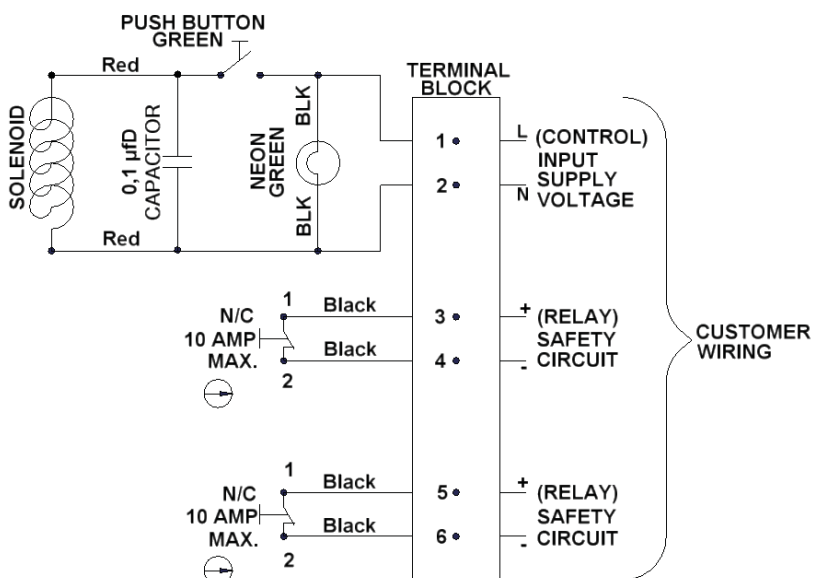

Order Information

	Product Type	1	2	3	4	5	6	7	8	9	10
Part Number	E										
Example	E	20	FS	B	1	D	F	CC	4	110	A

11	A1	Isolation Key Symbol (exchange key condition)
	OR	
12		Personnel Key Symbol (exchange key condition)
	OR	
		Primary Key Symbol (double key condition)
		Secondary Key Symbol (double key condition)

1	Isolation	20 amps (standard)
2	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
3	Material	B = Brass / S = Stainless steel
4	Secondary (additional) lock portion(s)	1 / 2 / 3 / 4 / 5 or 6 secondary lock portions
5	Key condition	E = Exchange key condition / D = Double key condition (simultaneous removal of all keys)
6	Mounting	P = Panel mount (back of board) / F = Front of board mount, with enclosure
7	Contacts arrangement in normal position	CO = NO/NC arrangement (contacts closed/opened)/ CC = NC arrangement (contacts closed)
8	Number of contacts	4 / 6 (standard)
9	Control voltage	110 / 24 / 240 (standard)
10	Current	VAC / VDC
11	Lock portion symbol: Isolation key (for exchange key condition) Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
12	Lock portion symbol: Personnel key (for exchange key condition) Secondary key(s) (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



KSUPSP-FSB-P-CO4

The KSUPS⁺ is a solenoid controlled trapped key interlock. It is primarily used in uninterruptable power supply (UPS) systems. The KSUPS⁺ ensures that access can only be gained once the UPS is a safe condition. The KSUPS⁺ is manufactured from either brass or stainless steel making it ideal for use in standard or harsh corrosive environments. The unit is supplied ready for mounting into an existing panel. The KSUPS⁺ comes with a multi-voltage range of input voltages: 24, 110 and 240 VAC or VDC.

Operation

The Castell KSUPS⁺ solenoid controlled switch is typically used in uninterruptable power supply control systems.

KSUPS⁺ Solenoid Controlled Switch

- ① Key is trapped while power is on, solenoid is de-energised.
- ② Solenoid is energised by external signal. As the LED illuminates, key can be turned and released.
- ③ Solenoid is energised, switch is locked out and key is free.



1. While the power is on and a machine is running, the key is trapped in the KSUPS⁺ unit.
2. To release the key, an external signal must be received to energise the solenoid. With the solenoid energised, the LED will illuminate to confirm that the key can be removed ensuring the power is off.
3. The key can now be removed and taken to open the door lock and gain access to the machine area.

The KSUPS⁺ can operate with a range of input voltages: 24, 110 or 240 VAC or VDC.

The KSUPS⁺ comes with 4 switch contacts as standard with contacts arrangements as 2NO/2NC or 4 Pole ON/OFF. Auxiliary sets of contacts are available on request.

Usage

The KSUPS+ solenoid controlled switch is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The KSUPS+ solenoid controlled switch is not designed for security purposes.

Installation

Installation should be carried out by a qualified electrical engineer.

The front of panel units should be mounted to a flat surface using 2 suitable M6 fixing screws. Holes should be drilled in the panel to accept the lock mounting (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

The faceplate is pushed on and clips on to the lock portion.



Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (see drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The KSUPS+ range of solenoid controlled switches must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.



KSUPS+ connections should be suitably terminated with bootlace ferrules or similar.

Installation not in accordance with these instructions may result in incorrect or unsafe operation.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.

Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions. Please see Contact section for contact details.

Technical Data


Temperature Rating	-25°C ice free to +55°C.		
Type of Mounting	Panel mount using suitable fasteners (please refer to drawing on page 4 for more details)		
Weight	0,6 kg		
Material	Brass/Stainless steel		
Power Isolation	20A		
Voltage	24V AC/DC	110-230V AC/DC	(+/- 5%)
Nominal Power Consumption	24V AC/DC: 9,5VA / 5,5W	110-230V AV/DC: 17VA / 5,5W	
Switch Approvals	BS,UL,CSA & VDE or CCC		
MTTF Certification	Available on request		

Application

A typical application of KSUPS+ solenoid controlled switch is the control of access to uninterruptable power supply (UPS) systems.

The key is released when the UPS system gives a signal to the KSUPS+ to energise the solenoid when it is in a safe state to allow access.

The key can then be taken to gain access to the protected area. The UPS cannot commence until the key is removed and taken to the KSUPS+.

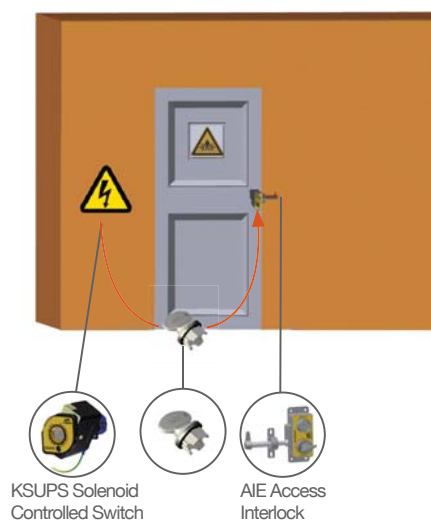

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Dr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

KSUPS+

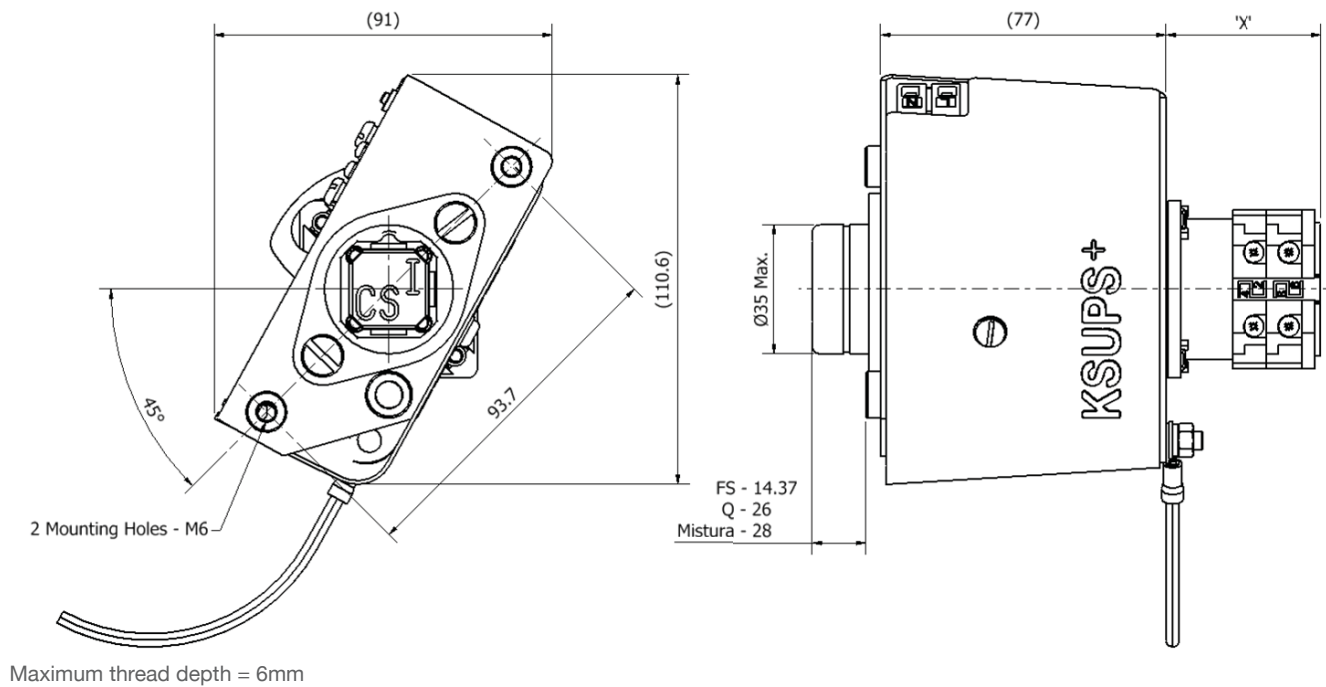

Panel Mounting Details

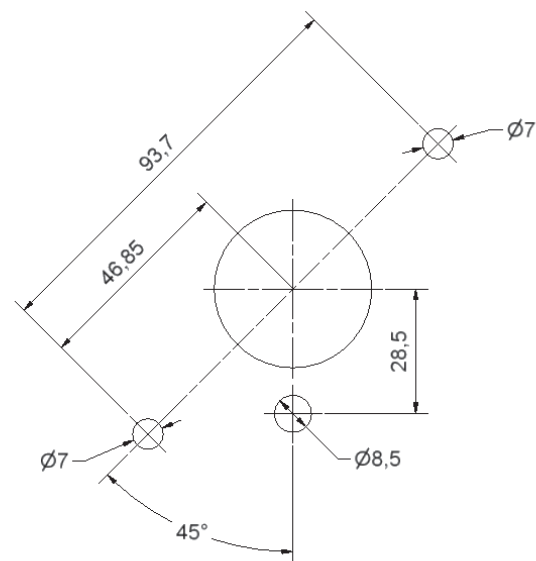

Dimension Reference 'X'	
No of Poles	Length
4 Poles	42,0 mm
6 Poles	51,5 mm
8 Poles	61,0 mm
10 Poles	70,5 mm
12 Poles	80,0 mm


While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Wiring Diagram


Dimensions:
in mm

Note: For safe mounting, use security screws



SOLENOID WIRING DIAGRAM (110 - 240V AC OR DC)

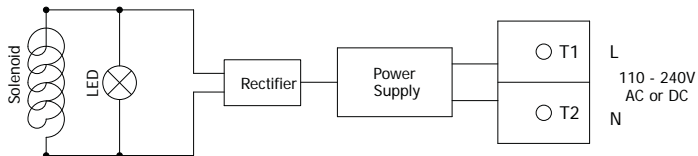


SOLENOID WIRING DIAGRAM (24V AC OR DC)

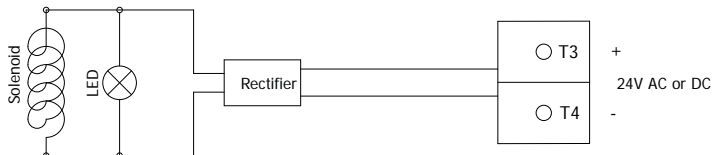


TERMINAL FOR SOLENOID POSITION MONITORING

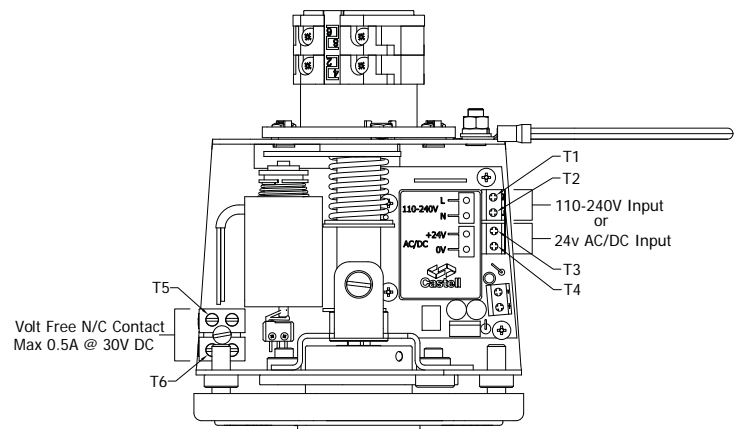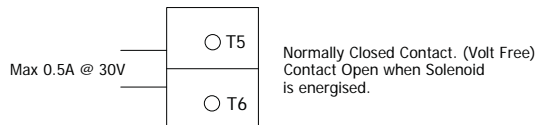

Contacts Wiring Diagram

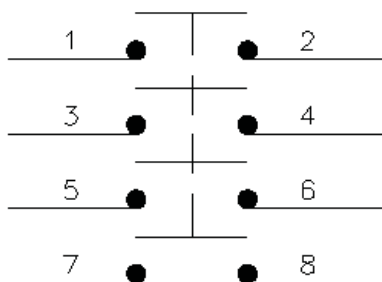

Key Free - Switch off - 4NC

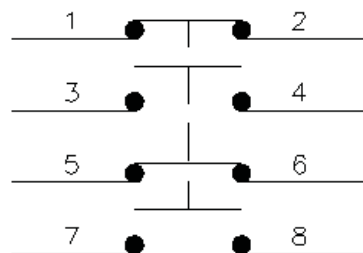

Key Free - 2 NO/2NC

Order Information

	Product Type	1	2	3	4	5	6
Part Number	KSUPSP	-			-		
Example	KSUPSP	-	FS	B	-	P	C/O 4 TBA

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Lock portion material	B = Brass / S = Stainless steel
3	Mounting	P = Panel mount (back of board), standard
4	Contacts arrangement in normal position (key in)	C/O = NO/NC arrangement (contacts closed/open) CC = NC arrangement (all contacts closed)
5	Number of contacts	4, standard
6	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com



MBV-FSS-L/O-L/C

The Castell MBV modular ball valve interlock is an integral valve interlock designed to enable locking off, in either the open, closed or both open and closed conditions. The MBV is suitable for any quarter-turn valves including Ball, Plug and Butterfly Valves up to 2 1/2" bore size. Fitting the MBV enforces a logical, predetermined and safe sequence of operation where the control of flow paths is critical. The MBV is manufactured in stainless steel with stainless steel lock portions, which makes it ideal for use in harsh or corrosive environments where it is subject to heavy use.

Operation

The Castell MBV modular ball valve interlocks are used to prevent unauthorised opening (or closing) of a line ensuring that the valve is always locked in the crucial position.

MBV modular ball valve interlock, locked closed only condition

- ① Valve is normally locked closed, key is free
- ② Insert and turn key to unlock the valve
- ③ Valve is unlocked and opened, key is trapped



1. The service line is normally closed and the MBV modular ball valve interlock locks the valve in the closed condition. The key is free.
2. By inserting and turning the key in the MBV, you can release the valve from being locked closed to open the line.
3. The key stays trapped while the valve can be opened.

Operation

The Castell MBV modular ball valve interlocks with locked opened and locked closed condition are used to prevent unauthorised closing of one of lines (e. g. operational line) ensuring that one line is always open (e. g. service line).

MBV modular ball valve interlock, locked opened and locked closed condition

- ① Valve is locked open, key B is trapped, key A is free
- ② Insert and turn key A to unlock the valve. Turn the valve to closed position. Turn and release key B to lock the valve in the new position.
- ③ Valve is closed, key A is trapped, key B is free



1. The service line is normally open and the MBV modular ball valve interlock locks the valve in the open position. Key A is free, while key B is trapped.
2. By inserting and turning key A in the MBV, the valve can be released from locked open condition and changed to closed. By turning and releasing the key B the valve is locked in the closed condition.
3. Key A stays trapped and key B is released while the valve locked closed.

Usage

The MBV Modular ball valve interlock should be used to prevent unauthorised closing or opening of lines

The MBV modular ball valve Interlock is not designed for large bore valves above 2 1/2 inches.



No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

Fitting the MBV enforces a logical, predetermined and safe sequence of operation where the control of flow paths is critical.

The MBV interlocks are available in either the locked open, locked closed or both locked opened and locked closed conditions.

IMPORTANT:

The MBV interlock should only be fitted by the Castell Engineering Team. Please supply the valves to Castell to enable the MBV to be fitted.



The MBV Modular Ball Valve Interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.

Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions. Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	The MBV modular ball valve interlocks must be fitted to the valves by Castell engineering team
Weight	4,0 kg
Material	Stainless steel body with stainless steel lock portions
MTTF Certification	Available on request

Application

The MBV is designed to operate as part of an integrated safety system controlling the operation of quarter turn ball valves in safety critical applications. The typical application of the MBV modular ball valve interlock is preventing unauthorised closing of one of the lines ensuring that one line is always open.

Interlock valves in both open and closed positions have an interchangeable key between the valves ensuring that the first valve is open before the second is closed. While the operational line is locked opened, the service line is locked closed. Prior to opening the service line it needs to be ensured the operational line is locked closed. By inserting key A (from control room) in the MBV, which controls the operational line, you can unlock the valve and bring it from opened to closed. By turning and releasing key B, you can lock the valve in the closed condition.

Key B can be taken to the next valve, which controls the service line. This valve can now be unlocked by inserting and turning key B in the MBV. The valve position can then be changed from closed to open and locked in the opened position by releasing key C. This key can then be taken to the control room.

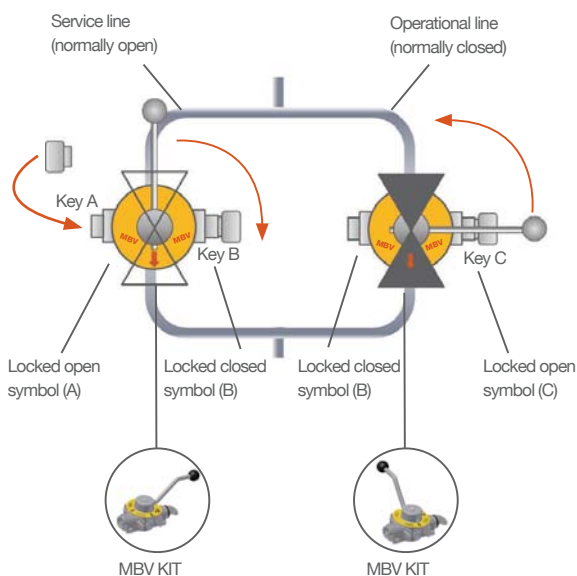

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

MBV, opened position

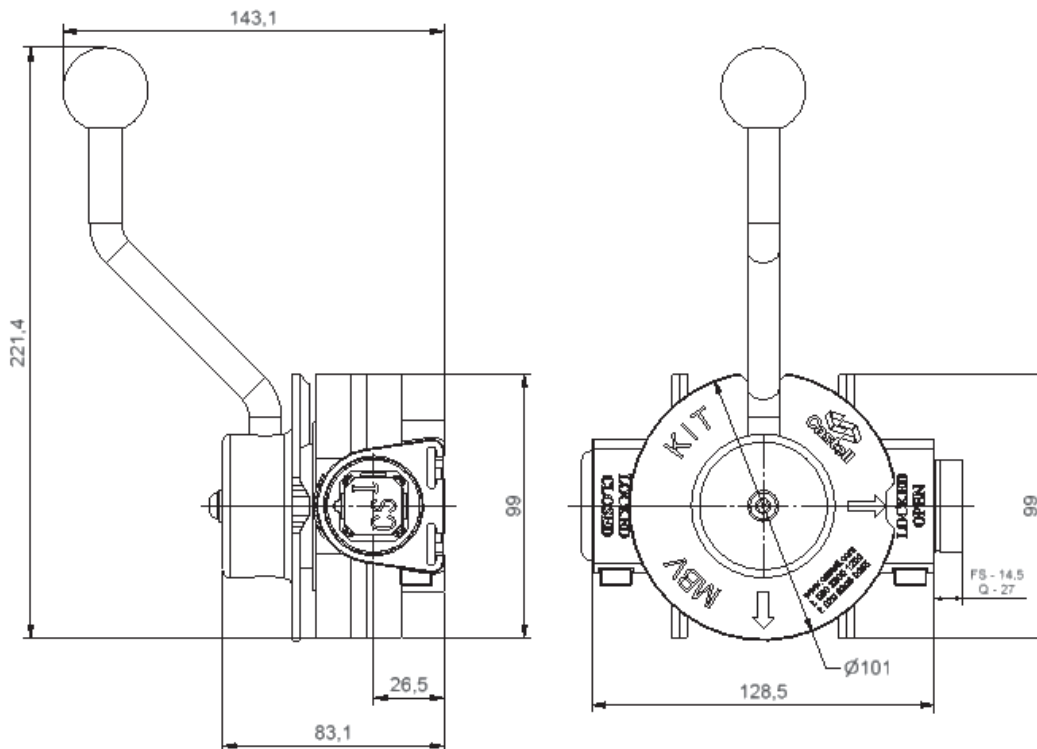

MBV, closed position

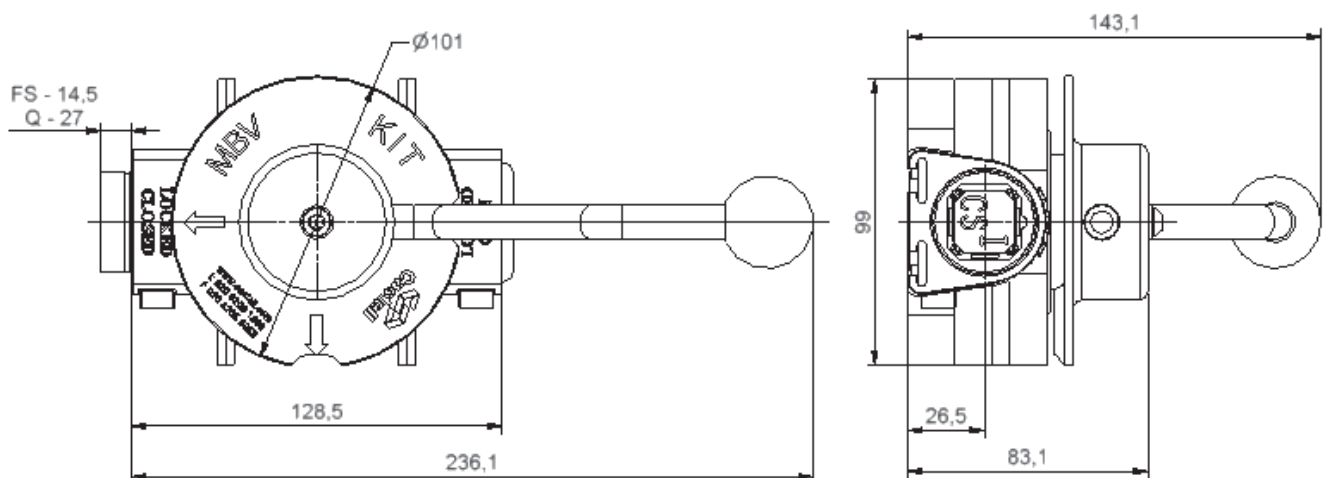

Order Information

	Product Type	1	2	3	4*
Part Number	MBV				
Example	MBV	FS	S	L/O - L/C	

	L/O Symbol
5	A
	L/C Symbol
	B


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	S = Stainless steel (standard)
3	Valve locked state	L/O = locked open L/C = locked closed L/O-L/C = locked open and closed
4*	Optional: additional features available	SWITCH = complete with LIMIT SWITCH EEXDSW = complete with ATEX LIMIT SWITCH
5	Lock portion symbols	L/O Symbol = locked open symbol (please advise) L/C Symbol = locked closed symbol (please advise) FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International
The Castell Building
217 Kingsbury Road
London, NW9 9PQ
UK

t: +44 (0)20 8200 1200
f: +44 (0)20 8205 0055
uksales@castell.com

Castell Safety International
Oskar-Jäger-Straße 137
50825 Köln
Germany

t: +49 (0)221 169 47 94
f: +49 (0)221 169 47 95
vertrieb@castell.com

Castell Interlocks
150 N Michigan Avenue
Suite 800
Chicago IL 60601
USA

t: +1 (312) 360 1516
f: +1 (312) 268 5174
ussales@castell.com

Castell Safety International
Building 1, No. 123
Lane 1165 Jindu Rd
Shanghai, 201108
China

t: +86 (0)21 6151 9028
f: +86 (0)21 6151 9030
chinasales@castell.com

Castell Safety International
No.14, 7th Street, R.E. Nagar
Porur, Chennai - 600116
Tamil Nadu
India

t: +91 (0)98406 31258
f: +44 (0)20 8205 0055
indiasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Appendix - Pricing Application Form Questionnaire

In order to ensure accurate and consistent pricing, Castell prices all valves on a price on application basis. Please complete the questions below and return via email to sales@castell.com.

If you require assistance please call our technical sales team at +44 (0)20 8200 1200.

Customer organisation name

Customer organisation contact person

Customer organisation contact number and email address

Delivery address

Valve details

(1) Type of host valve/s (please circle one)

Ball Valve	Butterfly
------------	-----------

(2) Valve model, manufacturers and part number

(3) Is it 2 or 3 way valve? (please circle one)

2-way	3-way
-------	-------

(4) Degree of rotation (please circle one)

90 Degrees	180 Degrees
------------	-------------

(5) Size of valve in DN or inches

(6) Operating torque

(7) Class of valve

(8) Gland size

(9) Pressure handling capacity (alternatively, please provide a data sheet of valve in selection)

(10) Operating temperature

(11) Weight of the valve

(12) Is the interlocked valve a sequence or one-off? (please circle one)

Sequence	One-off
----------	---------

(13) Operating cycle of the valve (please circle one)

Daily	Monthly
Yearly	Other

(14) Does the valve handle gases or fluids?

(15) Is the valve exposed to hazardous operating environment? If so, please specify

Note: All completed pricing application forms must be accompanied by a top work drawing of the entity in question. An example of the type of top work drawing required is included on page 8 of this document.



MSI-FSB-F-3-110A

The MSI is designed to control access to rotating machinery that has a run-down time. The MSI relies on the detection of motion via two sensors. Only when both sensors detect zero movement can the key be released. The MSI has been designed to provide the highest level of safety when installed as part of an access control system for dangerous machinery.

Operation

The Castell MSI motion sensing interlocks are typically used for machine isolation in applications in order to protect the hazardous area from access while power is on.

MSI movement sensing interlock

- ① Power is on, key is trapped. Red LED is illuminated.
- ② Turn the key to OFF position. Once zero movement of a motor has been detected, a signal is sent to the unit energising the solenoid. The green LED illuminates. Release the key by pushing the green button.
- ③ Key is released, power is off and the motor stands still.



1. While the power is on and a motor is running, the key is trapped in the MSI motor sensing interlock. A red LED is illuminated.
2. Turn the key to OFF position to switch the power off. A movement sensor in the MSI unit gives a signal to the solenoid once zero movement has been detected. This will illuminate a green LED. The key can now be released by pushing the green button. This key can be taken to unlock the access lock on the motor unit.
3. The motor stands still and power is off until the key is replaced in the MSI motor sensing unit.

Usage

The MSI movement sensing interlock is designed to be part of a safety system and is used to switch off the power and detect zero motor movements before releasing a key which is then used to gain access to a hazardous area via an access interlock such as the AI or Salus.



The MSI movement sensing interlock is not designed for security purposes.

Installation

The MSI movement sensing interlock should be mounted to a surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 5 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The MSI range of movement sensing interlocks must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature	Minimum: -5°C [23°F]
	Maximum: 55°C [131°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Attachment	Millimeters: 240mm(H) x 140mm(W)
	Inches: 9.45"(H) x 5.51"(W)
Weight	5.0 kg
Material	Brass or Stainless steel lock portions, powder coated mild steel enclosure
Standards	EN60439-1
Cable Size	M20 Gland x 2
IP Rating	IP65, NEMA 4 enclosure
Standards	Standstill detection components to UL
Contact Rating	Continuous, unattended, remote
Use	Engine switch, circuit-breaker or control switch
Voltage	24 VDC and 240 VAC, 120 VAC
Max Motor Voltage	600V
Max Power Consumption	20VA / 18W

Application

The MSI is designed to operate as part of an integrated safety system, controlling access to hazardous areas to motor driven, high risk applications where complete isolation of the power supply is required before access is granted. Two sensors are positioned on the rotating shaft, these are wired into the MSI unit.

When the electric motor is running, the key of the MSI interlock cannot be removed, hence preventing access to the hazardous area. To gain access to the area, the electrical motor must be switched off by turning the key to OFF position. This changes the switches of the electrical supply to the machine to a safe condition. A movement sensing detector sends a signal to the MSI unit once a zero movement of the motor has been stated. A green LED illuminates. By pushing the green button, the key can now be removed and taken by the personnell to the AI access interlock.

The guard can only be opened when the electrical supply has been switched into a safe condition. The machine cannot be restarted until the door is closed and the key is removed and taken to the MSI movement sensing interlock.

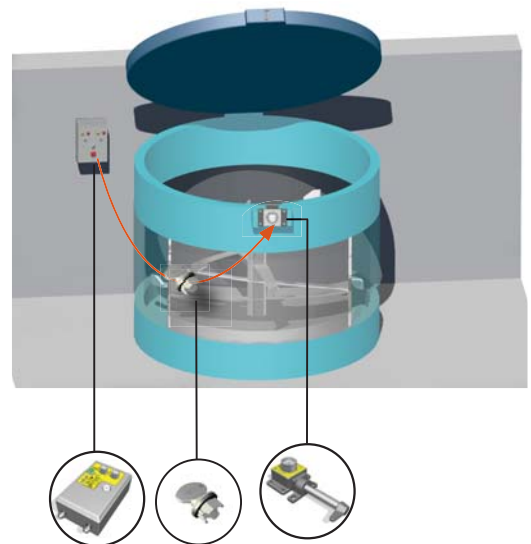

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm


Note: For safe mounting, use security screws

MSI

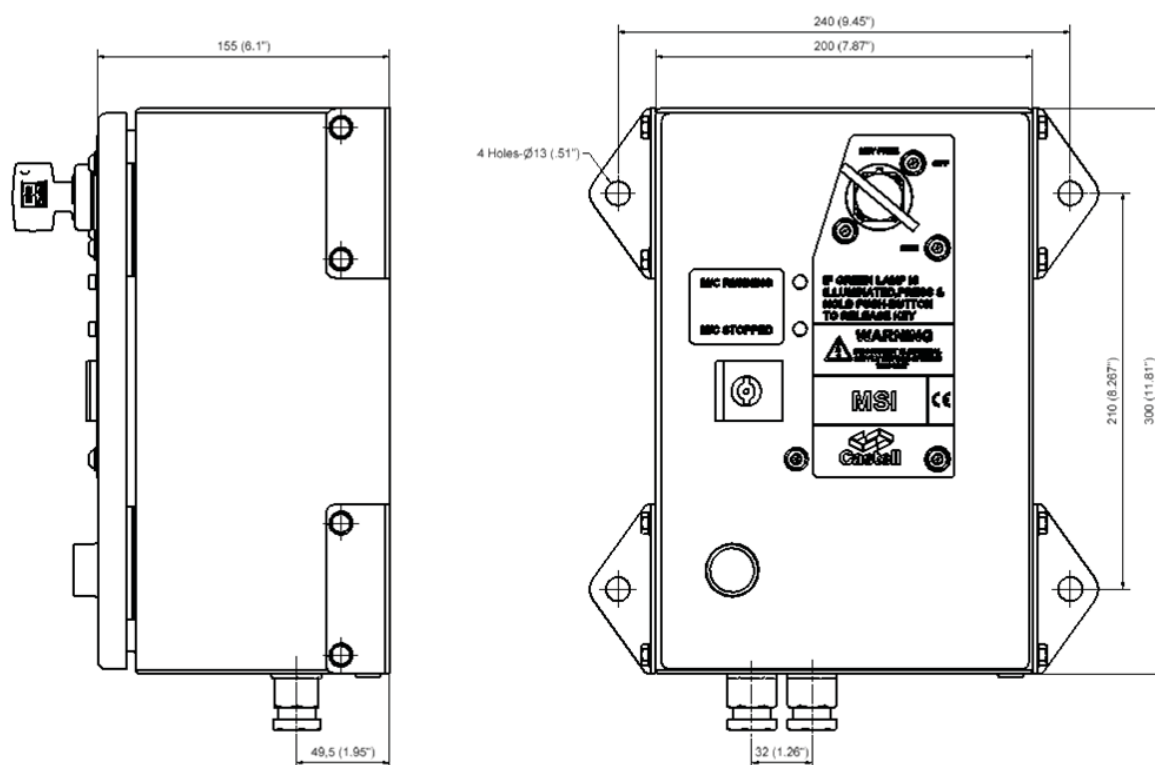

Wiring Diagram

MSI

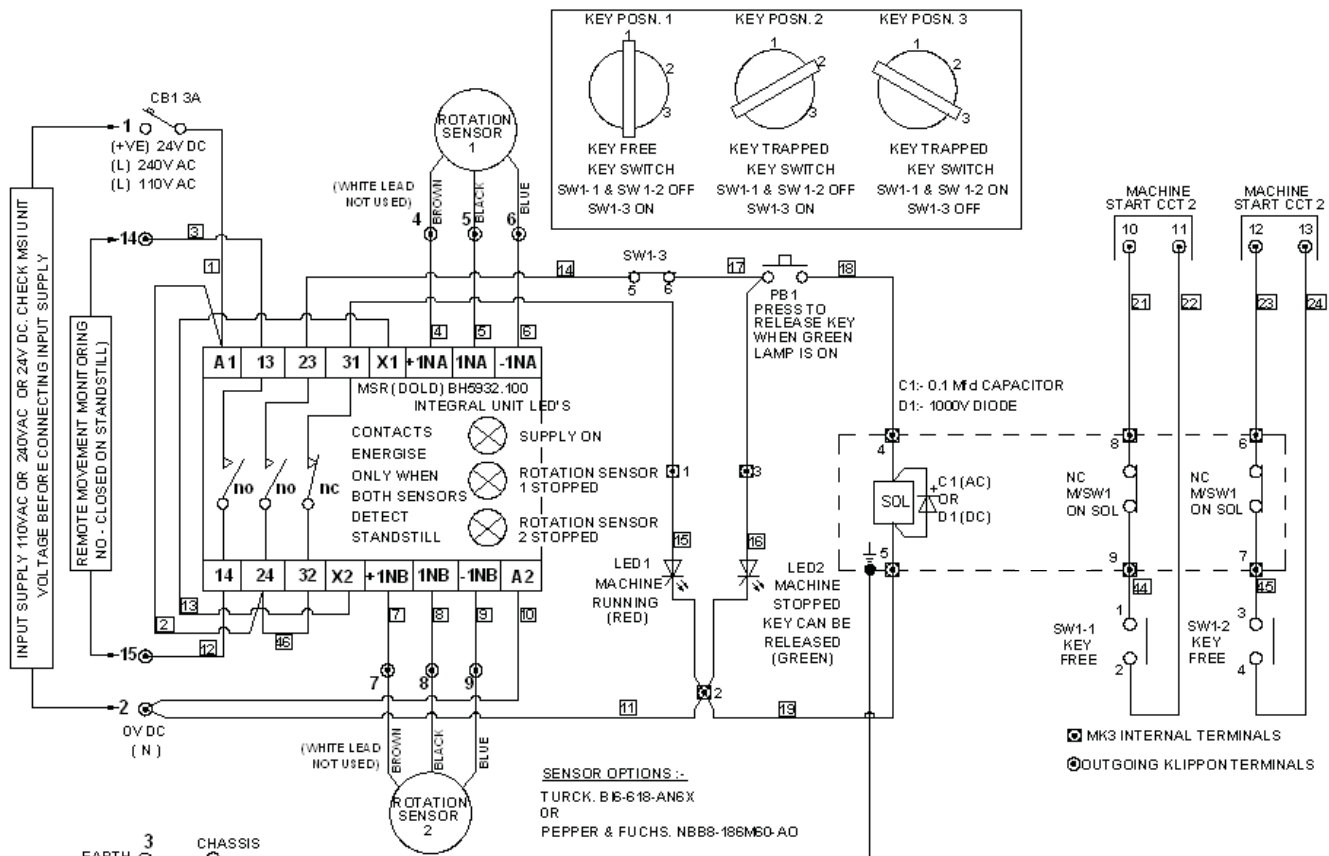

Order Information

	Product Type	1	2	3	4*	5	6	7
Part Number	MSI							
Example	MSI	FS	B	F	1S	3	110	A
		8						
	ABC							


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
3	Mounting	F = Front of board mount, with enclosure (standard)
4*	Secondary lock portion(s) Secondary lock portions are provided for personnel keys, primary lock portion for the isolation key	1S / 2S = 1 or 2 secondary lock portions respectively
5	Number of poles	3, standard
6	Control voltage	110 / 24 / 240 (standard)
7	Current	AC (use for 110V and 240V) / DC (use for 24V)
8	Lock portion symbol	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



OLYM-S24D-C24D

The Olympus 4HD is a heavy duty solenoid controlled access lock available with either a stainless steel tongue actuator or a heavy duty handle. The Olympus 4HD is capable of supporting Category 4 safety systems through its 2n/c 1n/o contacts and is ideal for all types of hinging or sliding access points with a good tolerance for misaligned guarding. The unit is locked by the solenoid when it is de-energized and opened when energized. A mechanical key override facility for the solenoid comes standard. The Olympus 4HD is ideal for use on production cells and automated production and assembly lines where fast access is required.

Operation

The Castell Olympus Solenoid controlled access lock is typically used for machine isolation in applications where a machine has to finish a cycle prior to isolation.

OLYMPUS Heavy Duty Solenoid Controlled Access Lock

- ① Tongue actuator is trapped. No LEDs are lit.
- ② An external signal energises the solenoid. The yellow LED illuminates. Retract the tongue actuator.
- ③ Solenoid is energised and tongue actuator is released. Red and yellow LEDs are lit.



1. While the power is on and the machine is running, the solenoid, which controls the tongue, is de-energised. This traps the tongue in the OLYMPUS unit.
2. To open the guard the machine is instructed to stop via control circuit. On stopping a signal is sent to the solenoid in the OLYMPUS unit. With the solenoid energised, the tongue actuator can be retracted to break the contacts ensuring the machine cannot restart.
3. With the tongue released the machine area can be accessed. The machine cannot restart until the tongue actuator is re-inserted and the contacts closed.

The OLYMPUS heavy duty solenoid controlled lock is available either with a stainless steel tongue actuator or heavy duty handle.

The OLYMPUS is available with different control and solenoid voltages (see order information on page 6 for more details).

Usage

The OLYMPUS solenoid controlled access lock is designed to be part of a safety system and is typically used as an access lock combined with machine isolation function in applications where a machine has to finish a cycle prior to isolation through the tongue actuator.



The OLYMPUS solenoid controlled access lock is not designed for security purposes.

Installation

OLYMPUS units should be mounted to a flat surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (see drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The OLYMPUS range of solenoid controlled access lockes must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.



In case of defects beeing detected please contact your nearest Castell Support Department for further actions. Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -5°C [23°F], Maximum: +40°C [104°F]*
Type of mounting	Panel mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	4,0 kg
Material	Zinc alloy, stainless steel tongue*
Paint Finish	Gloss polyester power coat on passivated base material*
Ingress Protection	IP67 (DIN 40050)*
MTTFd	high > 385 years (31.250)*

* Source: Fortress Interlocks data sheet, document number: A_DS_E_LOK_V1.1_DEC09

Application

A typical application of OLYMPUS solenoid controlled access lock is machine guarding. It is usually connected to power isolators via safety relays.

When the machine is in operation the access door is locked via the de-energized solenoid in the OLYMPUS solenoid controlled access lock. To open the guard, the machine is instructed to stop via the control circuit. Once the machine has completed the cycle, an external signal is received by the solenoid. Retracting the tongue actuator will break the contacts ensuring the power is locked out.

The machine cannot be restarted until the door is closed and the tongue actuator is replaced in the OLYMPUS solenoid controlled access lock.



OLYMPUS
Solenoid Controlled Access Lock

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Drawing*

Dimensions*:
in mm

Note: For safe mounting, use security screws

OLYMPUS

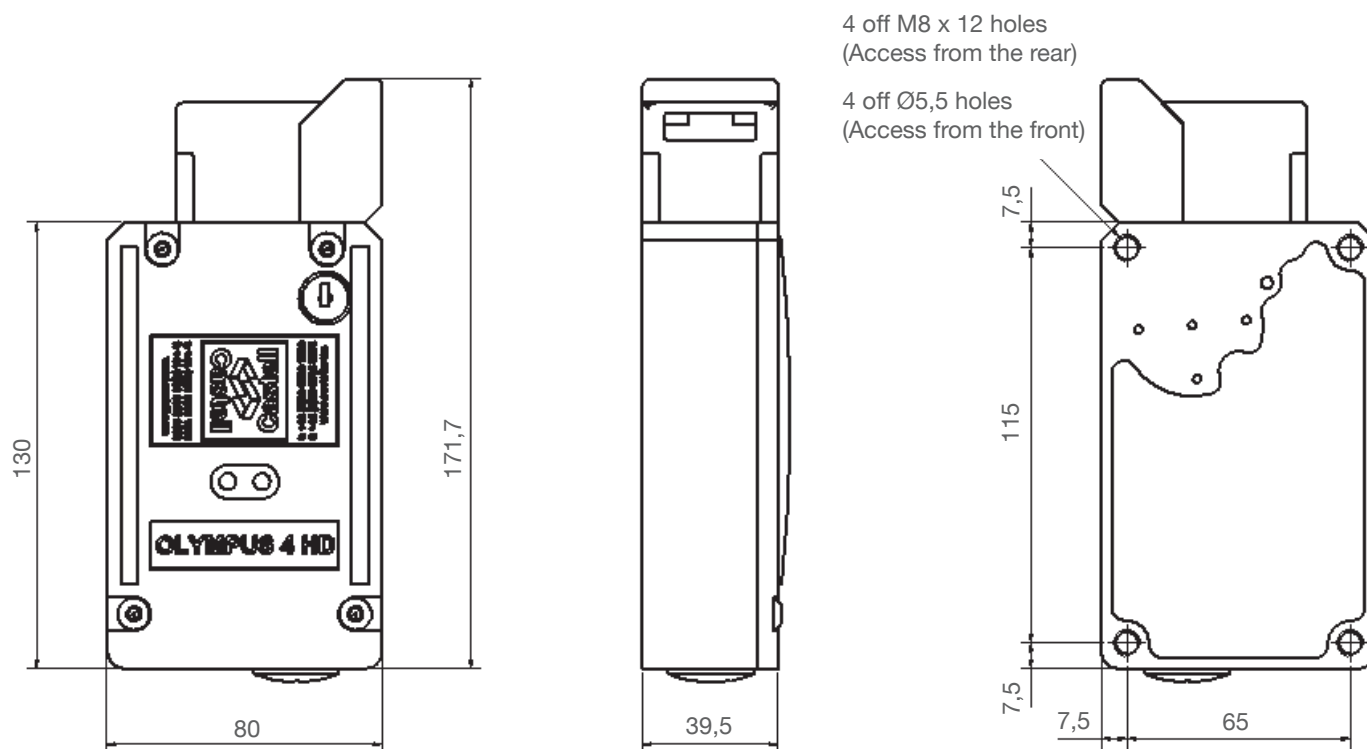


* Source: Fortress Interlocks Data Sheet, Document Number: A_DS_E_LOK_V1.1_DEC09

Wiring Diagram

Note: For safe mounting, use security screws

OLYMPUS

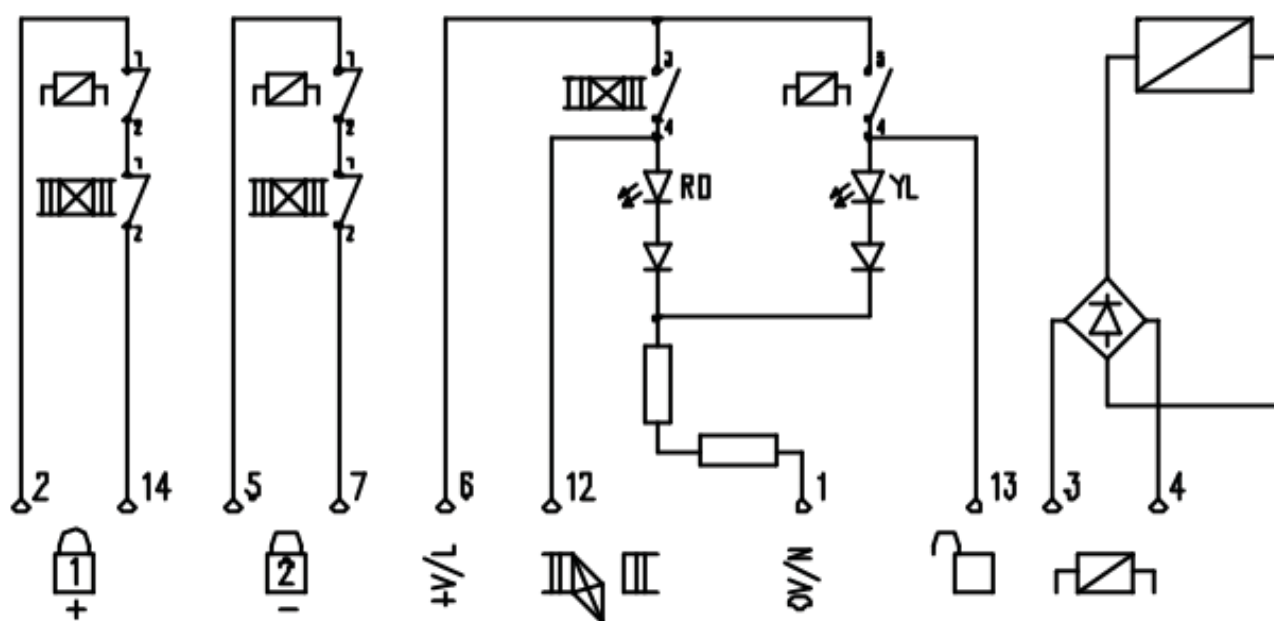

* Source: Fortress Interlocks Data Sheet, Document Number: A_DS_E_LOK_V1.1_DEC09

Order Information

	Product Type	1	2	3	4
Part Number	OLYM	S			
Example	OLYM	S	24	D	C 24 D

1	Solenoid Voltage	24 / 48 / 110 / 240 V
2	Solenoid Current	D = DC / A = AC
3	Control Voltage	24 / 48 / 110 / 240 V
5	Control Current	D = DC / A = AC

Contact Information

Special construction available upon enquiry

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



The Salus is a single key automatic access interlock for use on hinged or sliding doors. The interlock is available in both left and right hinged and sliding door configurations. The unit is manufactured in stainless steel, making it ideal for use in harsh and corrosive environments and for heavy use. Typical industries using the Salus are food, chemical, mining, steel and pharmaceutical.

SALUS-S-1

Operation


The Castell single key access interlocks are used in various applications to control part body access to hazardous areas.

SALUS access interlock, hand 1, hinged door operation

- ① Key is free, bolt is trapped in the lock



- ② Insert and turn key, to release bolt



- ③ Key is trapped, bolt is released



1. While the key is free, the bolt of the Salus access interlock is trapped in the mechanism. The hinged door is locked.
2. By inserting and turning the key in the access interlock, you can release the bolt. This will trap the key in the lock.
3. The key stays trapped while the bolt is released.

SALUS access interlock, hand 1, sliding door operation

- ① Key is free, bolt is trapped in the lock



- ② Insert and turn key, to release bolt



- ③ Key is trapped, bolt is released



1. While the key is free, the bolt of the Salus access interlock is trapped in the mechanism. The sliding door is locked.
2. By inserting and turning the key in the access interlock, you can release the bolt. This will trap the key in the lock.
3. The key stays trapped while the bolt is released.

Usage

The Salus automatic access interlock should be used as a part of a safety system to allow safe access to potentially hazardous and dangerous areas.



The Salus interlock is not designed for security purposes, such as a safe or external access to buildings.

The Salus interlock has been tested to vibration, in accordance with BS EN 50155:2001 & IEC 61373:1999-01 up to a maximum of 150Hz). If the unit is to be subjected to vibration levels higher than this, then anti vibration pads should be used.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The mounting bracket should be mounted on the static frame or the door. The mounting should be positioned so that bolt engagement is made before the door touches the frame. The Salus unit is then presented to the mounting plate at an angle and clipped on by engagement with the internal tangs. Once the unit is clipped on, the two dog screws are tightened (using the security bit supplied), trapping the mounting plate and securing the unit for use. The bolt should then be aligned and mounted, using suitable fasteners. The design of the bolt allows for some misalignment to the housing. Please refer to drawing on page 4 for more installation details.



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The Salus access interlock must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of detected defects please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free
	Maximum: 75°C [167°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	1.4kg
Material	Stainless steel
MTTF Certification	Available on request


Application

A typical application of the Salus single key automatic access interlock is machine guarding with part body access.

The Salus is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed.

The system involves the Salus20 key switch that breaks the machine safety circuit when the key is removed. The key can then be taken to the Salus automatic access interlock to enable access to the machine.

The machine cannot be restarted until the door is closed, the bolt is trapped in the Salus lock and the key is removed and taken to the Salus20 key switch.

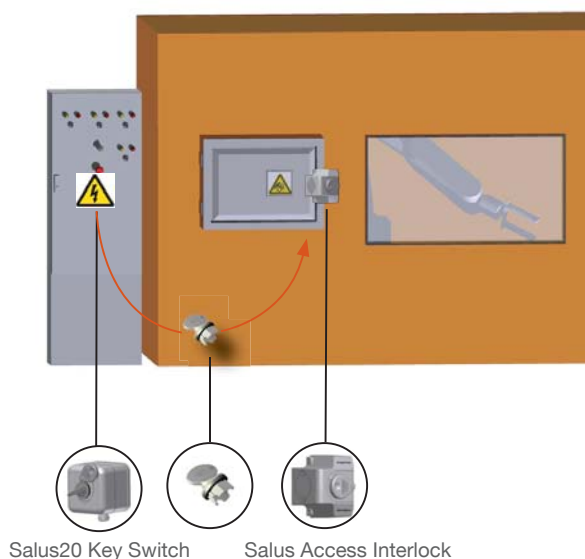

Salus20 Key Switch

Salus Access Interlock

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

SALUS, Hand 1, hinged door operation

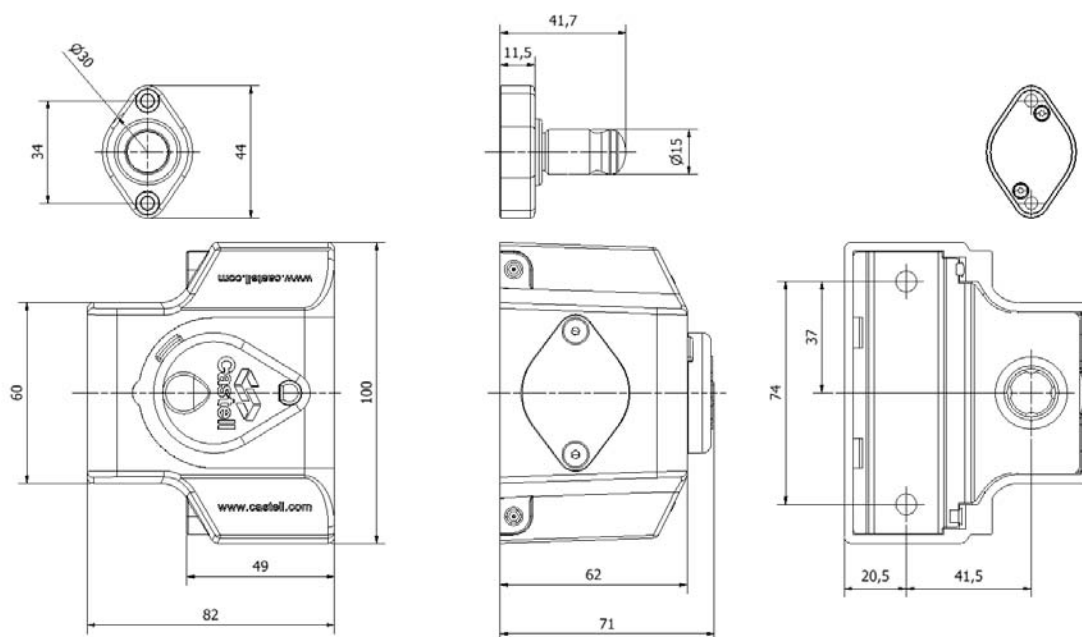

SALUS, Hand 1, sliding door operation

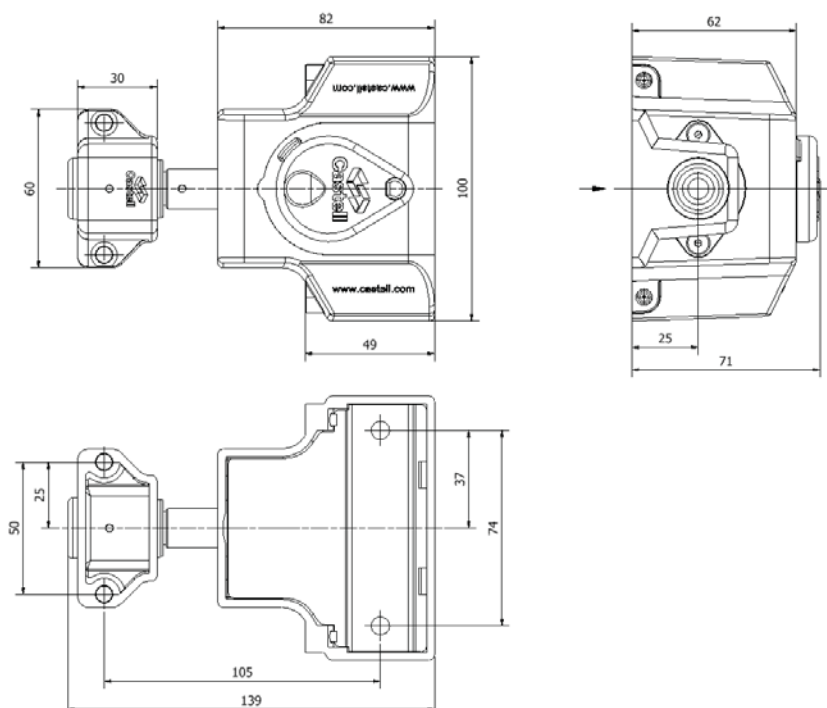

Order Information


	Product Type	1	2
Part Number	SALUS	-	-
Example	SALUS	-	S - 1
	3		
	ABC		

1	Operation	H = Hinged Door Operation ⁽¹⁾ S = Sliding Door Operation ⁽¹⁾
2	Handing	1 = left hinged door (bolt enters left) ⁽²⁾ 2 = right hinged door (bolt enters right) ⁽²⁾
3	Lock portion symbol	up to 3 characters

(1) Hinged Door Operation Sliding Door Operation



(2) Hand 1 Hand 2



Individual construction upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



SALUS20

The Salus20 is a trapped key isolation switch capable of switching up to 20 amps. It combines an integrated flush mounted lock with sliding lock cover in a stainless steel sealed enclosure rated to IP65. The stainless steel housing has an ergonomic design that means the Salus20 has no potential areas for dirt to collect and trap. The Salus20 is also fitted with stainless steel glands further enhancing its suitability for harsh or corrosive environments and heavy use. Typical industries using the Salus20 are food, chemical, mining, steel and pharmaceutical.

Operation


The Castell Salus range is used in various applications to control access to hazardous areas, especially in harsh or corrosive environments.

Salus20

① Key is trapped, power is on.



② Turn and remove key to change the switch condition and switch the power off.



③ Key is removed, power is off.



1. While the power is on and machine is running, the key is trapped in the Salus key switch.
2. By turning and removing the key, the power will be shut off by changing the switch contacts in the Salus20.
3. The key can be taken to gain access to machine area via a door interlock.

Usage

The Salus20 is designed to be part of a safety system and is used to isolate the power releasing a key which is then used to gain access to a hazardous area via an access interlock such as the Salus.



The Salus20 isolator key switch is not designed for security purposes or for switching loads greater than 20 amps.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The housing of the Salus20 should normally be mounted to a surface using suitable fasteners to fix the mounting bracket (see drawing on page 4 for more installation details).



The Salus20 key isolator switch must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -5°C [23°F] ice free
	Maximum: 55°C [131°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details). Fixings provided with the unit.
Weight	1,4 kg
Material	Stainless steel
MTTF Certification	Available on request
Ingress Protection	IP65

Application

A typical application of Salus20 isolator key switch is machine guarding. It is usually used in combination with an access interlock such as the Salus for part body access or an access interlock with an exchange key for full body access control.

The Salus20 breaks the machine safety circuit, ensuring a machine is shut down when the key is turned and removed. The key can then be taken to the Salus automatic access interlock to enable access to the machine.

The machine cannot be restarted until the door is closed, the bolt is trapped in the access interlock and the key is removed and taken to the Salus20 key isolator switch.

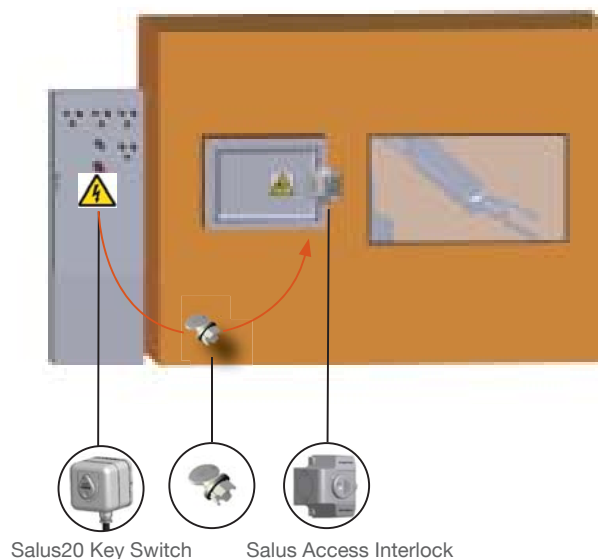

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director



Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

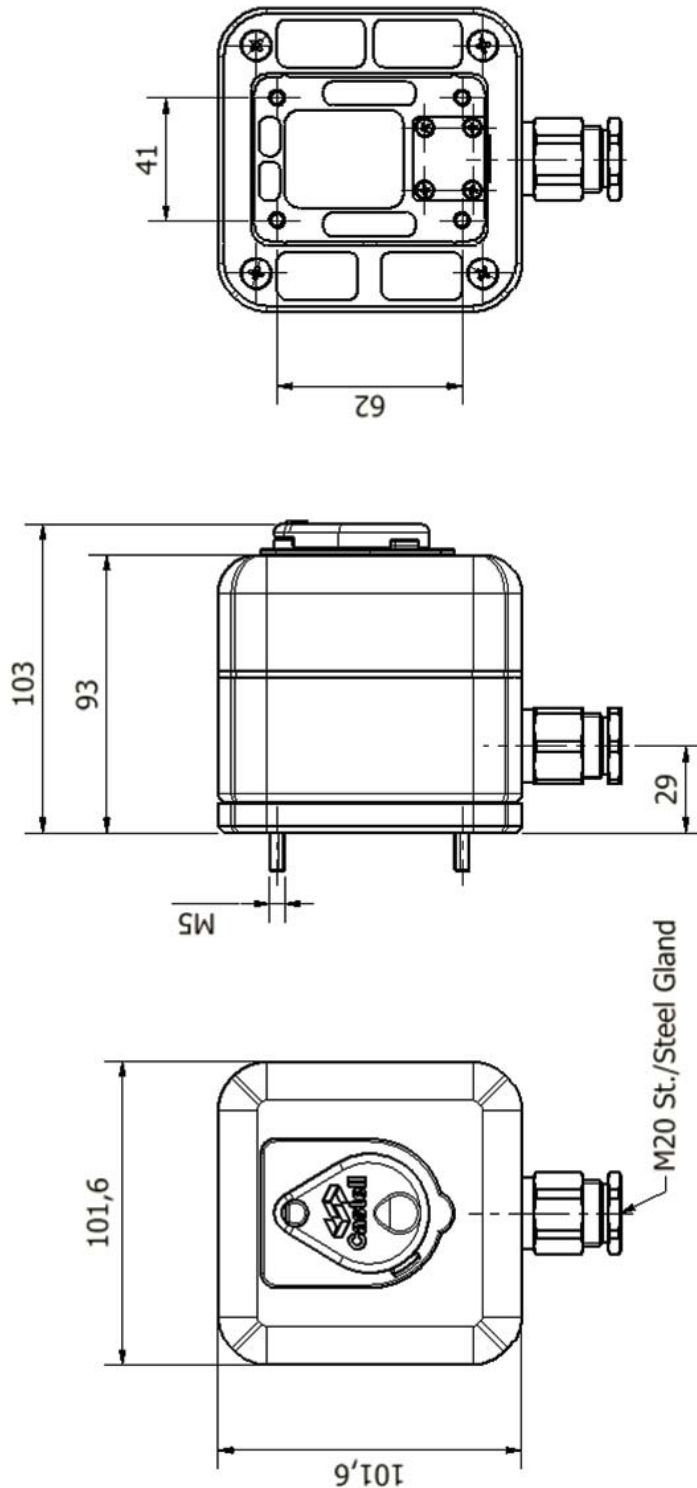


While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.


Wiring Diagram

Note: For safe mounting, use security screws

Key Free, Switch off

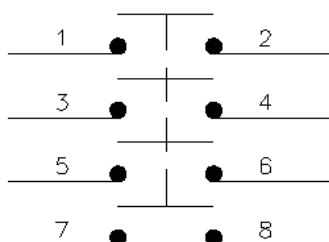

Key Free, 2 NO/2NC

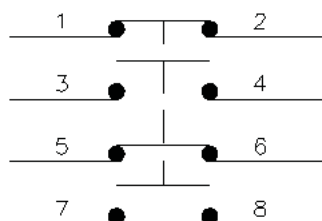

Order Information

Product Type **1**

Part Number -

Example -

2

1	Contacts arrangement	C/O4 = 2 NO/2 NC CC4 = 4NC
2	Lock portion symbol	Please advise (up to 3 characters)

Special construction available upon enquiry

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



TDI-FSB-F-1S-N/O6-110A

The TDI electronic time delay isolator is a heavy duty trapped key interlock switch controlled by a fail-safe timer and solenoid. The TDI unit is designed to control access to hazardous machines with run down times and can be used in high risk applications. It incorporates a dual channel fail-safe timer, a heavy duty continuously rated solenoid, solenoid position monitoring, a 20A isolation switch, a front panel lamp indication of solenoid position and a timer failure with one or more lock portions for multiple access applications.

Operation

The Castell TDI electronic time delay isolator is typically used for machine isolation in applications in order to protect the hazardous area from access while power is on.

TDI electronic time delay isolator

- ① Power is on, keys are trapped. Red LED is illuminated.
- ② Turn the knob to OFF position, switching the power off. Once the timer is complete, the green LED illuminates. Release the keys by pushing the green button.
- ③ Keys are released, power is off.



1. While the power is on, all keys are trapped in the TDI unit. The red LED is illuminated.
2. Turn the switch to OFF position to switch the power off. The TDI timer starts running. Once complete, the green LED illuminates. All keys can now be released by pushing the green button. The keys can be taken to unlock the access locks, which protect the motor or machine area.
3. The power is off until all keys are replaced in the TDI electronic timer and the power knob turned back to the ON position.

The TDI is available with different solenoid voltages as AC or DC: 24, 110 or 240 V (see order information on page 6 for more details).

The TDI comes with 6 contacts as standard with contacts arrangements as 3NO/3NC, but auxiliary set of contacts are available on request.

Usage

The TDI electronic time delay isolator is designed to be part of a safety system and is used to switch off the power and a pre-set time (set to be longer than the run-down time of the machine) has elapsed before releasing a key or a set of keys which is then used to gain access to a hazardous area via an access interlock such as the AI or Salus.



The TDI electronic time delay isolator is not designed for security purposes.

Installation

The TDI electronic time delay isolator should be mounted to a surface using suitable fasteners (please refer to drawing on page 4 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 4 for more installation details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The TDI range of electronic timer with power isolations must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature	Minimum: -5°C [23°F]
	Maximum: 55°C [131°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	5 kg
Material	Brass or Stainless steel lock portions, powder coated mild steel enclosure
Cable Size	M20 Gland x 2
IP Rating	IP65, NEMA 4 enclosure
Standards	UL508
Voltage	24 VDC and 240 VAC, 110 VAC

Application

The TDI is designed to operate as part of an integrated safety system, controlling access to hazardous areas to motor driven, high risk applications where a certain rundown time is required before access is granted.

When the machine is running, the key of the TDI interlock cannot be removed, preventing access to the hazardous area. To gain access to the machine area, the electrical supply must be switched off by turning the switch to OFF position. When the machine stop sequence is initiated, a signal from the machine control circuits starts the internal timer. After a pre-set time (which must exceed the machine run down time), the timer energizes the solenoid illuminating the green LED. By pushing the green button the key can be released from the TDI unit. This key is taken by the personnell to the AIE access interlock.

The machine cannot be restarted until the door is locked closed and the key is returned to the TDI electronic timer.

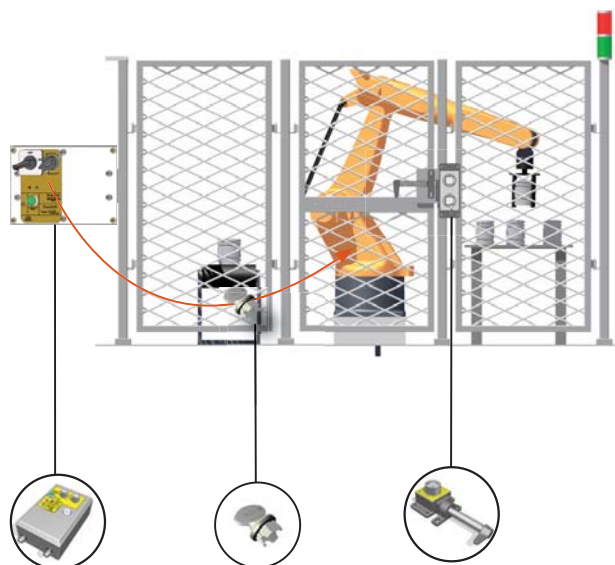

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws


TDI

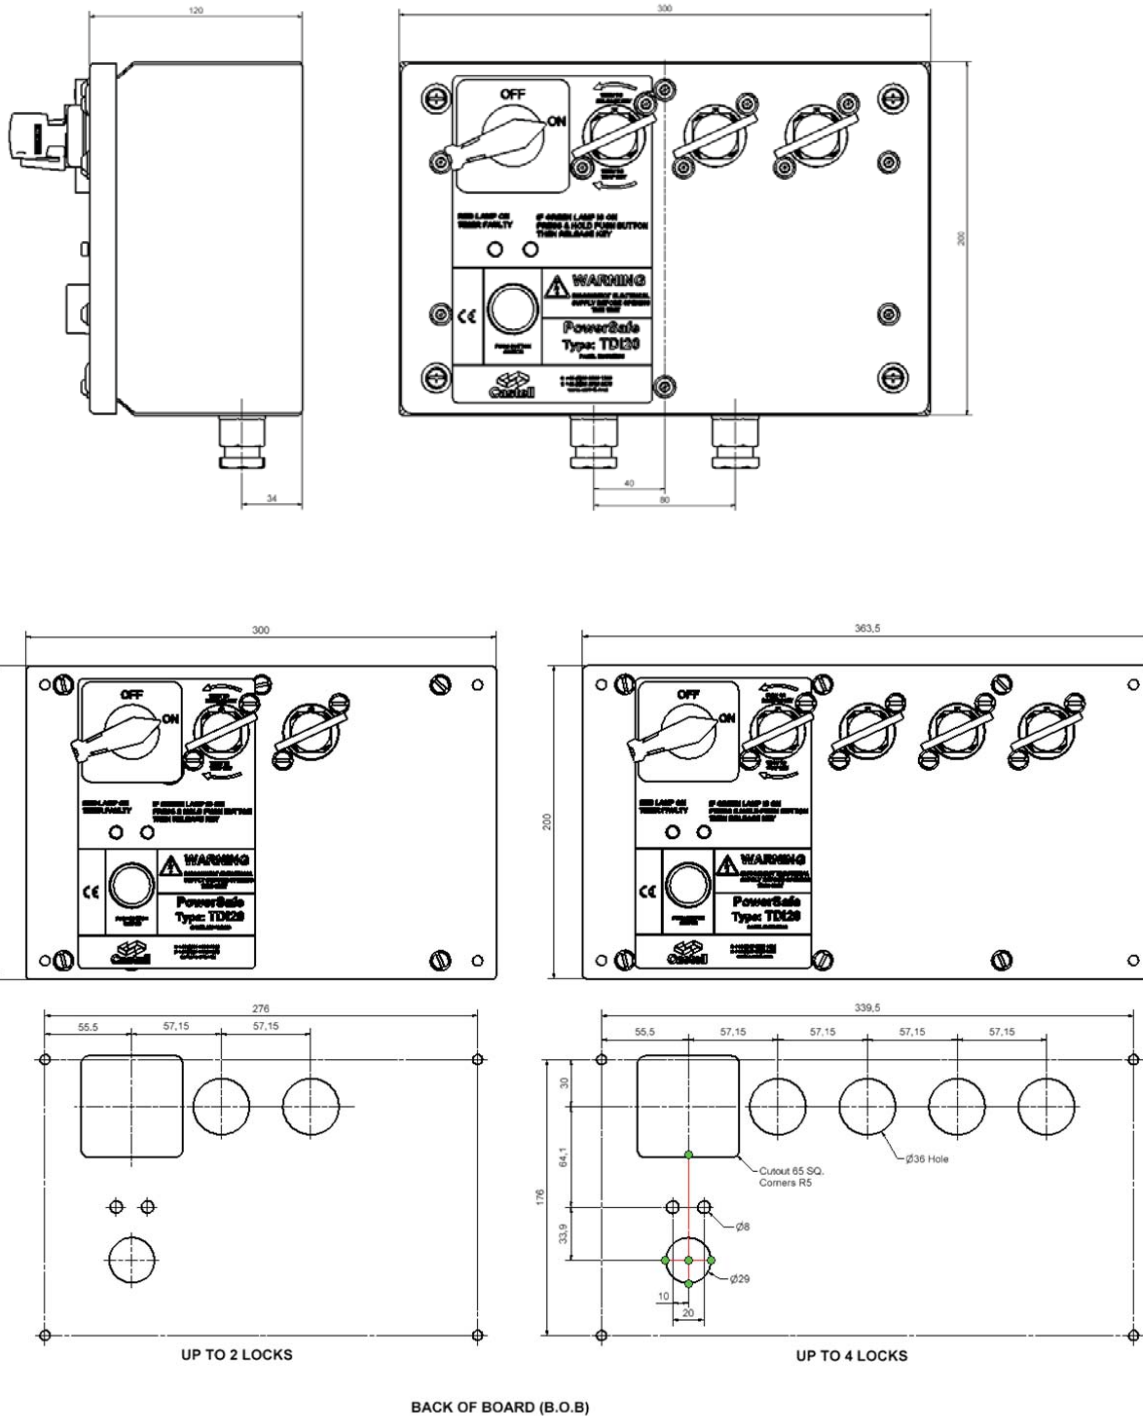


While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission. Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

Wiring Diagram


1. MACHINE CYCLE RUNNING, PRIMARY KEY TRAPPED, SOLENOID DE-ENERGISED.

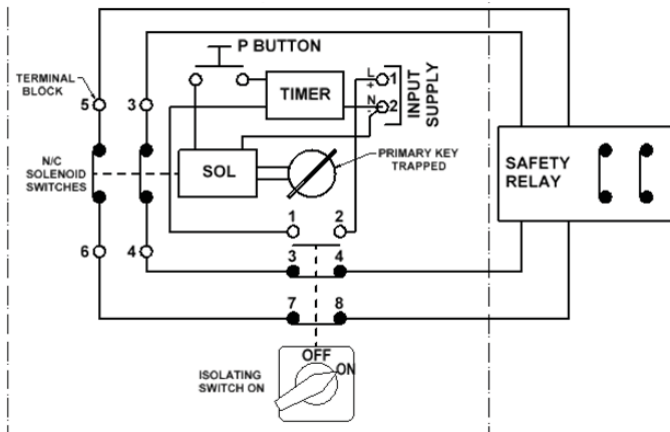


2. SWITCH OFF, ISOLATING SWITCH MACHINE RUNDOWN STARTED, TIMER ENERGISED.

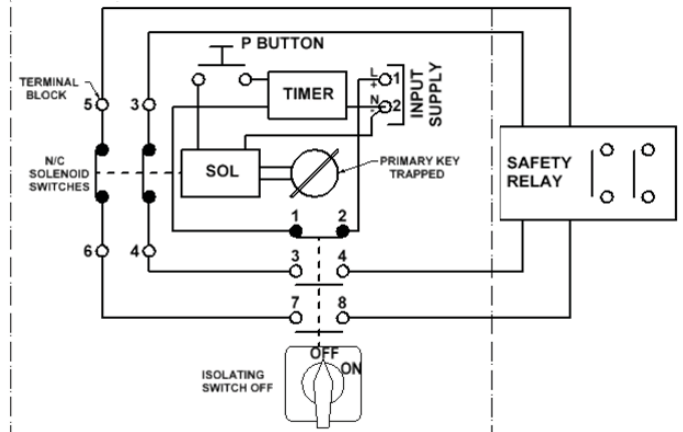

3. TIME DELAY IS FINISHED, PRESS PUSH BUTTON TO ENERGISE SOLENOID, TURN KEY ACW TO RELEASE.

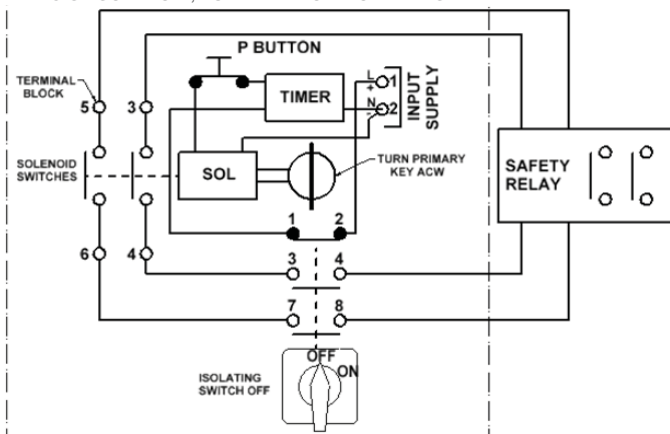

4. KEY IS RELEASED, MACHINE IS ISOLATED, SOLENOID DE-ENERGISED.

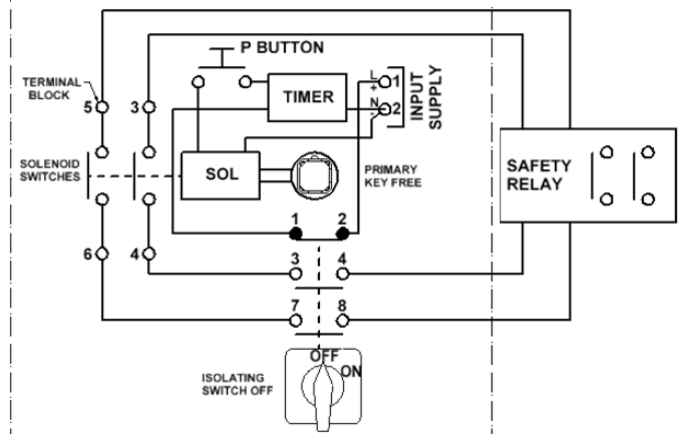

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	TDI								
Example	TDI	FS	B	F	1	E	N/O6	110	A

9 A1 Isolation Key Symbol
(exchange key condition)
OR
 Primary Key Symbol
(double key condition)

10 B1 Personnel Key Symbol
(exchange key condition)
OR
 Secondary Key Symbol
(double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Mounting	F = Front of board mount, with enclosure (standard) P = Panel mount
4	Secondary (additional) lock portion(s)	1 / 2 / 3 etc. secondary lock portions available
5	Key condition	S = for secondary lock portions, if simultaneous removal of all keys required E = for secondary lock portions, if exchange key version required
6	Contacts arrangement in normal position (standard)	N/O6 = 6 contacts, 3no/3nc arrangement (standard)
7	Control voltage	110 / 24 / 240 (standard)
8	Current	VAC / VDC
9	Lock portion symbol: Isolation key (for exchange key condition) or Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
10	Lock portion symbol: Personnel key (for exchange key condition) or Secondary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Contact Information

Special construction available upon enquiry

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

t: +49 (0) 221 1649 794
f: +49 (0) 221 1649 795
e: vertrieb@castell.com

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



TDR-FSB-F-3D-N/O6-110A

The TDR time delay remote unit is a heavy duty trapped key interlock switch controlled by a fail-safe timer and solenoid. The unit is designed to control access to hazardous machines with run down times and can be used in high risk applications. The unit incorporates a dual channel fail-safe timer, heavy duty continuously rated solenoid, solenoid position monitoring, 20A electrical switch, front panel lamp indication of solenoid position and timer failure with up to four lock centers for multiple access applications.

Operation

The Castell TDR time delay remote unit with electrical isolation is typically used for machine isolation in applications in order to protect the hazardous area from access while power is on.

TDR electronic time delay remote unit with electrical isolation

- ① All keys are trapped. No signal to the TDR unit.
- ② Continuous voltage signal initiates timer. After time delay, release the keys by pushing the green button.
- ③ All keys are free.



1. The keys are trapped in the TDR. Switch contacts arrangement: 3 normally open and 3 normally closed.
2. When the machine stop sequence is initiated, a signal from the machine control circuits starts the timer in the TDR unit. Once completed, the timer energizes the solenoid illuminating the green LED. By pushing the green button the keys can be released. These keys are taken by the personnell to the machine area.
3. The machine cannot be restarted until all keys are replaced and trapped in the TDR time delay remote unit.

The TDR is available with different solenoid voltages as AC or DC: 24, 110 or 240 V (see order information on page 7 for more details).

The TDR comes with 6 contacts as standard with contacts arrangements as 3NO/3NC, but auxiliary set of contacts are available on request.

Usage

The TDR time delay remote unit with electrical isolation is designed to be part of a safety system and is used to switch off the power. The TDR waits for a signal from the machine which starts the time delay countdown, before releasing a key, which is then used to gain access to a hazardous area via an access interlock such as the AI, AIE or Salus.



The TDR time delay remote unit with electrical isolation is not designed for security purposes.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The TDR time delay remote unit with electrical isolation should be mounted to a surface using suitable fasteners (please refer to drawing on page 4-5 for more details). The lock face should be sealed to the panel for ingress protection.

Cables should be connected to the switch in accordance with the applicable wiring diagrams. Ensure that the unit is bonded for earth continuity (please refer to drawing on page 6 for more details).



IMPORTANT:

The interlock should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The TDR range of electronic timer with electrical isolations must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager / safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature	Minimum: -5°C [23°F]
	Maximum: 55°C [131°F]
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4-5 for more details)
Weight	5 kg
Material	Brass or Stainless steel lock portions, powder coated mild steel enclosure
Cable Size	M20 Gland x 2
Voltage	24 VAC/VDC and 110 VAC, 240 VAC
Max Motor Voltage	600V
Max Power Consumption	20VA / 18W

Application

The TDR is designed to operate as part of an integrated safety system, controlling access to hazardous areas to motor driven, high risk applications where a certain time rundown is required before access is granted.

While machine is running, the keys are trapped in the TDR interlock, preventing access to the machine area. To gain access to the area, the electrical supply must be switched off via the machine control panel. When the machine stop sequence is initiated, a signal from the machine control circuits starts the internal timer. After a pre-set time (which must exceed the machine run down time), the timer energizes the solenoid illuminating the green LED. By pushing the green button the keys can be released. These keys are taken by the personnell to the AIE access interlocks on the doors.

The machine cannot be restarted until all doors are locked closed and all keys returned to the TDR electronic timer.

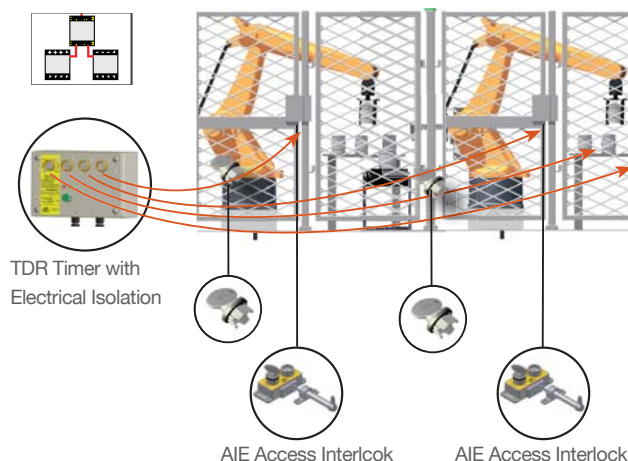

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Dr T.C. Whelan
Managing Director




Drawing


Dimensions:
in mm

Note: For safe mounting, use security screws

TDR, surface mount/enclosure version (FOB = front on board)

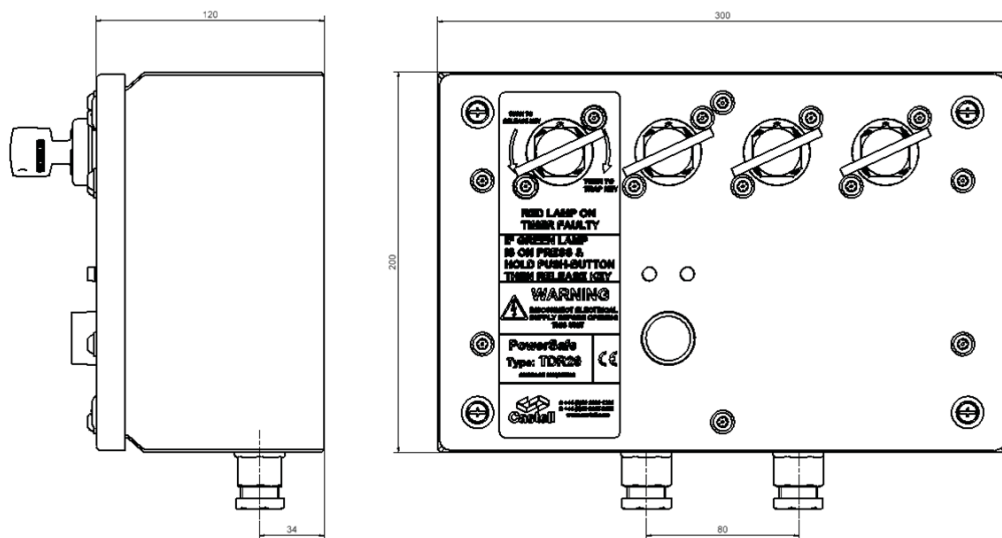

TDR, panel mount (BOB = back on board)

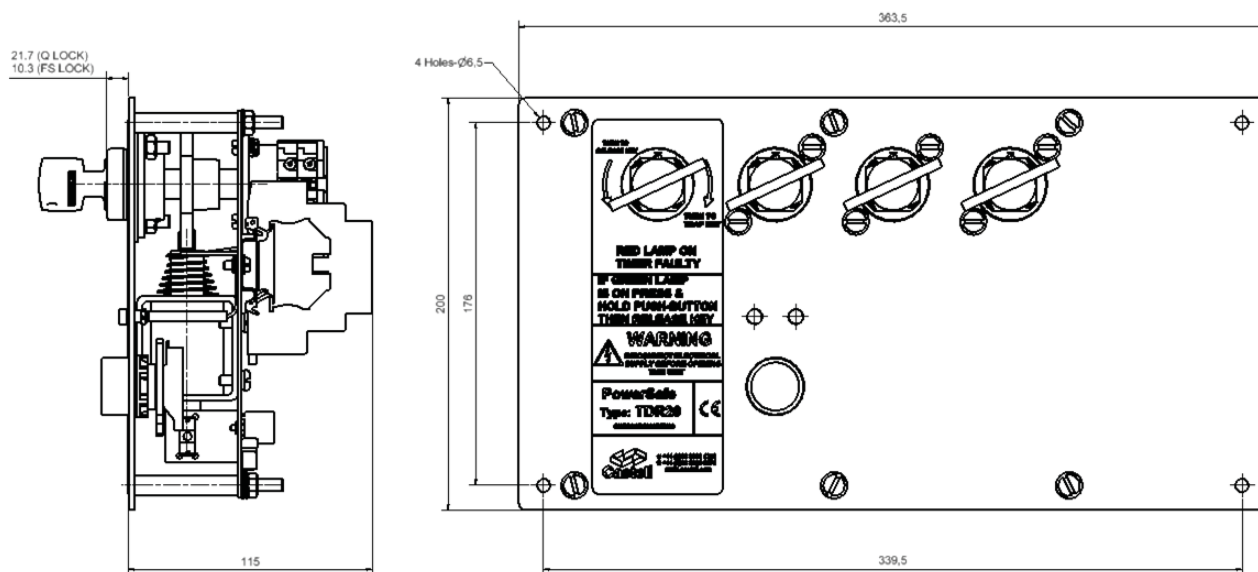


Drawing

Dimensions:
in mm


Note: For safe mounting, use security screws

TDR, surface mount/enclosure version (FOB = front on board)

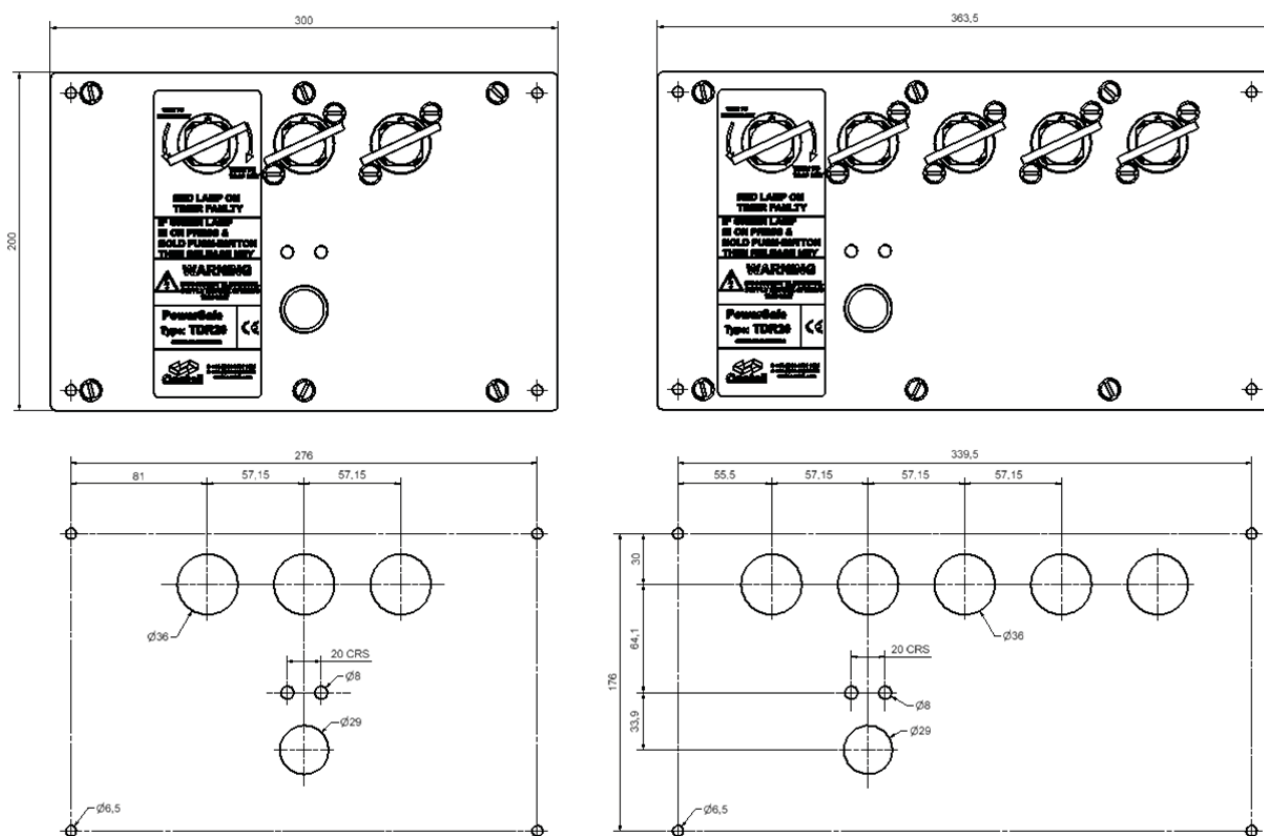

Wiring Diagram

TDR

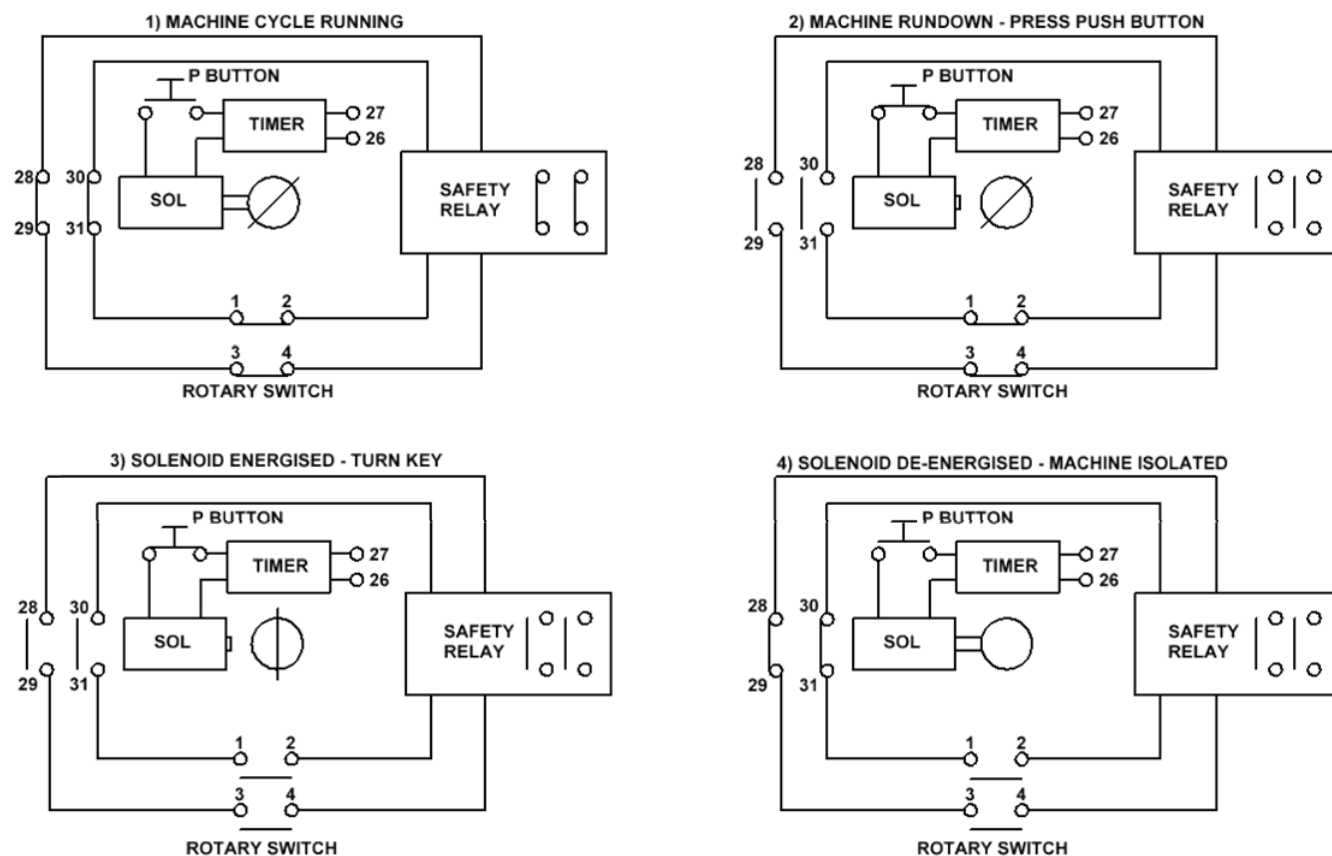

Order Information

	Product Type	1	2	3	4	5	6	7	8
Part Number	TDR								
Example	TDR	FS	B	F	3	D	N/O6	110	A

9	A1	Isolation Key Symbol (exchange key condition)
	OR	Primary Key Symbol (double key condition)

10	B1	Personnel Key Symbol (exchange key condition)
	OR	Secondary Key Symbol (double key condition)

1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass / S = Stainless steel
3	Mounting	F = Front of board mount, with enclosure (standard)
4	Secondary (additional) lock portion(s)	1 = 1 secondary lock portion available as standard version
5	Key condition	D = Double key version / S = secondary keys as for exchange key version
6	Contacts arrangement in normal position (standard)	N/O6 = 6 contacts, 3NO/3NC arrangement (standard)
7	Control voltage	110 / 24 / 240 (standard)
8	Current	VAC / VDC
9	Lock portion symbol: Isolation key (for exchange key condition) or Primary key (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
10	Lock portion symbol: Personnel key(s) (for exchange key condition) or Secondary key(s) (for double key condition)	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** Up to 3 characters **Q - Lock type** Up to 6 characters



Contact Information

Special construction available upon enquiry

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



X-FSB

The W key selector box is designed to enable the controlled release of keys by the positioning of a selector knob. It is typically used in switchgear applications ensuring multiple supplies are not applied to common bus bars. The W box is suitable for releasing any number of keys, in a pre-determined sequence in differing combinations. A maximum of six selector knob positions is available. The requirement for this type of product usually arises due to various system setups i.e. in the control of switchgear. The W box is supplied in an enclosure suitable for surface mounting.


Operation

Castell W key selector boxes are used in switch gear applications to ensure multiple supplies are not applied to common bus bars.

W key selector box, horizontal mount (5 keys)

- ① Determine the required combination of trapped/released keys to operate the incomers and bus bars
- ② Find the corresponding selector knob position in the truth table (containing all possible combinations pre-determined as per individual requirements)
- ③ Select the position of the selector knob (1-4) and release the required set of keys

W box front

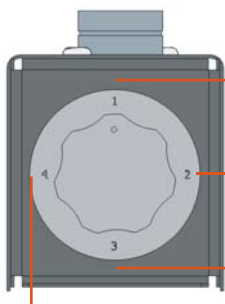

Selector Switch

	Inc 1	Inc 2	Inc 3	Bus 1	Bus 2
1	F	F	F	T	T
2	T	F *	F *	F	T
3	F	T	F *	F*	T
4	F *	F	T	T	F

F = free key

T = trapped key

* = key not returned between two neighbouring selections

Usage

W key selector boxes should be used in switchgear applications to allow a safe access to potential hazardous and dangerous areas with one or more access points.



The W key selector box is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The W key selector box should normally be mounted on the static frame using suitable fasteners (please refer to drawing on page 4 for more details). The W key selector boxes are available in horizontal and vertical mounting versions. Anti vibration pads should be used on machines that generate a high level of vibration



IMPORTANT:

The W key selector box should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The W key selector box must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data


Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 1 kg for 2 lock options, add 0,5 kg per additional portion
	Stainless steel: 1 kg for 2 lock options, add 0,5 kg per additional portion
Material	Brass or stainless steel
MTTF Certification	Available on request

Application

A typical application of the W key selector box is switchgear to ensure that multiple supplies are not applied to common bus bars.

In the application illustrated key I1 will operate incomer 1, key I2 will operate incomer 2 and key I3 will operate incomer 3. Key B1 operates bus coupler 1 while key B2 operates bus coupler 2. When the key is inserted, the corresponding switch is closed.

The system shown is in condition 1 (see table) and has the three incomer switches closed and the busbar switches open. To change the system to condition 2 the I1 key is returned to the selector box and the selector knob moved to condition 2. In this position, the B1 key can be removed and the B1 Busbar switch closed.

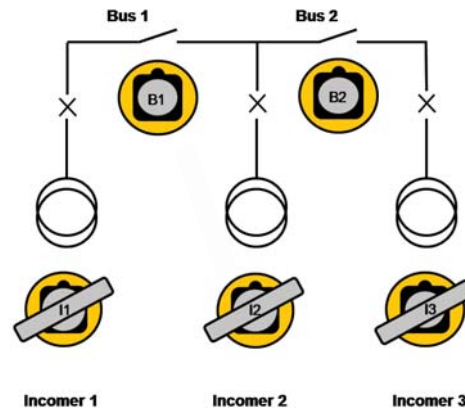

	Inc 1 (I1)	Inc 2 (I2)	Inc 3 (I3)	Bus 1 (B1)	Bus 2 (B2)
1	F	F	F	T	T
2	T	F *	F *	F	T
3	F	T	F *	F *	T
4	F *	F	T	T	F

F = free key

T = trapped key

* = key not returned between two neighbouring selections

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

W key selector box, horizontal mount

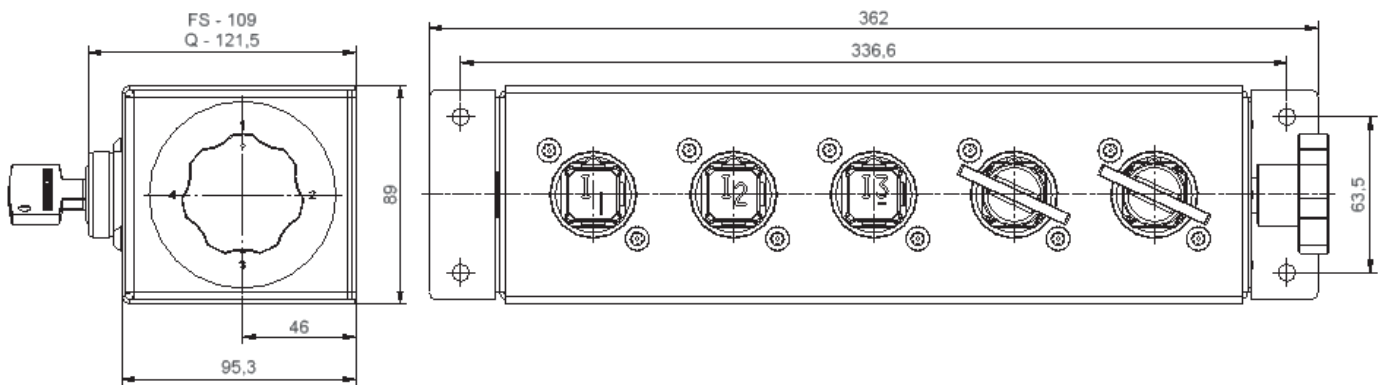

Order Information

	Product Type	1	2
Part Number	<input type="text" value="W"/>	-	<input type="text"/>
Example	<input type="text" value="W"/>	-	<input type="text" value="FS"/> <input type="text" value="B"/>
	3		
	<input type="text"/>		Truth Table


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass S = Stainless steel
3	Truth table: please provide or contact our technical support	see example on page 1

(1) **FS - Lock type** Up to 3 characters **Q - Lock type** Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com


Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.

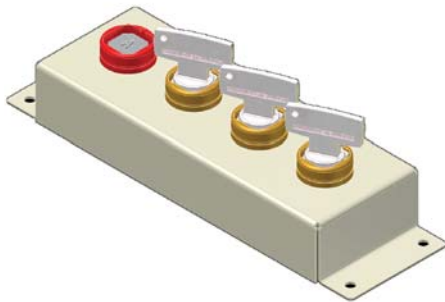

X-FSB-H-1/3

The X key exchange box is designed to enable the release of keys by the insertion of one or more primary key(s). The need for this type of product usually arises when there are multiple points of entry. The unit will generally be the link between the isolation locks and the access products. The product is supplied in an enclosure suitable for surface mounting and is available in a number of configurations and number of locks.

Operation



Castell Key Exchange Boxes are used in various applications to control (multi-)door access(es) to hazardous areas.

X key exchange box, horizontal mount

① 1 key is free, 3 keys are trapped.

② Insert and turn the free key, then turn and release the trapped keys in a sequence.

③ 1 key is trapped, 3 keys are released

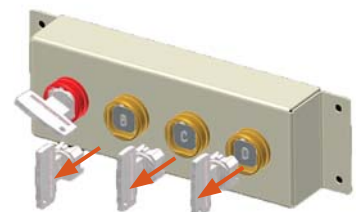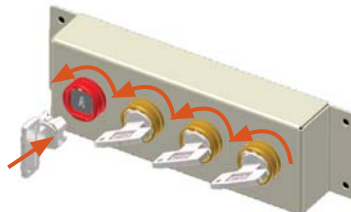

1. While 1 key is free which is usually used in a power isolation, 3 keys are trapped.
2. By inserting and turning the free key in the X key exchange box, trapped keys can be sequentially released. The released keys can be used in the access door locks to gain access to the hazardous area.
3. The inserted key stays trapped until all released keys are returned to their original position.

The X key exchange box is available in different combinations of free and trapped keys and also in a vertical mounting version.



Usage

X key exchange boxes should be used to allow a safe access to potential hazardous and dangerous areas with one or more access points.



The X key exchange box is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The X key exchange box should normally be mounted on the static frame using suitable fasteners. Please refer to the drawing on page 4 for maximum and minimum mounting distance and hole details. The X key exchange boxes are available in horizontal and vertical mounting versions. Anti vibration pads should be used on machines that generate a high level of vibration.



IMPORTANT:

The X key exchange box should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The X key exchange box must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.



Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	Surface mount using suitable fasteners (please refer to drawing on page 4 for more details)
Weight	Brass: 1 kg for 2 lock options, add 0,5 kg per additional portion
	Stainless steel: 1 kg for 2 lock options, add 0,5 kg per additional portion
Material	Brass or stainless steel
MTTF Certification	Available on request


Application

A typical application of the X key exchange box is machine guarding with one or more access points to the hazardous area.

The key exchange box is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed. The system involves a KS key switch for the electrical supply and typically more than one AIE access interlocks for full body access.

The removal of the isolation key from the key switch isolates the electrical supply to the machine. This key is taken to the X key exchange box to release the trapped keys. The released keys are used to gain access through the AIE door interlocks.

The machine cannot be restarted until all keys are returned to the key exchange box and the power isolation key is removed and taken to the KS key switch.

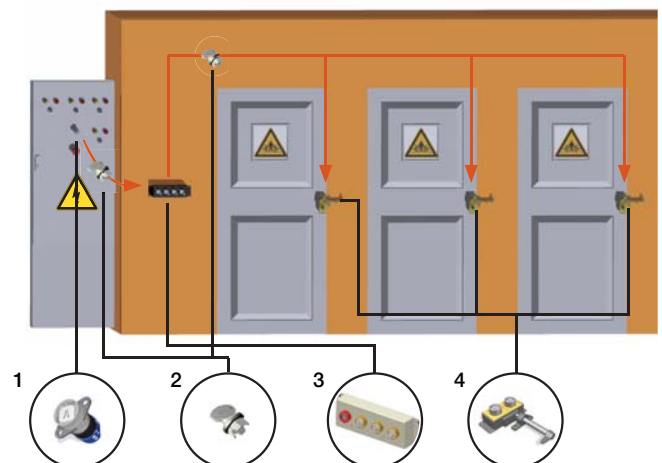

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:


Mr T.C. Whelan
Managing Director

Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

X, horizontal mount

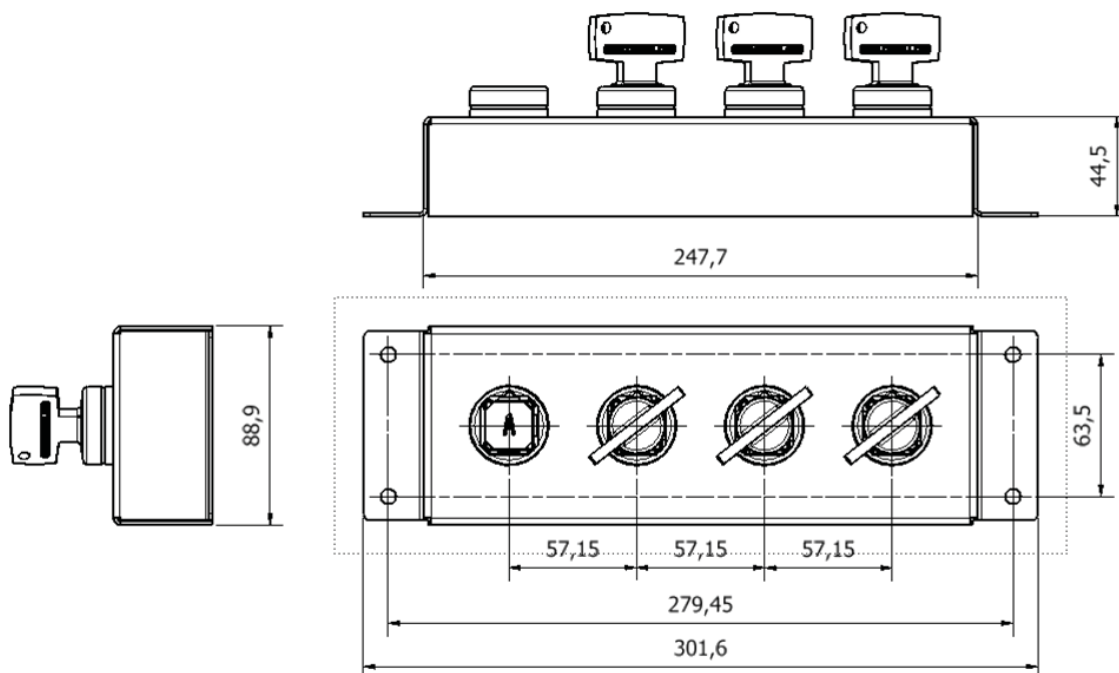



Order Information

Product Type	1	2	3	4	5
Part Number	X				
Example	X	FS	B	H	1 / 3
	6				
	A1	Free Key Symbol(s)/keys in			
	7				
	B1	Trapped Key Symbol(s)/keys out			


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass S = Stainless steel
3	Mounting	H = Horizontal V = Vertical
4	Number of free keys (keys in)	please specify
5	Number of trapped keys (keys out)	please specify
6	Lock portion symbol(s), free keys - all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
7	Lock portion symbol(s), trapped keys - all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) FS - Lock type Q - Lock type
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



Y-FSB-H-1/8

The Y key exchange box is a product designed to enable the release of keys by insertion of an initial key. The Y box is designed for the release of six or more keys, with no upper limit, with the keys being released in any order once the isolation (end key) has been inserted. The need for this type of product usually arises due to there being more keys required than the initial isolation system supplies. The unit will generally be the link between the isolation locks and the access products. The Y box is supplied in an enclosure suitable for surface mounting.

Operation

Castell Key Exchange Boxes are used in various applications to control multi-door accesses to hazardous areas.

Y key exchange box, horizontal mount (1 key free - 8 keys trapped)

① End key is free, front keys are trapped



② Insert and turn end key, then turn and release front keys in any order



③ End key is trapped, front keys are free



1. While the end key is free which is usually used in a power isolation, all (8) front keys are trapped.
2. By inserting and turning the free end key in the Y key exchange box, you can release the trapped front keys in any order. Once the first key has been removed, the end key stays trapped. The released keys can be used in the access door locks to gain access to the hazardous area.
3. The end key stays trapped until all released keys are replaced and turned to their original position.

The Y key exchange box is available with different numbers of front keys and also in a vertical mounting version.



Usage

Y key exchange boxes should be used to allow a safe access to potential hazardous and dangerous areas with one or more access points.



The Y key exchange box is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The Y key exchange box should normally be mounted on the static frame using suitable fasteners. Please refer to the drawing on page 4 for maximum and minimum mounting distance. Y key exchange boxes are available in horizontal and vertical mounting versions. Anti vibration pads should be used on machines that generate a high level of vibration



IMPORTANT:

The Y key exchange box should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The Y key exchange box must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	surface mount using suitable fasteners
Weight	Brass: 1 kg for 2 lock portions, add 0,5 kg per additional portion
	Stainless steel: 1 kg for 2 lock portions, add 0,5 kg per additional portion
Material	Brass or stainless steel
MTTF Certification	Available on request


Application

A typical application of the Y key exchange box is machine guarding with more than one access points to the hazardous area.

The key exchange box is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed. The system involves a KS key switch for the electrical supply and typically more than one AI access interlock for part body access.

The removal of the isolation key from the key switch isolates the electrical supply to the machine. This key is taken to the Y key exchange box to release the trapped keys. The released keys are used to gain access through the AI door interlocks.

The machine cannot be restarted until all keys are returned to the Y key exchange box and the end key (power isolation key) is removed and taken to the KS key switch.

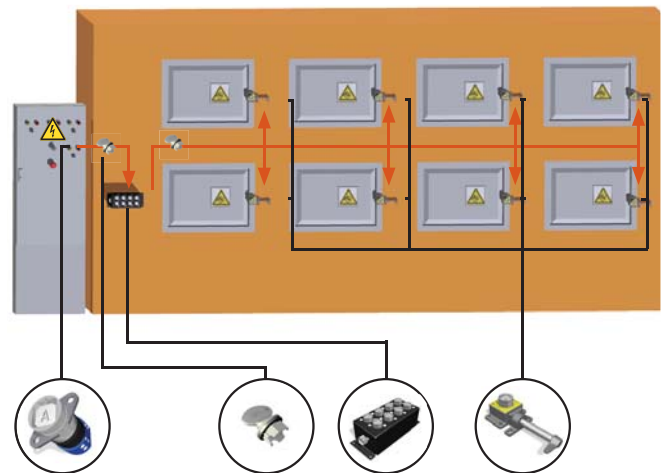

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

Y key exchange box, horizontal mount

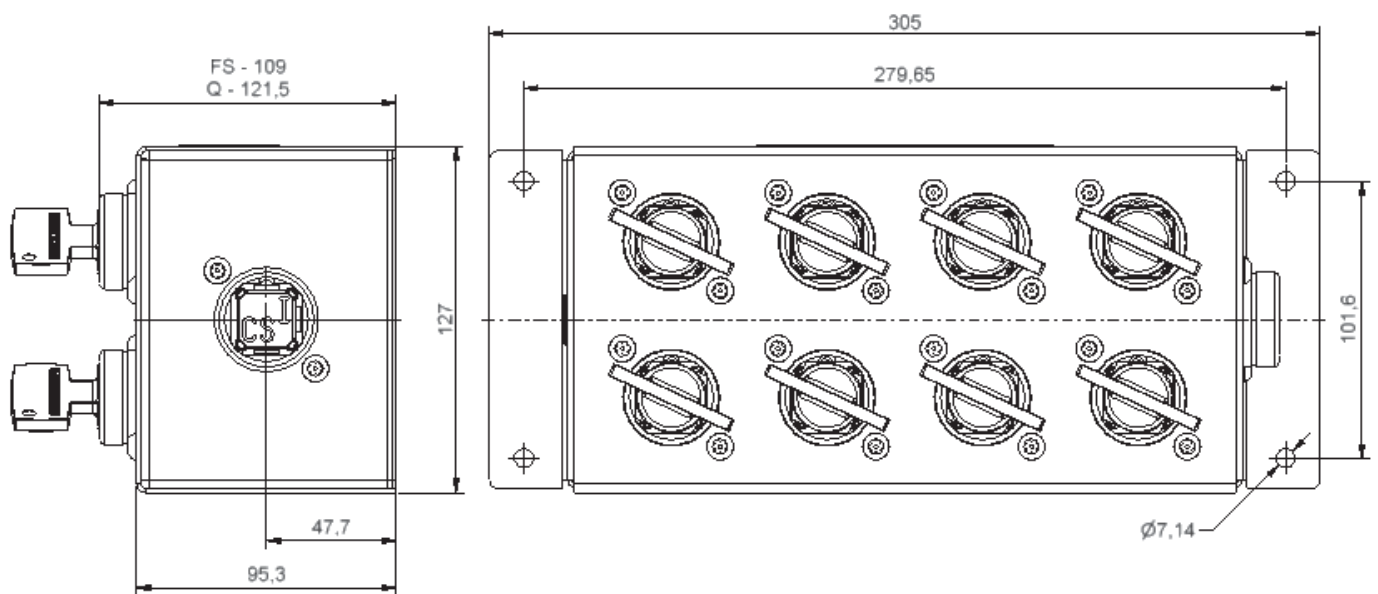

Order Information

	Product Type	1	2	3	4	5
Part Number	Y					
Example	Y	FS	B	H	1	8
	6					
	A	End Lock Symbol				
	7					
	B	Front Lock Symbol(s)				


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass S = Stainless steel
3	Mounting	H = Horizontal V = Vertical
4	Number of Free Keys	1 (standard)
5	Number of Trapped Keys	please specify
6	Lock portion symbol - End Key	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
7	Lock portion symbol(s) - Front Key(s), all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.



Z-FSB-H-1/4

The Z key exchange box is designed to enable the release of keys by insertion of an initial key. The Z box is suitable for releasing up to five keys in any order once the isolation (end key) has been inserted. The requirement for this type of product usually arises due to there being more keys required than the initial isolation system supplies. The unit will generally be the link between the isolation locks and the access products. The Z box is supplied in an enclosure suitable for surface mounting.

Operation

Castell Key Exchange Boxes are used in various applications to control multi-door accesses to hazardous areas.

Z key exchange box, horizontal mount (1 key free - 3 keys trapped)

① End key is free, 4 front keys trapped



② Insert and turn end key, then turn and release front keys in any order



③ End key is trapped, 4 front keys are free



1. While the isolation key is free, this is usually trapped in the power isolator, the access keys, positioned on the front, are trapped.
2. By inserting the isolation key the access keys are released in any order. Once the first access key has been removed the isolation key will be trapped. The access keys can then be used to access the protected area via access locks.
3. The isolation key remains trapped until all the access keys have been returned

The Z key exchange box is available with up to five front keys and also in a vertical mounting version.

Usage

Z key exchange boxes should be used to allow a safe access to potential hazardous and dangerous areas with one or more access points.



The Z key exchange box is not designed for security purposes, such as a safe or external access to a building.

No hazardous substances were used in the manufacture of this product. The product can be disposed of in standard waste.

Installation

The Z key exchange box should normally be mounted on the static frame using suitable fasteners. Please refer to the drawing on page 4 for maximum and minimum mounting distance. The Z key exchange boxes are available in horizontal and vertical mounting versions. Anti vibration pads should be used on machines that generate a high level of vibration



IMPORTANT:

The Z key exchange box should be mounted using anti-tamper fasteners to prevent unauthorised removal.



The Z key exchange box must be installed by a competent and qualified person who has read and understood these instructions. Please retain this document in your technical file.

Maintenance

Periodic visual checks should be carried out by the site manager/safety officer.
Do not lubricate lock barrel with oil or grease, use CK Dry Powder Graphite if necessary.



In case of defects being detected please contact your nearest Castell Support Department for further actions.
Please see Contact section for contact details.

Technical Data

Temperature rating	Minimum: -40°C [-40°F] ice free for Q & FS type
	Maximum: 107°C [224,6°F] for Q type/140°C [284°F] for FS type or 288°C [550°F] upon request
Type of mounting	surface mount using suitable fasteners
Weight	Brass: 1 kg for 2 lock options, add 0,5 kg per additional portion
Material	Brass
MTTF Certification	Available on request


Application

A typical application of the Z Key Exchange Box is machine guarding with one or more access points to the hazardous area.

The key exchange box is used as a part of a safety system, which ensures a machine is shut down, before access to the hazardous area is allowed. The system involves a KS key switch for the electrical supply and typically more than one AIE access interlocks for full body access.

The removal of the isolation key from the key switch isolates the electrical supply to the machine. This key is taken to the Z key exchange box to release the trapped keys. The released keys are used to gain access through the AIE access interlocks.

The machine cannot be restarted until all keys are returned to the Z key exchange box and the power isolation key is released and replaced in the KS key switch.

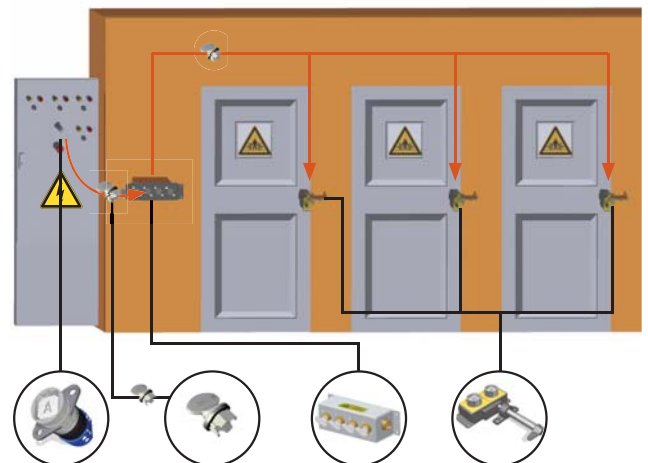

EC-Declaration

We, the manufacturers, declare that the components, detailed herein and placed on the market, comply with all the essential health and safety requirements applying to them.

Empowered signatory:

Mr T.C. Whelan
Managing Director




Drawing

Dimensions:
in mm

Note: For safe mounting, use security screws

Z key exchange box, horizontal mount

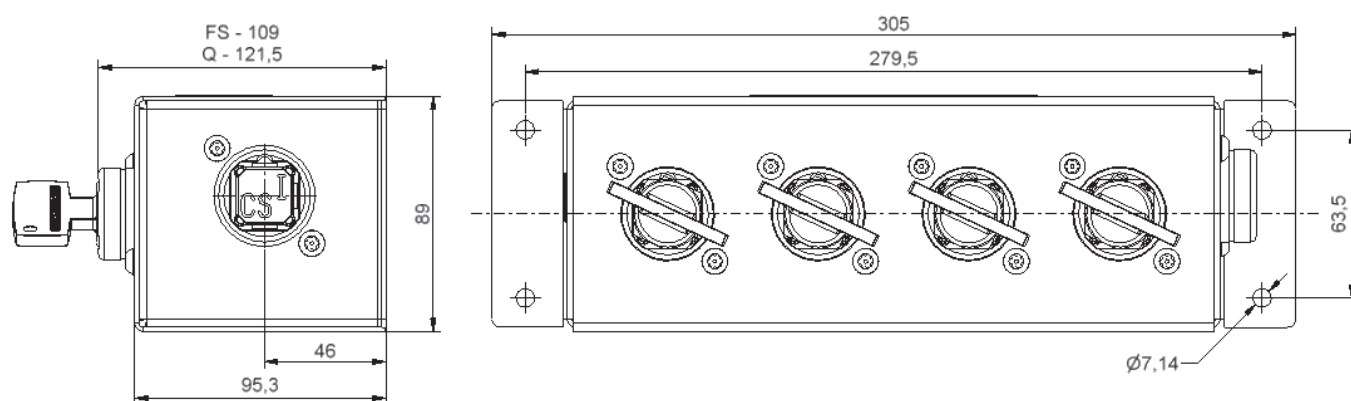

Order Information

	Product Type	1	2	3	4	5
Part Number	Z					
Example	Z	FS	B	H	1	3
	6					
	A	End Lock Symbol				
	7					
	B	Front Lock Symbol(s)				


1	Lock portion type	FS ⁽¹⁾ / Q ⁽¹⁾
2	Material	B = Brass (standard)
3	Mounting	H = Horizontal V = Vertical
4	Number of End Keys	1 (standard)
5	Number of Front Keys	please specify
6	Lock portion symbol - End Key	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters
7	Lock portion symbol(s) - Front Key(s), all to be advised separately	FS ⁽¹⁾ up to 3 characters / Q ⁽¹⁾ up to 6 characters

(1) **FS - Lock type** **Q - Lock type**
Up to 3 characters Up to 6 characters



Special construction available upon enquiry

Accessories

	Product	Part number
	Flip Cap	FLIP-S

Contact Information

Castell Safety International Ltd.
The Castell Building
217 Kingsbury Road
London, England NW9 9PQ

t: +44 (0) 20 8200 1200
f: +44 (0) 20 8905 9378
e: uksales@castell.com

Castell Safety International Ltd.
Oskar-Jäger-Strasse 137
50825 Köln
Germany

t: +49 (0) 221 1694 794
f: +49 (0) 221 1694 795
e: vertrieb@castell.com

Castell Interlocks Inc.
Suite 800
150 N Michigan Avenue,
Chicago, Illinois 60601
USA

t: +1.312.360.1516
f: +1.312.268.5174
e: ussales@castell.com

Castell Safety China
Building 1, No. 123,
Lane 1165, Jindu Road,
Minhang District,
Shanghai 201108, China.

t: +86 21 61519023
f: +86 21 61519030
e: chinasales@castell.com

While every effort has been made to ensure the accuracy of the information provided, no liability can be taken for any errors or omission.
Castell Safety International Limited reserves the right to alter specifications and introduce improvements without prior notice.